Reference

(Data summarized on January 9)

Place of Sampling	West Gate of Fukushima Daiichi NPS		MP-1 of Fukushima Daini (Reference)				Danaity limit by the appayment of
Time of Sampling	2012/1/8 7:00 ~ 12:00		2012/1/8 9:14 ~ 9:24				Density limit by the announcement of Reactor Regulation (Bq/cm3) (Density limit in the air to which radiation workers breathe in the section 4 of the appendix 2)
Detected Nuclides (Half-life)	density of sample (Bq/cm3)	Scaling Factor (/)	density of sample (Bq/cm3)	Scaling Factor (/)	density of sample (Bq/cm3)	Scaling Factor (/)	broadie in the doctor i of the appendix 2)
I-131 (about 8 days)	ND	-	ND	-			1E-03
Cs-134 (about 2 years)	ND	1	ND				2E-03
Cs-137 (about 30 years)	ND	-	ND	-			3E-03

^{*} The value of radioactivity density is the sum of the value of volatile nuclide's density and the value of particulate nuclide's density.

O.OE - O means O.O x 10-O

Data of other nuclides are under examination.

Detection limits of 3 nuclides on the West Gate of Fukushima Daiichi are as follows:

 $Volatile: I-131: approx.\ 1E-7Bq/cm3,\ Cs-134:\ approx.\ 3E-7Bq/cm3,\ Cs-137:\ approx.\ 3E-7Bq/cm3$

Particulate: I-131: approx. 6E-8Bq/cm3, Cs-134: approx. 2E-7Bq/cm3, Cs-137: approx. 2E-7Bq/cm3


Detection limits of 3 nuclides on MP-1 of Fukushima Daini are as follows:

Volatile: I-131: approx. 2E-6Bq/cm3, Cs-134: approx. 3E-6Bq/cm3, Cs-137: approx. 3E-6Bq/cm3 Particulate: I-131: approx. 9E-7Bq/cm3, Cs-134: approx. 2E-6Bq/cm3, Cs-137: approx. 2E-6Bq/cm3

^{*} In the case that two or more kinds of nuclides exist, sum of each scaling factor to the density limit is compared with 1.

^{* &}quot;ND" means the sampled data is below measurable limit.

West Gate of Fukushima Daiichi Nuclear Power Station Results of Dust Nuclide Analysis (Bq/cm3)

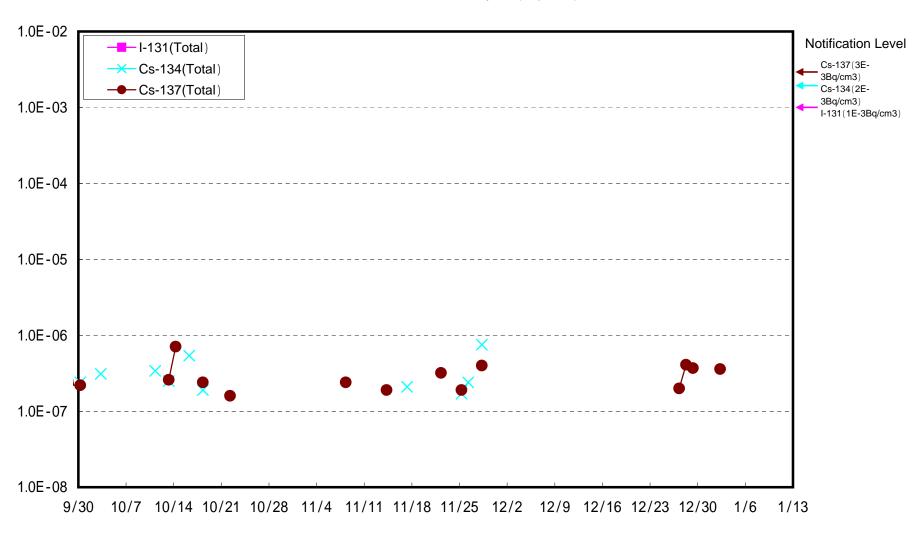

(Reference) Fukushima Daini MP-1 Results of Dust Nuclide Analysis (Bq/cm3)

