Reference

Nuclide Analysis Results of Radioactive Materials in the Air at the Sites of Fukushima Nuclear Power Stations <1/2>

(Data summarized on May 9)

Place of Sampling	West Gate of Fukushima Daiichi NPS		MP-1 of Fukushima Daini (Reference)				Density limit by the announcement of Reactor Regulation (Bq/cm3) (Density limit in the air to which radiation workers
Time of Sampling	May 8, 2012 7:00 ~ 12:00		May 8, 2012 9:41 ~ 9:51				
Detected Nuclides (Half-life)	density of sample (Bq/cm3)	Scaling Factor (/)	density of sample (Bq/cm3)	Scaling Factor (/)	density of sample (Bq/cm3)	Scaling Factor (/)	breathe in the section 4 of the appendix 2)
I-131 (approx. 8 days)	ND	-	ND	-			1E-03
Cs-134 (approx. 2 years)	ND	-	ND	-			2E-03
Cs-137 (approx. 30 years)	ND	-	ND	-			3E-03

^{*} The value of radioactivity density is the sum of the value of volatile nuclide's density and the value of particulate nuclide's density.

O.OE - O means O.O x 10-O

Data of other nuclides are under examination.

Detection limits at the West Gate of Fukushima Daiichi are as follows:

Volatile: I-131: approx. 1E-7Bq/cm3, Cs-134: approx. 3E-7Bq/cm3, Cs-137: approx. 3E-7Bq/cm3

134: approx. 2E-7Bq/cm3, Cs-137: approx. 2E-7Bq/cm3

Detection limits at MP-1 of Fukushima Daini are as follows:

Volatile: I-131: approx. 2E-6Bq/cm3, Cs-134: approx. 2E-6Bq/cm3, Cs-137: approx. 3E-6Bq/cm3 134: approx. 1E-6Bq/cm3, Cs-137: approx. 2E-6Bq/cm3

Particulate: I-131: approx. 6E-8Bq/cm3, Cs-

Particulate: I-131: approx. 1E-6Bq/cm3, Cs-

^{*} In the case that two or more kinds of nuclides exist, sum of each scaling factor to the density limit is compared with 1.

^{* &}quot;ND" means the sampled data is below measurable limit.

Reference

Nuclide Analysis Results of Radioactive Materials in the Air at the Sites of Fukushima Nuclear Power Stations <2/2>

(Data summarized on May 9)

Place of Sampling	Fukushima Daiichi MP-1		Fukushima Daiichi MP-3		Fukushima Daiichi MP-8		Density limit by the announcement of Reactor Regulation (Bq/cm3) (Density limit in the air to which radiation workers
Time of Sampling	May 8, 2012 9:20 ~ 14:20		May 8, 2012 8:47 ~ 13:47		May 8, 2012 9:00 ~ 14:00		
Detected Nuclides (Half-life)	density of sample (Bq/cm3)	Scaling Factor (/)	density of sample (Bq/cm3)	Scaling Factor (/)	density of sample (Bq/cm3)	Scaling Factor (/)	breathe in the section 4 of the appendix 2)
I-131 (approx. 8 days)	ND	-	ND	1	ND	1	1E-03
Cs-134 (approx. 2 years)	ND	-	ND	-	ND	-	2E-03
Cs-137 (approx. 30 years)	ND	-	ND	-	ND	-	3E-03

^{*} The value of radioactivity density is the sum of the value of volatile nuclide's density and the value of particulate nuclide's density.

O.OE - O means O.O x 10-O

Data of other nuclides are under examination.


The followings show the detection limits. Volatile: I-131: approx. 2E-7Bq/cm3, Cs-134: approx. 4E-7Bq/cm3, Cs-137: approx. 5E-7Bq/cm3 Particulate: I-131: approx. 9E-8Bq/cm3, Cs-134: approx. 2E-7Bq/cm3, Cs-137: approx. 3E-7Bq/cm3

Please note that these nuclides are sometimes detected even when they are below the limits, contingent on the detector or samples.


^{*} In the case that two or more kinds of nuclides exist, sum of each scaling factor to the density limit is compared with 1.

^{* &}quot;ND" means the sampled data is below measurable limit.


West Gate of Fukushima Daiichi Nuclear Power Station Results of Dust Nuclide Analysis (Bq/cm3)

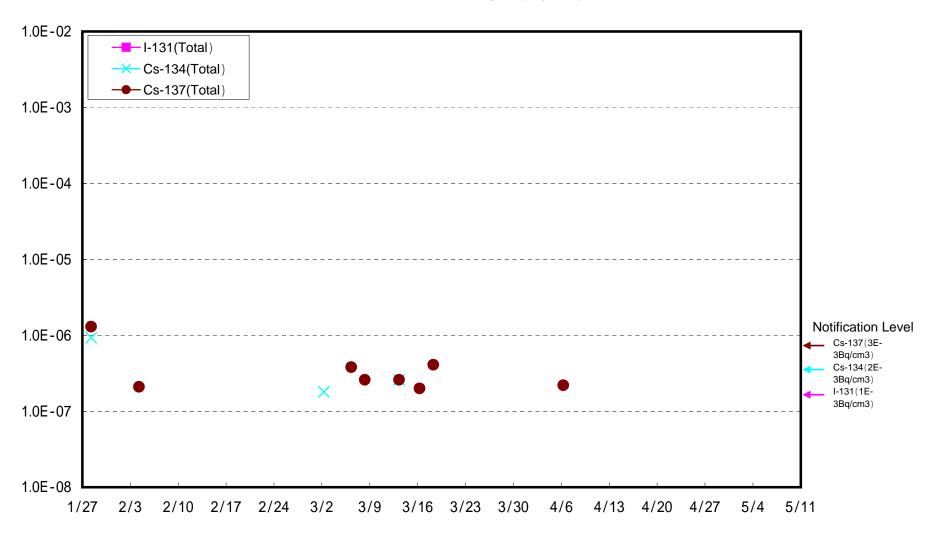


(Reference) Fukushima Daini MP-1 Results of Dust Nuclide Analysis (Bq/cm3)

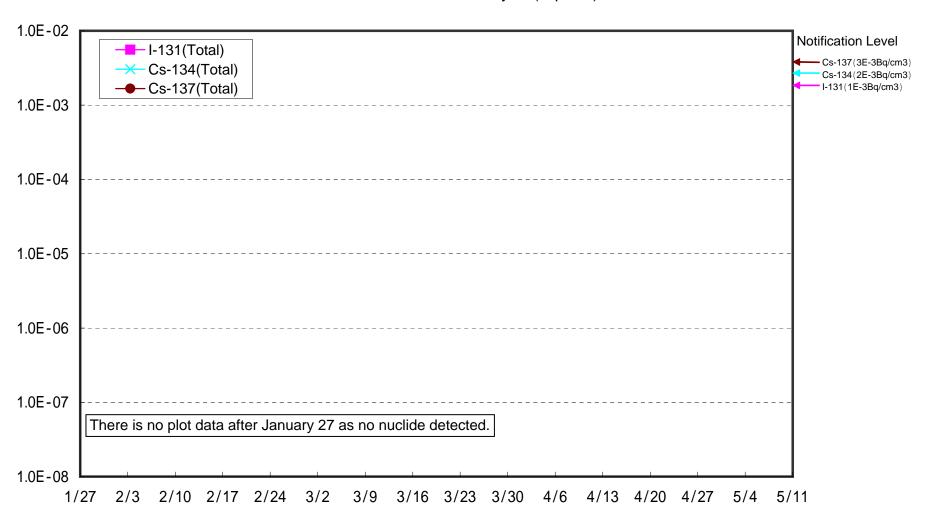

Fukushima Daiichi MP-1 Results of dust nuclides analyses (Bq/cm3)

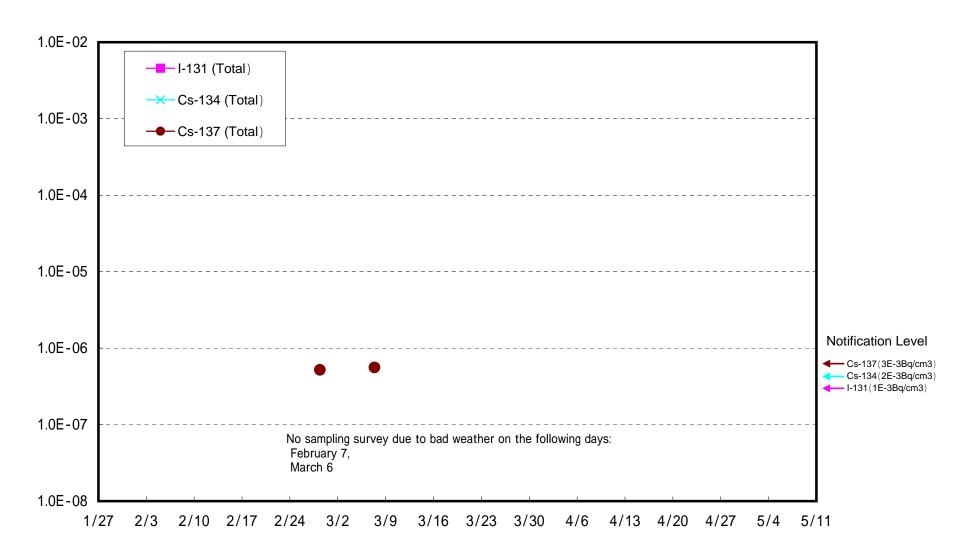

Fukushima Daiichi MP-3 Results of dust nuclides analyses (Bq/cm3)

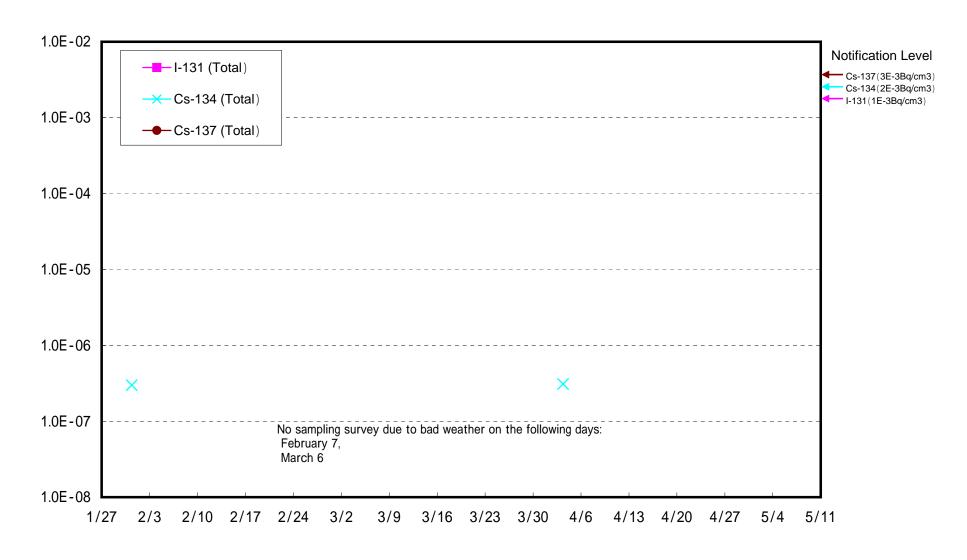

Fukushima Daiichi MP-8 Results of dust nuclides analyses (Bq/cm3)

