

Reference

Nuclide Analysis Results of the Radioactive Materials in the Air at Fukushima Nuclear Power Stations < 1/2 >

(Data summarized on September 5)

Place of Sampling	The West Gate of Fukushima Daiichi NPS		MP-1 of Fukushima Daini NPS (Reference)				Density Limit Specified by the Reactor Regulation (Bq/cm <sup>3</sup> ) (Density limit in the air which radiation workers breathe in is specified in section 4 of Appendix 2)
Time of Sampling	September 4, 2012 7:00 AM - 12:00 PM		September 4, 2012 10:11 AM - 10:21 AM				
Detected Nuclides (Half-life)	Density of Sample (Bq/cm <sup>3</sup> )	Scaling Factor ( / )	Density of Sample (Bq/cm <sup>3</sup> )	Scaling Factor ( / )	Density of Sample (Bq/cm <sup>3</sup> )	Scaling Factor ( / )	
I-131 (Approx. 8 days)	ND	-	ND	-			1E-03
Cs-134 (Approx. 2 years)	ND	-	ND	-			2E-03
Cs-137 (Approx. 30 years)	ND	-	ND	-			3E-03

\* The radioactivity density is the sum of the volatile nuclides density and the particulate nuclides density.

O.OE - O is the same as O.O x 10<sup>-0</sup>

Data of other nuclides is under examination.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

\* "ND" indicates that the measurement result is below the detection limit.

The detection limits at the west gate of Fukushima Daiichi NPS are as follows:      Volatile: I-131: Approx. 1E-7Bq/cm<sup>3</sup>, Cs-134: Approx.2E-7Bq/cm<sup>3</sup>, Cs-137: Approx.3E-7Bq/cm<sup>3</sup>      Particulate: I-131: Approx. 6E-8Bq/cm<sup>3</sup>, Cs-134: Approx.1E-7Bq/cm<sup>3</sup>, Cs-137: Approx.2E-7Bq/cm<sup>3</sup>      The detection limits at MP-1 of Fukushima Daini MPS are as follows:      Volatile: I-131: Approx. 2E-6Bq/cm<sup>3</sup>, Cs-134: Approx.2E-6Bq/cm<sup>3</sup>, Cs-137: Approx.2E-6Bq/cm<sup>3</sup>      Particulate: I-131: Approx. 8E-7Bq/cm<sup>3</sup>, Cs-134: Approx.9E-7Bq/cm<sup>3</sup>, Cs-137: Approx.9E-7Bq/cm<sup>3</sup>

Reference

Nuclide Analysis Results of the Radioactive Materials in the Air at Fukushima Nuclear Power Stations < 2/2 >

(Data summarized on September 5)

Place of Sampling	MP-1 at Fukushima Daiichi NPS		MP-3 at Fukushima Daiichi NPS		MP-8 at Fukushima Daiichi NPS		② Density Limit Specified by the Reactor Regulation (Bq/cm3) (Density limit in the air which radiation workers breathe in is specified in section 4 of Appendix 2)	
Time of Sampling	September 4, 2012 9:31~14:31		September 4, 2012 8:59~13:59		September 4, 2012 9:09~14:09			
Detected Nuclides (Half-life)	① Density of Sample (Bq/cm3)	Scaling Factor (①/②)	① Density of Sample (Bq/cm3)	Scaling Factor (①/②)	① Density of Sample (Bq/cm3)	Scaling Factor (①/②)		
I-131 (Approx. 8 days)	ND	-	ND	-	ND	-	1E-03	
Cs-134 (Approx. 2 years)	ND	-	ND	-	ND	-	2E-03	
Cs-137 (Approx. 30 years)	ND	-	ND	-	ND	-	3E-03	

\* The radioactivity density is the sum of the volatile nuclides density and the particulate nuclides density.

O.OE—O is the same as O.O x 10-O


Data of other nuclides is under examination.

\* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.


\* "ND" indicates that the measurement result is below the detection limit.

The detection limits are as follows.   Volatile: I-131: Approx. 1E-7Bq/cm3, Cs-134: Approx.2E-7Bq/cm3, Cs-137: Approx.3E-7Bq/cm3  
Particulate: I-131: Approx. 6E-8Bq/cm3, Cs-134: Approx.1E-7Bq/cm3, Cs-137: Approx.2E-7Bq/cm3     As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.


## Dust Nuclides Analysis Result: The West Gate of Fukushima Daiichi Nuclear Power Station (Bq/cm<sup>3</sup>)

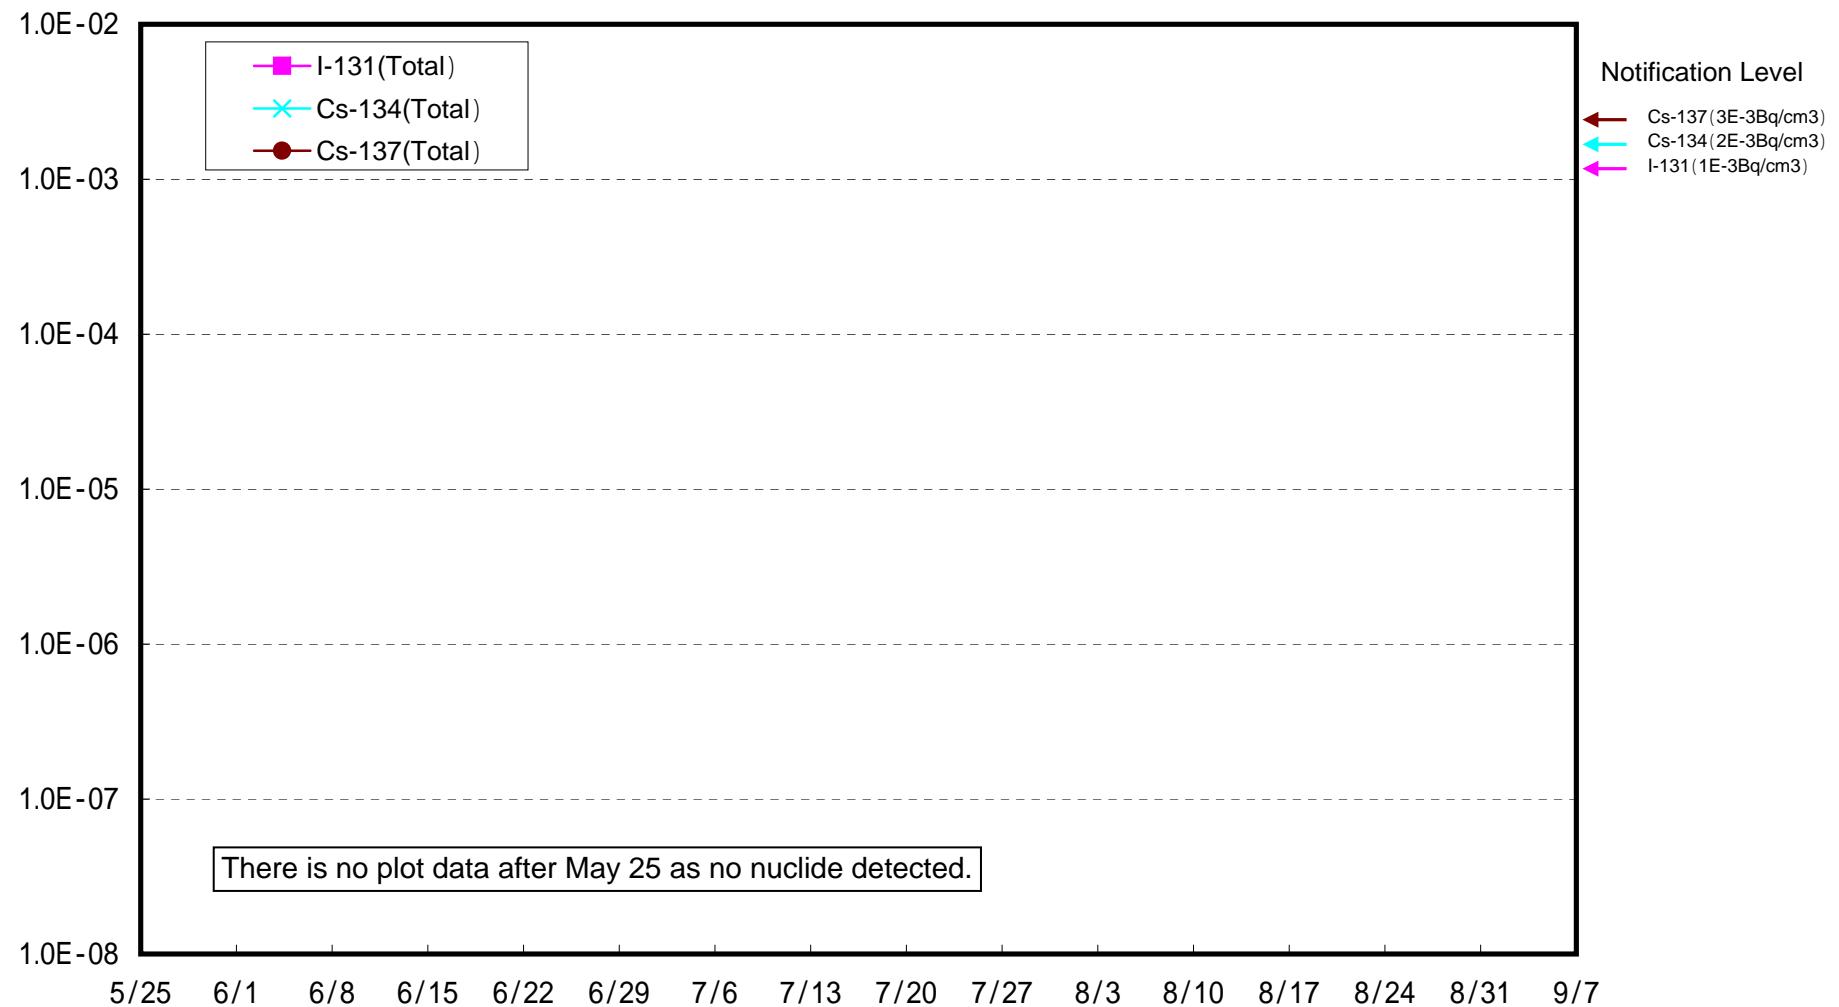


(Reference) Dust Nuclides Analysis Results of MP-1 at Fukushima Daini NPS (Bq/cm<sup>3</sup>)

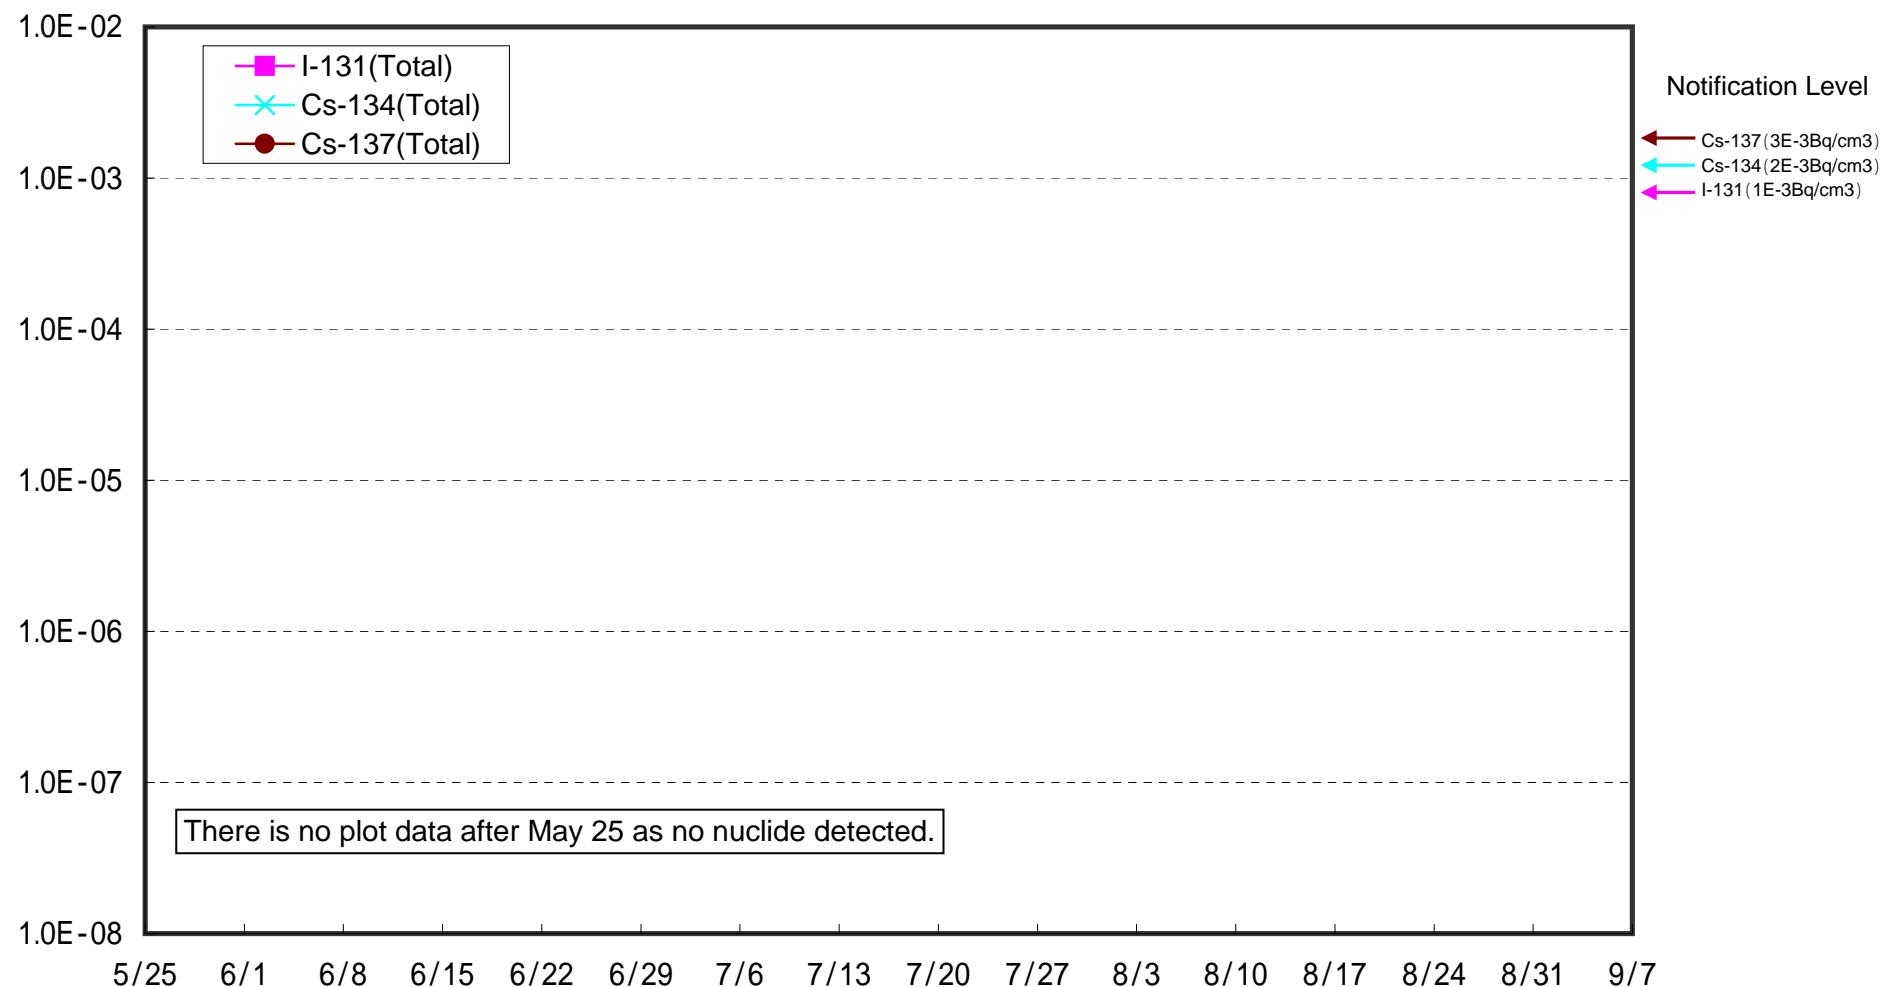

## Dust Nuclides Analysis Result: MP-1 at Fukushima Daiichi NPS (Bq/cm3)

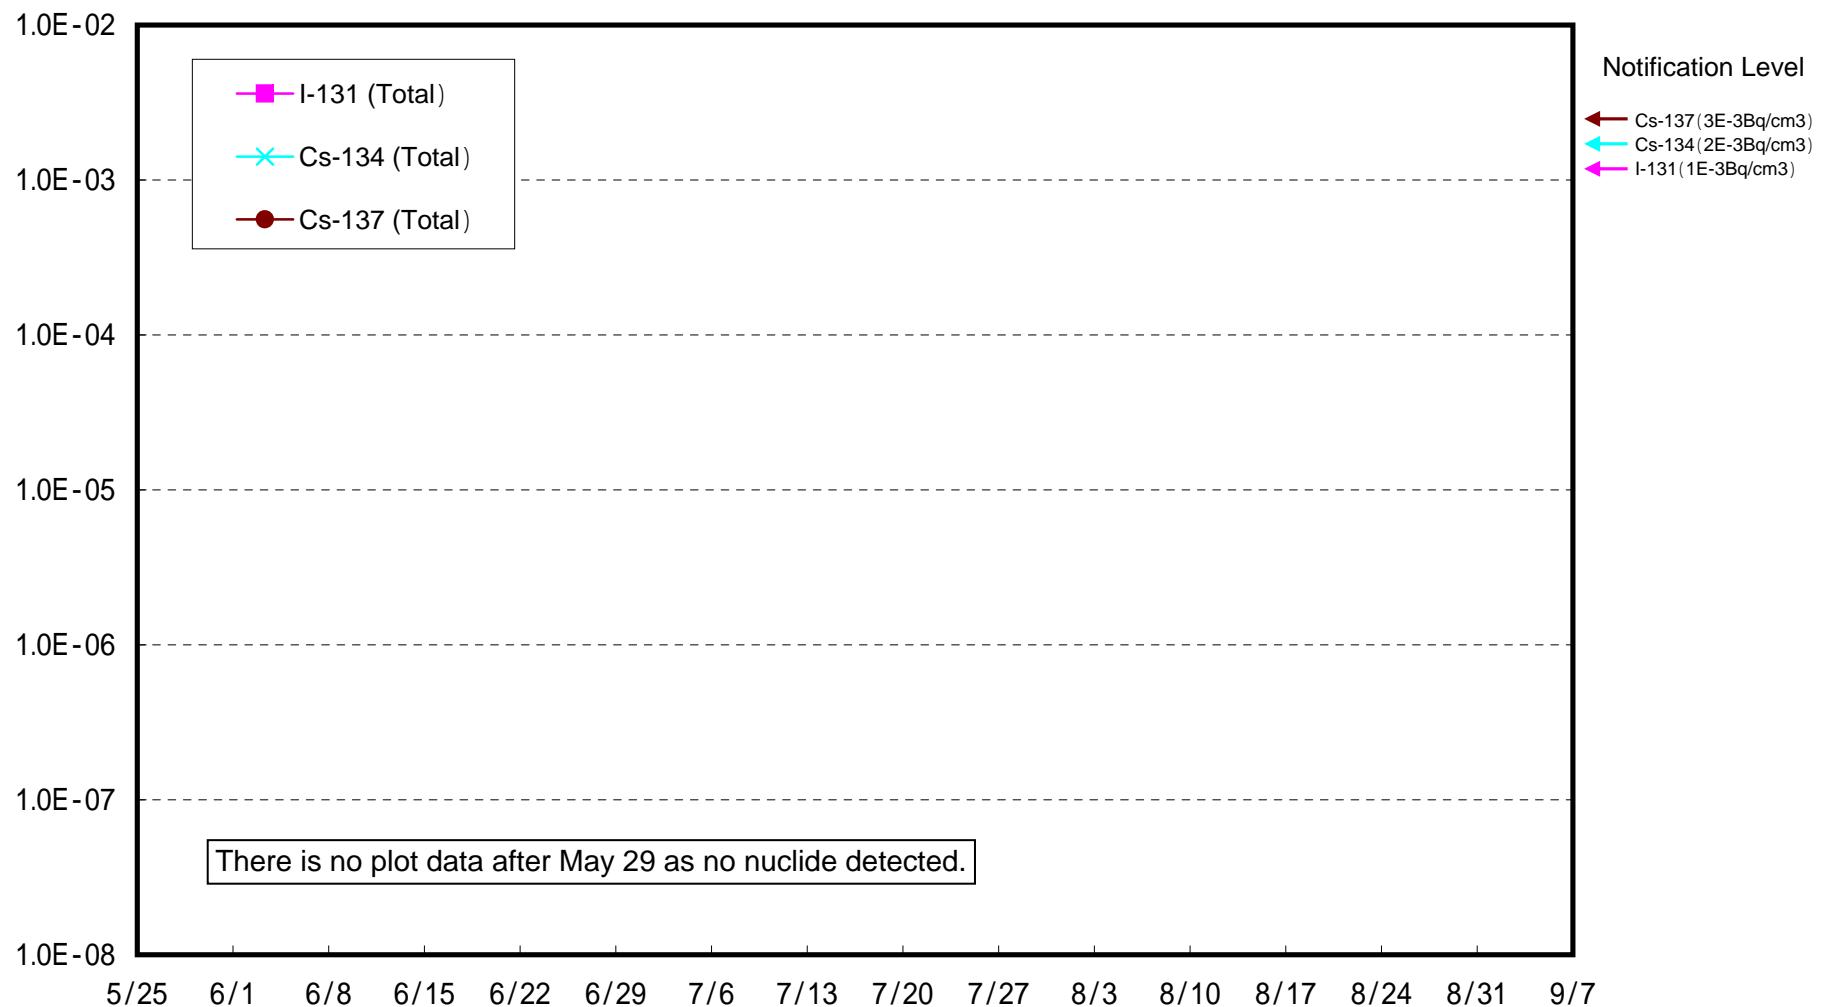

### Dust Nuclides Analysis Result: MP-3 at Fukushima Daiichi NPS (Bq/cm3)

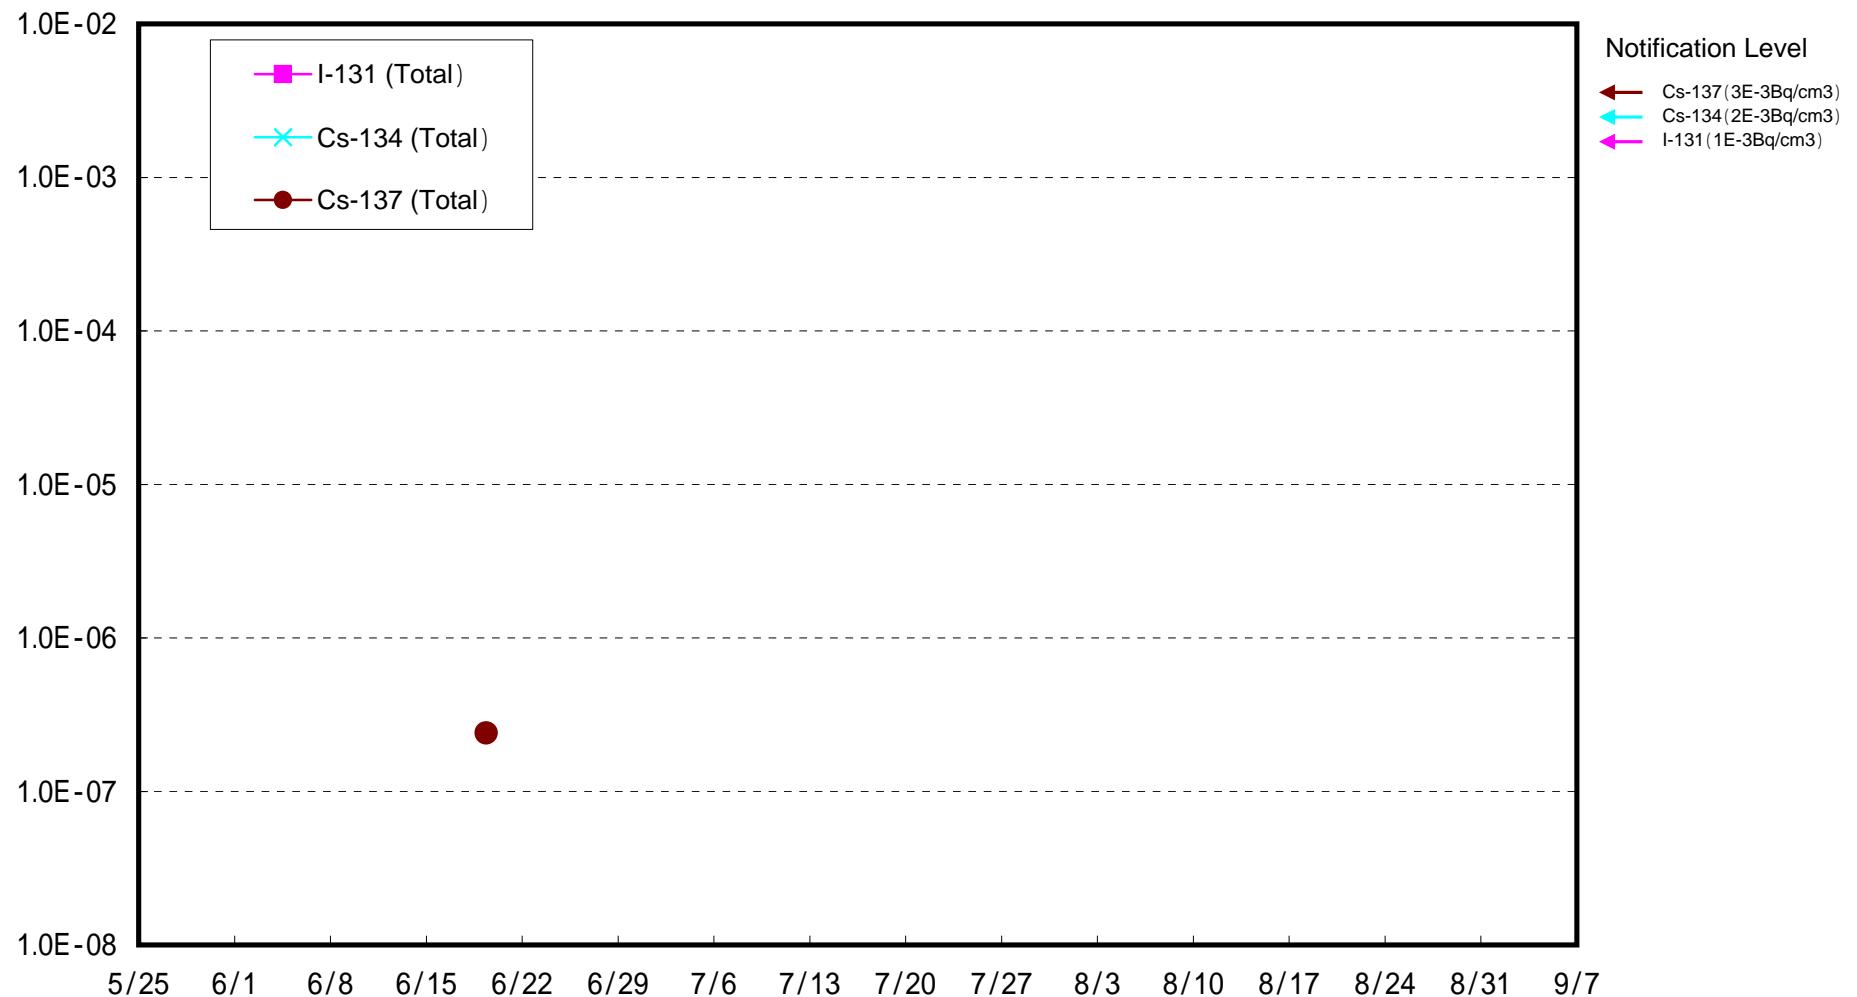

## Dust Nuclides Analysis Result: MP-8 at Fukushima Daiichi NPS (Bq/cm<sup>3</sup>)

