Reference

Nuclides Analysis Result of the Radioactive Materials in the Air at Fukushima Nuclear Power Stations (Data summarized on October 11)

Place of Sampling	The West Gate of Fukushima Daiichi NPS		MP-1 of Fukushima Daini NPS (Reference)				Density Limit Specified by
Time of Sampling	October 10, 2012 7:00 AM - 12:00 PM		October 10, 2012 9:33 AM - 9:43 AM				the Reactor Regulation (Bq/cm³) (Density limit in the air which radiation workers
Detected Nuclides (Half- life)	Density of Sample (Bq/cm ³)	Scaling Factor (/)	Density of Sample (Bq/cm ³)	Scaling Factor (/)	Density of Sample (Bq/cm ³)	Scaling Factor (/)	breathe in is specified in section 4 of Appendix 2)
I-131 (Approx. 8 days)	ND	-	ND	-			1E-03
Cs-134 (Approx. 2 years)	ND	-	ND	-			2E-03
Cs-137 (Approx. 30 years)	ND	-	ND	-			3E-03

^{*} The radioactivity density is the sum of the volatile nuclides density and the particulate nuclides density.

O.OE - O is the same as O.O x 10^{-O}

Data of other nuclides is under examination.


The detection limits at the west gate of Fukushima Daiichi NPS are as follows: Volatile: I-131: Approx. 8E-8Bq/cm3, Cs-134: Approx.2E-7Bq/cm3, Cs-137: Approx.3E-7Bq/cm3 Particulate: I-131: Approx. 5E-8Bq/cm3, Cs-134: Approx.1E-7Bq/cm3, Cs-137: Approx.1E-7Bq/cm3 The detection limits at MP-1 of Fukushima Daini MPS are as follows: Volatile: I-131: Approx. 2E-6Bq/cm3, Cs-134: Approx.2E-6Bq/cm3, Cs-137: Approx.2E-6Bq/cm3

Particulate: I-131: Approx. 8E-7Bq/cm3, Cs-134: Approx.1E-6Bq/cm3, Cs-137: Approx.1E-6Bq/cm3

^{*} In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

^{* &}quot;ND" indicates that the measurement result is below the detection limit.

Dust Nuclides Analysis Result: The West Gate of Fukushima Daiichi Nuclear Power Station (Bq/cm³)

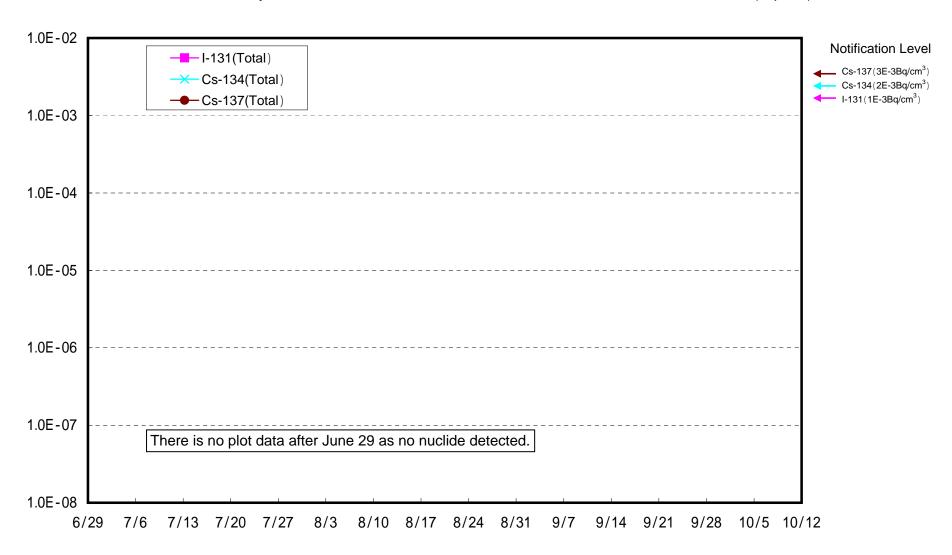

(Reference) Dust Nuclides Analysis Results of MP-1 at Fukushima Daini NPS (Bq/cm³)

