Nuclide Analysis Results of Radioactive Materials in Seawater < Coast>

Reference

(Data summarized on February 15)

Place of Sampling	North of Discha of 5-6u (approx. 30m r discharge o	of 1F orth of 5-6u	Around South Channel (appox. 330m Discharge (of 1F south of 1-4u	Around North Channel (Around 3,4u Chanr (approx. 10 kr	of 2F I Discharge nel)	Around Iwasawa (appox. 7 km : Discharge ((appox. 16 kr	south of 1,2u Channel)	Density limit by the announcement of Reactor Regulation (Bg/L)	
Time of Sampling	Feb 14, 08:45		Feb 14, 08:25		Feb 14, 08:30		Feb 14, 08:05		(the density limit in the water outside of surrounding monitored areas in the section 6 of the appendix 2)	
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)		
I-131 (about 8 days)	ND	-	ND	-	ND	-	ND	-	40	
Cs-134 (about 2 years)	1.7	0.03	ND	-	ND -		ND	-	60	
Cs-137 (about 30 years)	2.6	0.03	1.3	0.01	ND -		ND -		90	

^{*} Density by the announcement of Reactor Regulation is stated with an amount converted from Bq/cm3 to Bq/L.

I-131: approx. 0.70Bq/L, Cs-134: approx. 1.0Bq/L, Cs-137: approx. 1.0Bq/L

Please note that these nuclides are sometimes detected even when they are below the limits, contingent on the detector or samples.

^{*} Data of other nuclides are under evaluation.

^{*} In the case that two or more kinds of nuclides exist, sum of each scaling factor to the density limit is compared with 1.

^{* &}quot;ND" means the sampled data is below measurable limit.

Nuclide Analysis Results of Radioactive Materials in Seawater < Offshore 1/2>

Reference

(Data summarized on February 15)

													• '
Place of Sampling	15 km offshore of 15 km offshore of Minami-Souma Minami-Souma CityUpper Layer CityLower Layer		15 km offshore of Ukedo-gawa Upper Layer		15 km offshore of Ukedo-gawa Lower Layer		15 km offshore of Fukushima Daiichi Upper Layer		15 km offshore of Fukushima Daiichi Lower Layer		Density limit by the announcement of Reactor Regulation		
Time of Sampling	N/A		N/A		Feb 13, 2012 09:30 am		Feb 13, 2012 09:30 am		Feb 13, 2012 08:50 am		Feb 13, 2012 08:50 am		(Bq/L) (the density limit in the water outside of
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	surrounding monitored areas in the section 6 of the appendix 2)
I-131 (about 8 days)	-	-	-	-	ND	-	ND	-	ND	-	ND	-	40
Cs-134 (about 2 years)	-	-	-	-	ND	-	ND	-	ND	-	ND	-	60
Cs-137 (about 30 years)	-	-	-	-	ND	-	ND	-	ND	-	ND	-	90

Place of Sampling	Fukushima Da	15 km offshore of kushima Daini Upper Layer 15 km offshore of Fukushima Daini Lower Layer		15 km offshore of Iwasawa Shore Upper Layer		15 km offshore of Iwasawa Shore Lower Layer		15 km offshore of Hirono-town Upper Layer		15 km offshore of Hirono-town Lower Layer		Density limit by the announcement of Reactor Regulation		
Time of Sampling	Feb 13, 2 08:15 a		Feb 13, 2 08:15 a		N/A		N/A		N/A		N/A		(Bq/L) (the density limit in the water outside of	
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	surrounding monitored areas in the section 6 of the appendix 2)	
I-131 (about 8 days)	ND	-	ND	-	-	-	-	-	-	-	-	-	40	
Cs-134 (about 2 years)	ND	-	ND	-	-	-	-	-	-	-	-	-	60	
Cs-137 (about 30 years)	ND	-	ND	-	-	-	-	-	-	-	-	-	90	

^{*} Density by the announcement of Reactor Regulation is stated with an amount converted from Bq/cm3 to Bq/L.

Please note that these nuclides are sometimes detected even when they are below the limits, contingent on the detector or samples.

^{*} Data of other nuclides are under evaluation.

^{*} In the case that two or more kinds of nuclides exist, sum of each scaling factor to the density limit is compared with 1.

^{* &}quot;ND" means the sampled data is below measurable limit.

I-131: approx. 0.64Bq/L, Cs-134: approx. 0.93Bq/L, Cs-137: approx. 1.1Bq/L

Nuclide Analysis Results of Radioactive Materials in Seawater < Offshore 2/2>

Reference

(Data summarized on February 15)

Place of Sampling		km offshore of North of Skm offshore of North of Iwaki Upper Layer Iwaki Lower Layer		3 km offshore of Natsui river Upper Layer		3 km offshore of Natsui river Lower Layer		3 km offshore of Onahama port Upper Layer		3 km offshore of Onahama port Lower Layer		Density limit by the announcement of Reactor Regulation	
Time of Sampling	Feb 13, 2 06:25 a		Feb 13, 2 06:25 a		Feb 13, 2012 06:40 am		Feb 13, 2012 06:40 am		N/A		N/A		(Bq/L) (the density limit in the
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	water outside of surrounding monitored areas in the section 6 of the appendix 2)
I-131 (about 8 days)	ND	-	ND	-	ND	-	ND	-	-	-	-	-	40
Cs-134 (about 2 years)	ND	-	ND	-	ND	-	ND	-	-	-	-	-	60
Cs-137 (about 30 years)	ND	-	ND	-	ND	-	ND	-	-	-	-	-	90

Place of Sampling	3 km offshore of Ena Upper Layer 3 km offshore of Ena Lower Layer		3 km offshore of Numanouchi Upper Layer		3 km offshore of Numanouchi Lower Layer		3 km offshore of Toyoma Upper Layer		3 km offshore of Toyoma Lower Layer		Density limit by the announcement of Reactor Regulation		
Time of Sampling	N/A	N/A N/A			Feb 13, 2012 06:55 am		Feb 13, 2012 06:55 am		Feb 13, 2012 07:10 am		Feb 13, 2012 07:10 am		(Bq/L) (the density limit in the
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor	Density of Sample (Bq/L)	Scaling Factor (/)	Density of Sample (Bq/L)	Scaling Factor (/)	water outside of surrounding monitored areas in the section 6 of the appendix 2)
I-131 (about 8 days)	-	-	-	-	ND	-	ND	-	ND	-	ND	-	40
Cs-134 (about 2 years)	-	-	-	-	ND	-	ND	-	ND	ı	ND	ı	60
Cs-137 (about 30 years)	-	-	-	-	ND	-	ND	-	ND	-	ND	-	90

^{*} Density by the announcement of Reactor Regulation is stated with an amount converted from Bq/cm3 to Bq/L.

Please note that these nuclides are sometimes detected even when they are below the limits, contingent on the detector or samples.


^{*} Data of other nuclides are under evaluation.

^{*} In the case that two or more kinds of nuclides exist, sum of each scaling factor to the density limit is compared with 1.


^{* &}quot;ND" means the sampled data is below measurable limit.

I-131: approx. 0.68Bq/L, Cs-134: approx. 1.0Bq/L, Cs-137: approx. 1.1Bq/L


Radioactivity Density of Seawater (Bq/L)

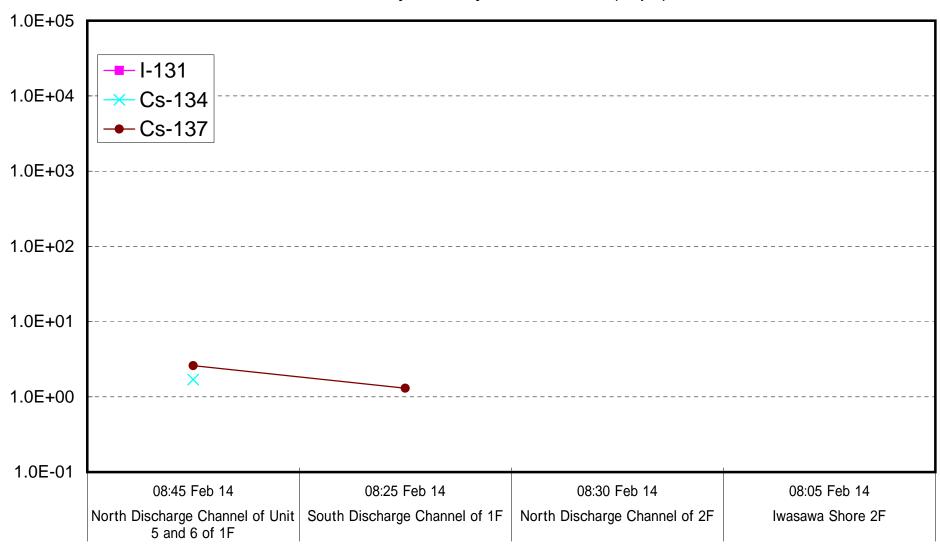


Radioactivity Density of Seawater at North of 1F5-6 Discharge Channel (Bq/L)

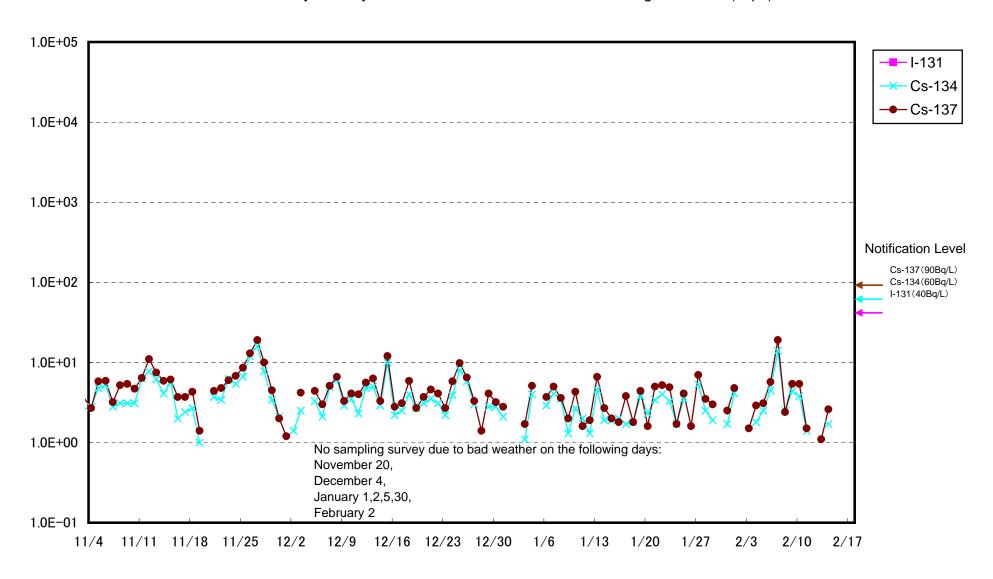


Radioactivity Density of Seawater at South Discharge Channel of 1F (Bq/L)

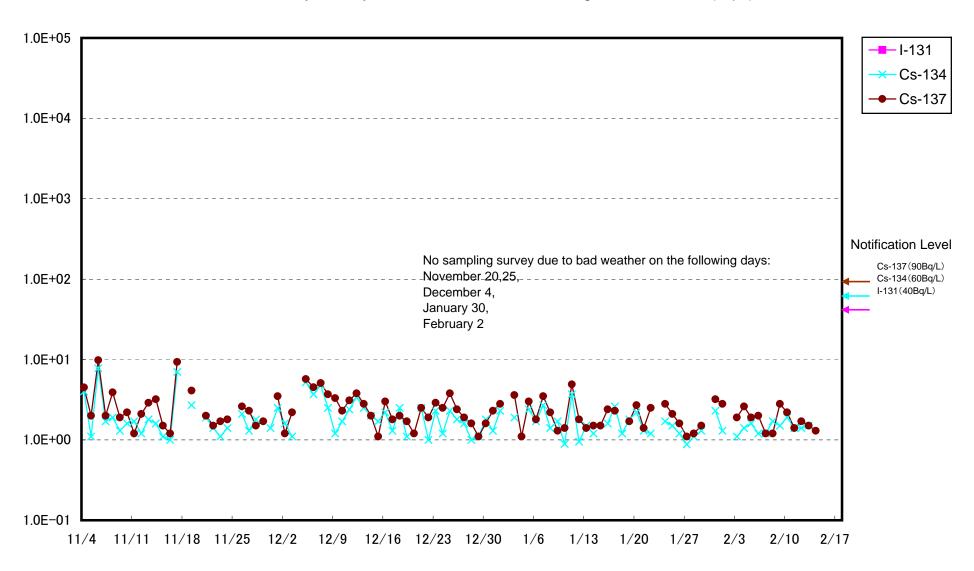

Radioactivity Density of Seawater at North Discharge Channel of 2F (Bq/L)

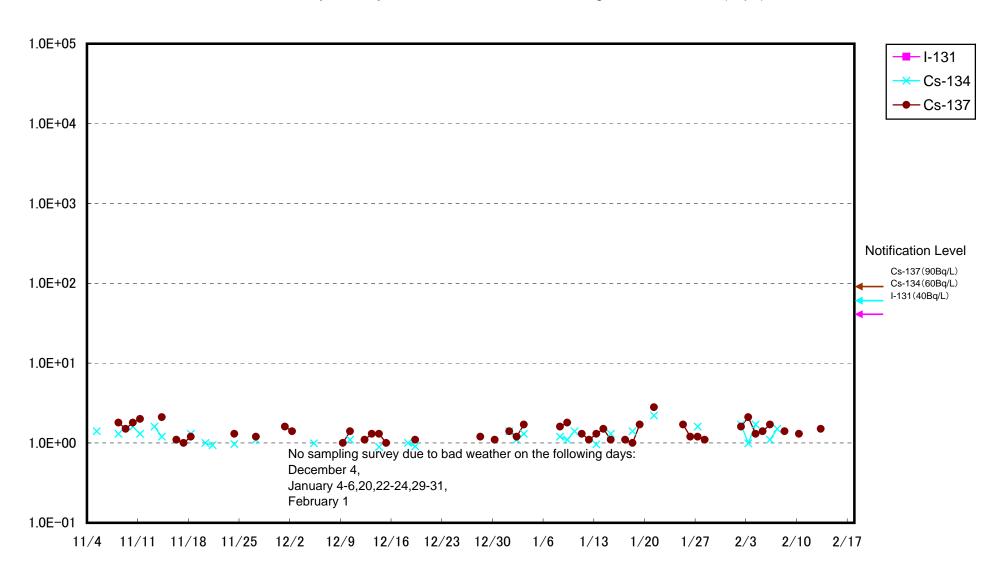

Radioactivity Density of Seawater at Iwasawa Shore 2F (Bq/L)

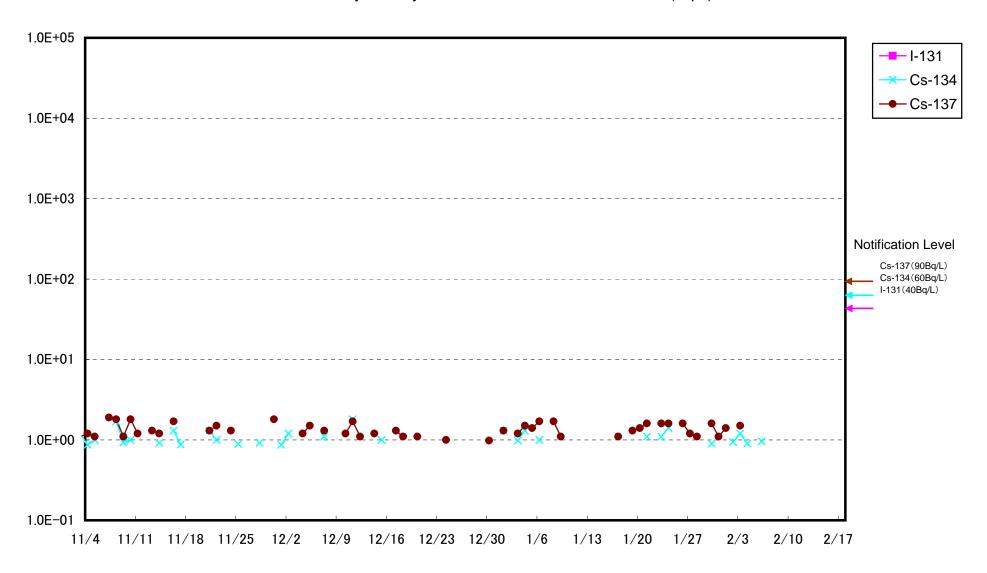

Radioactivity Density of Seawater (upper layer) around approx. 15 km offshore of Ukedo river (Bq/L)

