

Nuclides Analysis Result of the Radioactive Materials in the Seawater < Coast, Fukushima Daiichi Nuclear Power Station >

(Data summarized on October 17)

Place of Sampling	North of Unit 5-6 Discharge Channel at Fukushima Daiichi NPS (Approx. 30m North of Unit 5-6 Discharge Channel)		Around South Discharge Channel of Fukushima Daiichi NPS (Approx. 330m South of Unit 1-4 Discharge Channel)		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Time of Sampling Oct 16, 2012 8:15 AM		Time of Sampling Oct 16, 2012 8:00 AM		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	-	ND	-	40
Cs-134 (Approx. 2 years)	ND	-	ND	-	60
Cs-137 (Approx. 30 years)	ND	-	ND	-	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* Data of other nuclides is under evaluation.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

I-131: Approx. 0.48Bq/L, Cs-134: Approx.1.1Bq/L, Cs-137: Approx.1.5Bq/L

s the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

Nuclides Analysis Result of the Radioactive Materials in the Seawater < Coast, Fukushima Daiichi Nuclear Power Station, Remeasurement >

(Data summarized on October 17)

Place of Sampling	North of Unit 5-6 Discharge Channel at Fukushima Daiichi NPS (Approx. 30m North of Unit 5-6 Discharge Channel)		Around South Discharge Channel of Fukushima Daiichi NPS (Approx. 330m South of Unit 1-4 Discharge Channel)		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Time of Sampling		Time of Sampling		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	-	ND	-	40
Cs-134 (Approx. 2 years)	0.97	0.02	0.53	0.01	60
Cs-137 (Approx. 30 years)	1.4	0.02	0.86	0.01	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* Data of other nuclides is under evaluation.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

I-131: Approx. 0.86Bq/L

As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

Nuclides Analysis Result of the Radioactive Materials in the Seawater < Coast, Fukushima Daiichi Nuclear Power Station >

(Data summarized on October 17)

Place of Sampling	2F Around the North Discharge Channel (Around Unit 3-4 Discharge Channel) (Approx. 10km from 1F)		Around the North Side of Asamigawa (Approx. 12km South of Unit 1 & 2 Discharge Channel) (Approx. 24km from 1F)		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Time of Sampling		Time of Sampling		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	-	ND	-	40
Cs-134 (Approx. 2 years)	0.32	0.01	0.31	0.01	60
Cs-137 (Approx. 30 years)	0.49	0.01	ND	-	90

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* Data of other nuclides is under evaluation.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

I-131: Approx. 0.13Bq/L, Cs-137: Approx. 0.28Bq/L

s the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

Nuclides Analysis Result of Radioactive Materials in the Seawater < 1/2 >

(Data summarized on October 17)

Place of Sampling (Place No.)	15km Offshore of Fukushima Daiichi NPS(T-5) Upper Layer		3km Offshore of Ukedo River (T-D1) Upper Layer		3km Offshore of 1F(T-D5) Upper Layer		② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
	Date of Sampling		Date of Sampling		Date of Sampling		
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	ND	-	0.011	0.00	0.083	0.00	60
Cs-137 (Approx. 30 years)	0.0028	0.00	0.020	0.00	0.13	0.00	90
H-3 (approx. 12yrs)	ND	-	ND	-	ND	-	60,000
All α	ND	-	ND	-	ND	-	—
All β	ND	-	ND	-	ND	-	—
Sr-89 (Approx. 51 days)	ND	-	ND	-	ND	-	300
Sr-90 (Approx. 29 years)	ND	-	ND	-	0.031	0.00	30

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* Nuclide analysis results of I-131, Cs-134 and Cs-137 were announced on October 3, 10 and 16.

* When the measurement value is below the detection limit, "ND" is marked. The detection limits are as follows.

Cs-134: Approx.0.0015Bq/L, H-3: Approx. 3.1Bq/L, All α: Approx. 3.5Bq/L, All β: Approx. 22Bq/L, Sr-89: Approx. 0.02Bq/L, Sr-90: Approx. 0.008Bq/L

As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

* Nuclides analysis of Sr-89 and Sr-90 were done by Japan Chemical Analysis Center.

(Evaluation)

Although Sr-90 was detected supposedly as a result of this accident, it is less than the density limit in the water which is specified by the announcement.

Nuclides Analysis Result of Radioactive Materials in the Seawater < 2/2 >

(Data summarized on October 17)

Place of Sampling (Place No.)	3km Offshore of 2F (T-D9) Upper Layer						② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.)
Date of Sampling	Sep 5, 2012						
Detected Nuclides (Half-life)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	①Density of Sample (Bq/L)	Scaling Factor (①/②)	
Cs-134 (Approx. 2 years)	0.0097	0.00					60
Cs-137 (Approx. 30 years)	0.017	0.00					90
H-3 (approx. 12yrs)	ND	-					60,000
All α	ND	-					—
All β	ND	-					—
Sr-89 (Approx. 51 days)	ND	-					300
Sr-90 (Approx. 29 years)	0.021	0.00					30

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* Nuclide analysis results of I-131, Cs-134 and Cs-137 were announced on October 3.

* When the measurement value is below the detection limit, "ND" is marked. The detection limits are as follows.

H-3: Approx. 3.1Bq/L, All α: Approx. 3.5Bq/L, All β: Approx. 22Bq/L, Sr-89: Approx. 0.02Bq/L


As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

* Nuclides analysis of Sr-89 and Sr-90 were done by Japan Chemical Analysis Center.


(Evaluation)

Although Sr-90 was detected supposedly as a result of this accident, it is less than the density limit in the water which is specified by the announcement.


Radioactivity Density of the Seawater at the North of 1F Unit 5-6 Discharge Channel (Bq/L)

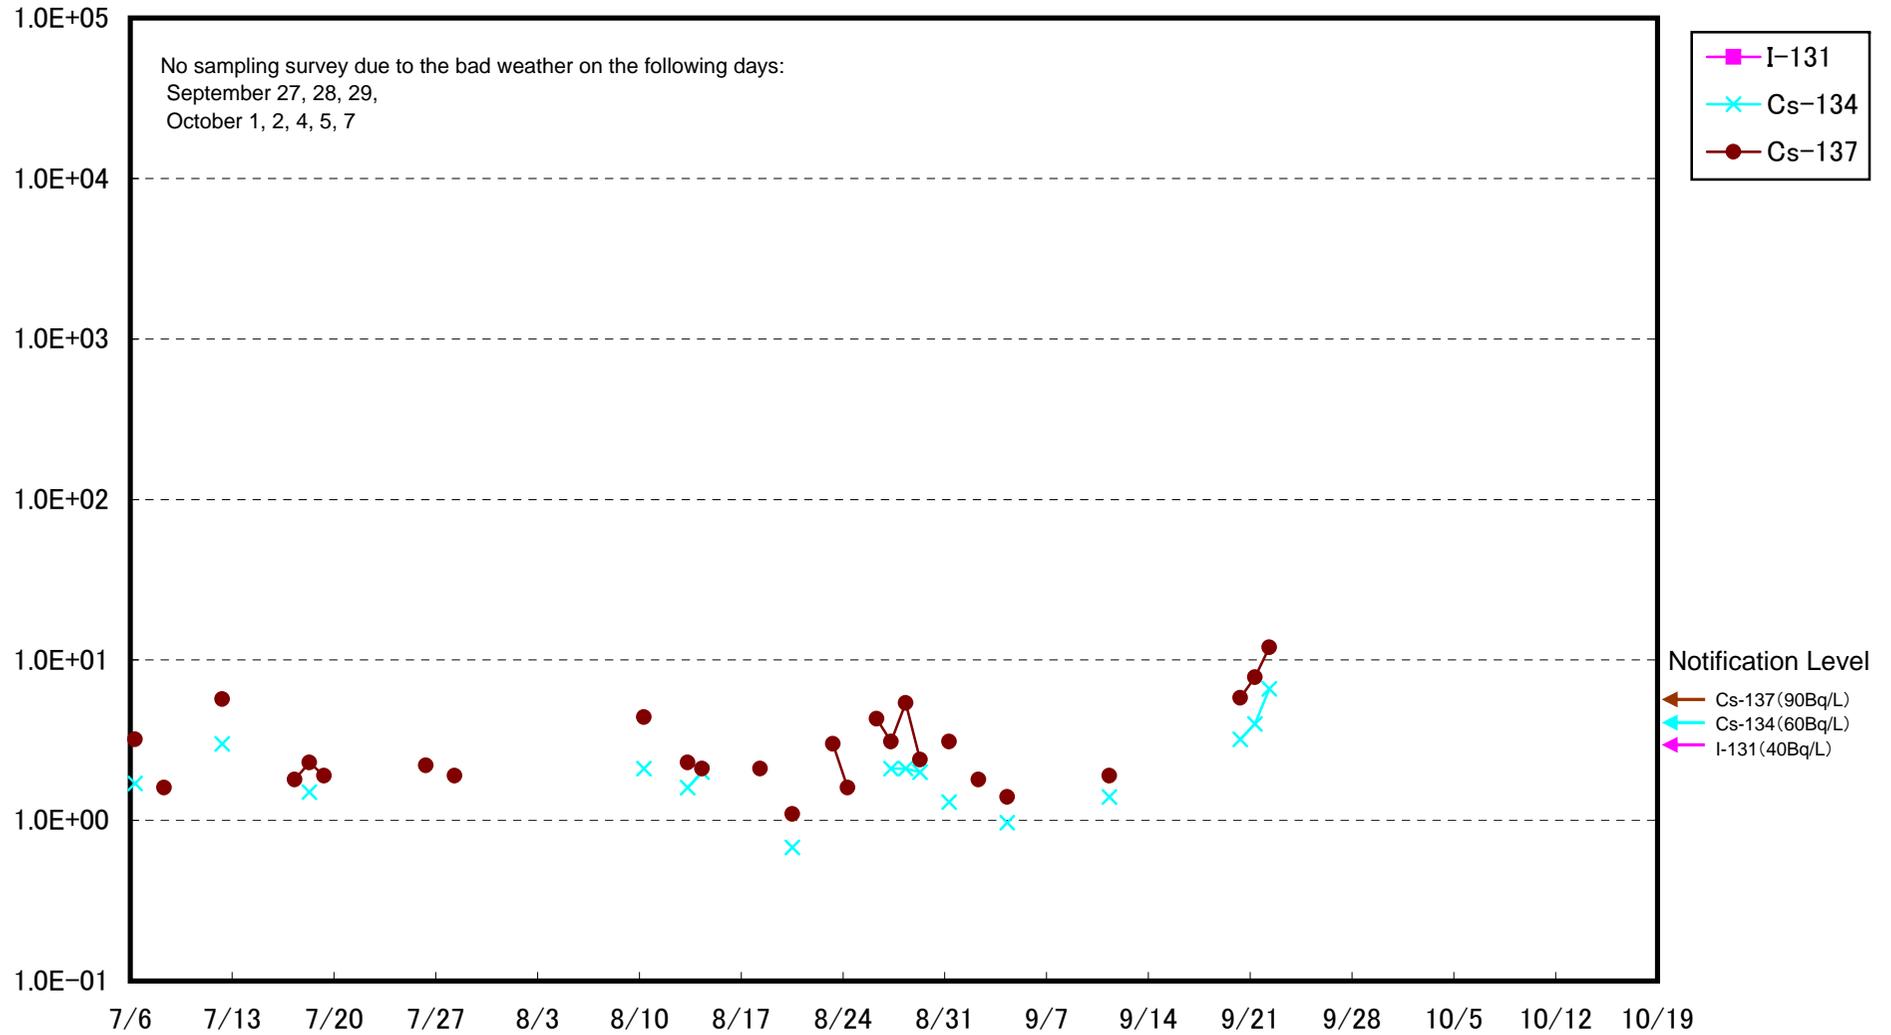

Radioactivity Density of the Seawater at 1F South Discharge Channel (Bq/L)

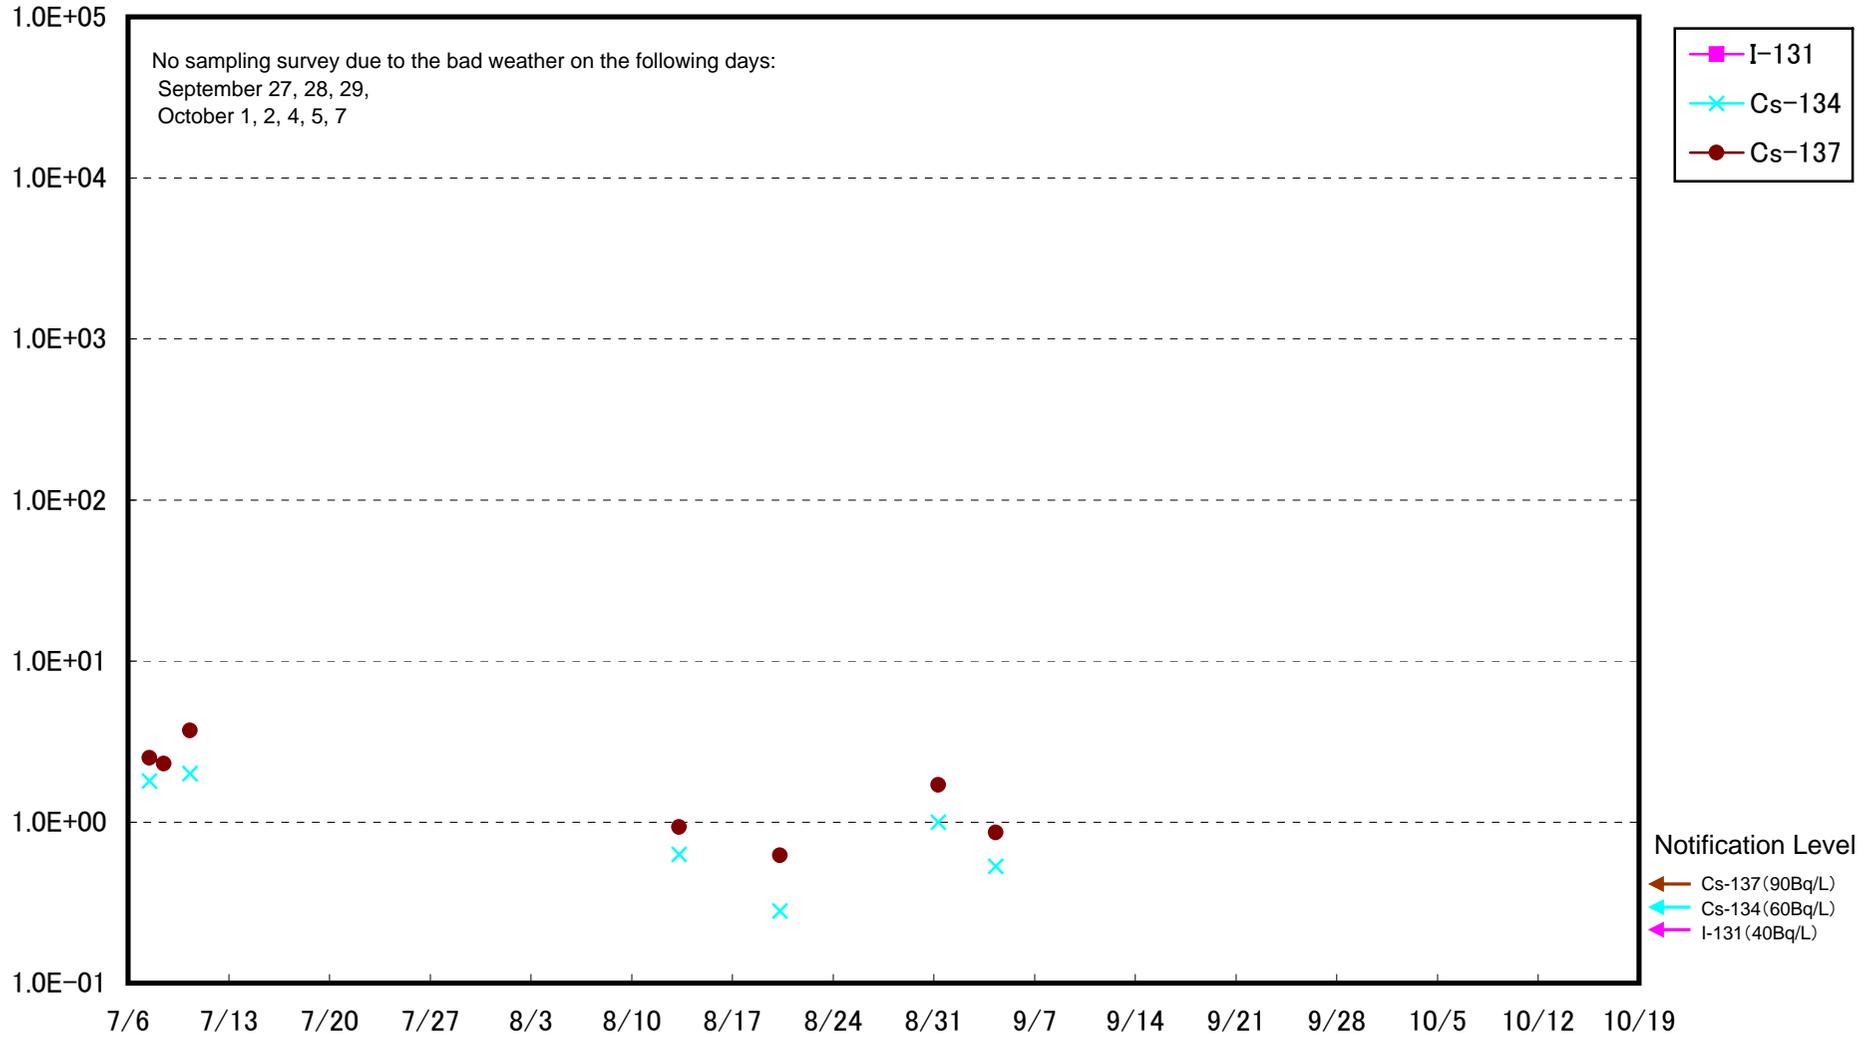

Radioactivity Density of the Seawater at 2F North Discharge Channel (Bq/L)

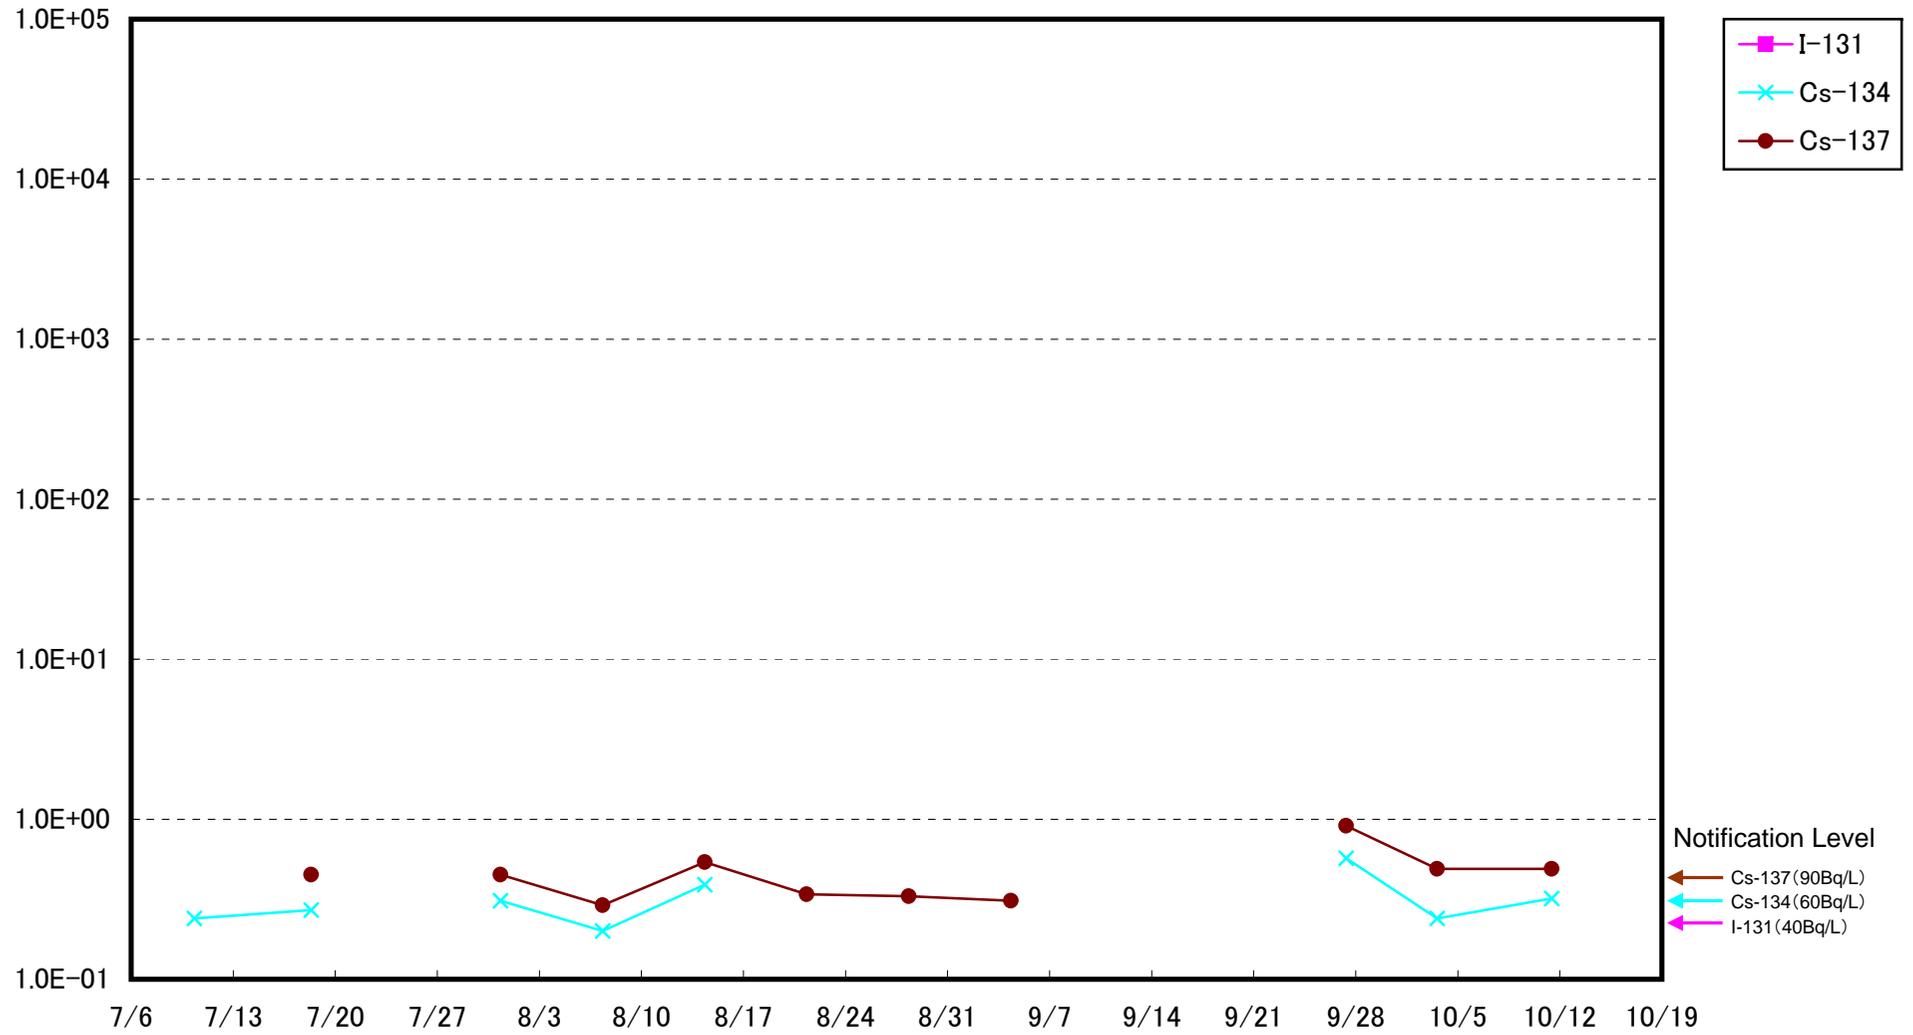

Radioactivity Density of the Seawater at Around the North of Asamigawa (Bq/L)

