Reference

## Nuclide Analysis Results of the Radioactive Materials in the Air at Fukushima Nuclear Power Stations

## (Data summarized on January 10)

| Place of Sampling                | The West Gate of Fukushima<br>Daiichi NPS     |                            | MP-1 of Fukushima Daini NPS<br>(Reference)    |                            |   |                            | Density Limit Specified by the Reactor Regulation (Bq/cm³) (Density limit in the air which radiation workers breathe in |
|----------------------------------|---|----------------------------|---|----------------------------|---|----------------------------|---|
| Time of Sampling                 | January 9, 2013<br>7:00 AM - 12:00 PM         |                            | January 9, 2013<br>9:28 AM - 9:38 AM          |                            |   |                            |   |
| Detected Nuclides<br>(Half-life) | Density of<br>Sample<br>(Bq/cm <sup>3</sup> ) | Scaling<br>Factor<br>( / ) | Density of<br>Sample<br>(Bq/cm <sup>3</sup> ) | Scaling<br>Factor<br>( / ) | Density of<br>Sample<br>(Bq/cm <sup>3</sup> ) | Scaling<br>Factor<br>( / ) | is specified in section 4 of<br>Appendix 2)   |
| I-131<br>(Approx. 8 days)        | ND  | 1                          | ND  | -                          |   |                            | 1E-03   |
| Cs-134<br>(Approx. 2 years)      | ND  | -                          | ND  | -                          |   |                            | 2E-03   |
| Cs-137<br>(Approx. 30 years)     | ND  | -                          | ND  | -                          |   |                            | 3E-03   |

<sup>\*</sup> The radioactivity density is the sum of the volatile nuclides density and the particulate nuclides density.

O.OE - O is the same as O.O  $\times$  10<sup>-O</sup>

Data of other nuclides is under examination.


The detection limits at the west gate of Fukushima Daiichi NPS are as follows: Volatile: I-131: Approx. 8E-8Bq/cm3, Cs-134: Approx.2E-7Bq/cm3, Cs-137: Approx.3E-7Bq/cm3 Particulate: I-131: Approx. 5E-8Bq/cm3, Cs-134: Approx.1E-7Bq/cm3, Cs-137: Approx.2E-7Bq/cm3 The detection limits at MP-1 of Fukushima Daini MPS are as follows: Volatile: I-131: Approx. 1E-6Bq/cm3, Cs-134: Approx.2E-6Bq/cm3, Cs-137: Approx.2E-6Bq/cm3

Particulate: I-131: Approx. 6E-7Bq/cm3, Cs-134: Approx.1E-6Bq/cm3, Cs-137: Approx.8E-7Bq/cm3

<sup>\*</sup> In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

<sup>\* &</sup>quot;ND" indicates that the measurement result is below the detection limit.

Dust Nuclides Analysis Result: The West Gate of Fukushima Daiichi Nuclear Power Station (Bq/cm³)

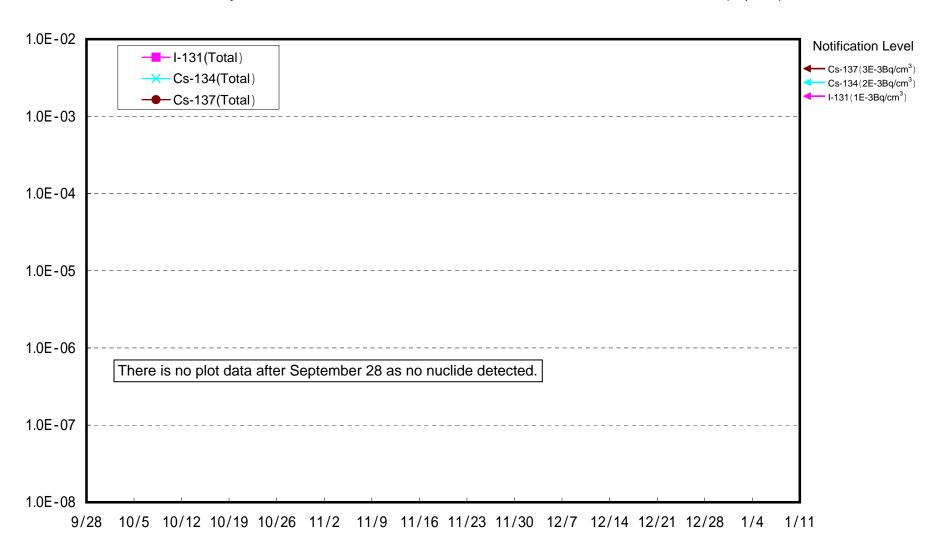

## (Reference) Dust Nuclides Analysis Results of MP-1 at Fukushima Daini NPS (Bq/cm<sup>3</sup>)

