

Nuclide Analysis Results of the Radioactive Materials in the Air at Fukushima Nuclear Power Stations < 1/2 >

(Data summarized on August 20)

Place of Sampling	The West Gate of Fukushima Daiichi NPS						② Density Limit Specified by the Reactor Regulation (Bq/cm ³) (Density limit in the air which radiation workers breathe in is specified in section 4 of Appendix 2)
	①Density of Sample (Bq/cm ³)	Scaling Factor (①/②)	①Density of Sample (Bq/cm ³)	Scaling Factor (①/②)	①Density of Sample (Bq/cm ³)	Scaling Factor (①/②)	
Time of Sampling	August 19, 2014 7:00 AM - 12:00 PM						
Detected Nuclides (Half-life)	①Density of Sample (Bq/cm ³)	Scaling Factor (①/②)	①Density of Sample (Bq/cm ³)	Scaling Factor (①/②)	①Density of Sample (Bq/cm ³)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	-					1E-03
Cs-134 (Approx. 2 years)	ND	-					2E-03
Cs-137 (Approx. 30 years)	ND	-					3E-03

* The radioactivity density is the sum of the volatile nuclides density and the particulate nuclides density.

0.0E-0 is the same as 0.0×10^{-0}

Data of other nuclides is under examination.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

The detection limits at the west gate of Fukushima Daiichi NPS are as follows: Volatile: I-131: Approx. $1E-7$ Bq/cm³, Cs-134: Approx. $1E-7$ Bq/cm³, Cs-137: Approx. $1E-7$ Bq/cm³ Particulate: I-131: Approx. $6E-8$ Bq/cm³, Cs-134: Approx. $7E-8$ Bq/cm³, Cs-137: Approx. $6E-8$ Bq/cm³ As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

Nuclide Analysis Results of the Radioactive Materials in the Air at Fukushima Nuclear Power Stations < 2/2 >

(Data summarized on August 20)

Place of Sampling	MP-1 at Fukushima Daiichi NPS		MP-3 at Fukushima Daiichi NPS		MP-8 at Fukushima Daiichi NPS		② Density Limit Specified by the Reactor Regulation (Bq/cm ³) (Density limit in the air which radiation workers breathe in is specified in section 4 of Appendix 2)
	Time of Sampling		Time of Sampling		Time of Sampling		
Detected Nuclides (Half-life)	①Density of Sample (Bq/cm ³)	Scaling Factor (①/②)	①Density of Sample (Bq/cm ³)	Scaling Factor (①/②)	①Density of Sample (Bq/cm ³)	Scaling Factor (①/②)	
I-131 (Approx. 8 days)	ND	-	ND	-	ND	-	1E-03
Cs-134 (Approx. 2 years)	ND	-	ND	-	ND	-	2E-03
Cs-137 (Approx. 30 years)	ND	-	ND	-	ND	-	3E-03

* The radioactivity density is the sum of the volatile nuclides density and the particulate nuclides density.

O.OE—O is the same as O.O x 10^{-O}

Data of other nuclides is under examination.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

The detection limits are as follows. Volatile: I-131: Approx. 5E-8Bq/cm³, Cs-134: Approx.7E-8Bq/cm³, Cs-137: Approx.6E-8Bq/cm³ Particulate: I-131: Approx. 4E-8Bq/cm³, Cs-134: Approx.5E-8Bq/cm³, Cs-137: Approx.4E-8Bq/cm³ As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

Analysis Result of Sr in the Air at Fukushima Daiichi Nuclear Power Station <1/4>

1. Measurement Result:

(Data summarized on August 20)
(Unit: Bq/cm³)

Place of Sampling	Type	Date of Sampling	Sr-89	Sr-90
1F, West Gate	Volatile	Feb 11, 2014	N.D.	N.D.
	Particulate		N.D.	N.D.

[] shows below the detection limit.

2. Evaluation:

Sr-89 and Sr-90 were not detected in the sample collected this time.

End

Analysis Result of Sr in the Air at Fukushima Daiichi Nuclear Power Station <2/4>

1. Measurement Result:

(Data summarized on August 20)
(Unit: Bq/cm³)

Place of Sampling	Type	Date of Sampling	Sr-89	Sr-90
1F, West Gate	Volatile	Mar 11, 2014	N.D.	N.D.
	Particulate		N.D.	N.D.

[] shows below the detection limit.

2. Evaluation:

Sr-89 and Sr-90 were not detected in the sample collected this time.

End

Analysis Result of Sr in the Air at Fukushima Daiichi Nuclear Power Station <3/4>

1. Measurement Result:

(Data summarized on August 20)
(Unit: Bq/cm³)

Place of Sampling	Type	Date of Sampling	Sr-89	Sr-90
1F, West Gate	Volatile	Apr 15, 2014	N.D.	N.D.
	Particulate		N.D.	N.D.

[] shows below the detection limit.

2. Evaluation:

Sr-89 and Sr-90 were not detected in the sample collected this time.

End

Analysis Result of Sr in the Air at Fukushima Daiichi Nuclear Power Station <4/4>

1. Measurement Result:

(Data summarized on August 20)
(Unit: Bq/cm³)

Place of Sampling	Type	Date of Sampling	Sr-89	Sr-90
1F, West Gate	Volatile	May 13, 2014	N.D.	N.D.
	Particulate		N.D.	N.D.


[] shows below the detection limit.

2. Evaluation:


Sr-89 and Sr-90 were not detected in the sample collected this time.

End


Dust Nuclides Analysis Result: The West Gate of Fukushima Daiichi Nuclear Power Station (Bq/cm³)

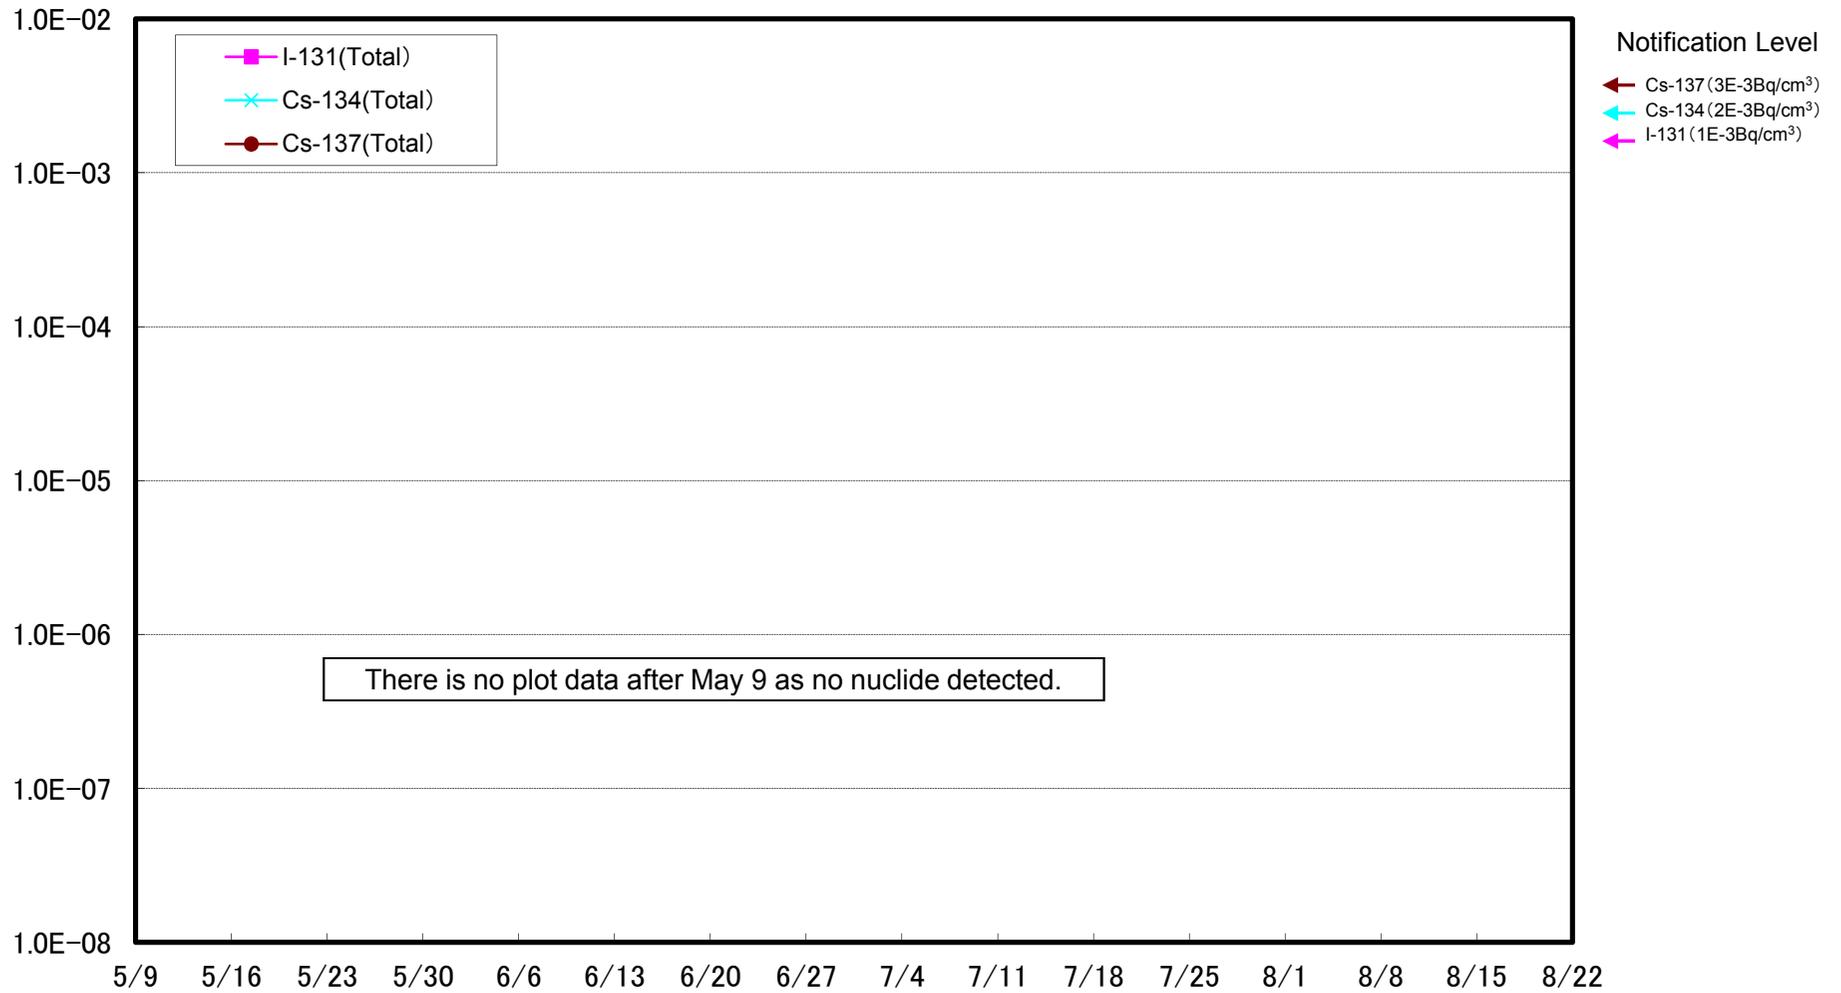

Dust Nuclides Analysis Result: MP-1 at Fukushima Daiichi NPS (Bq/cm³)

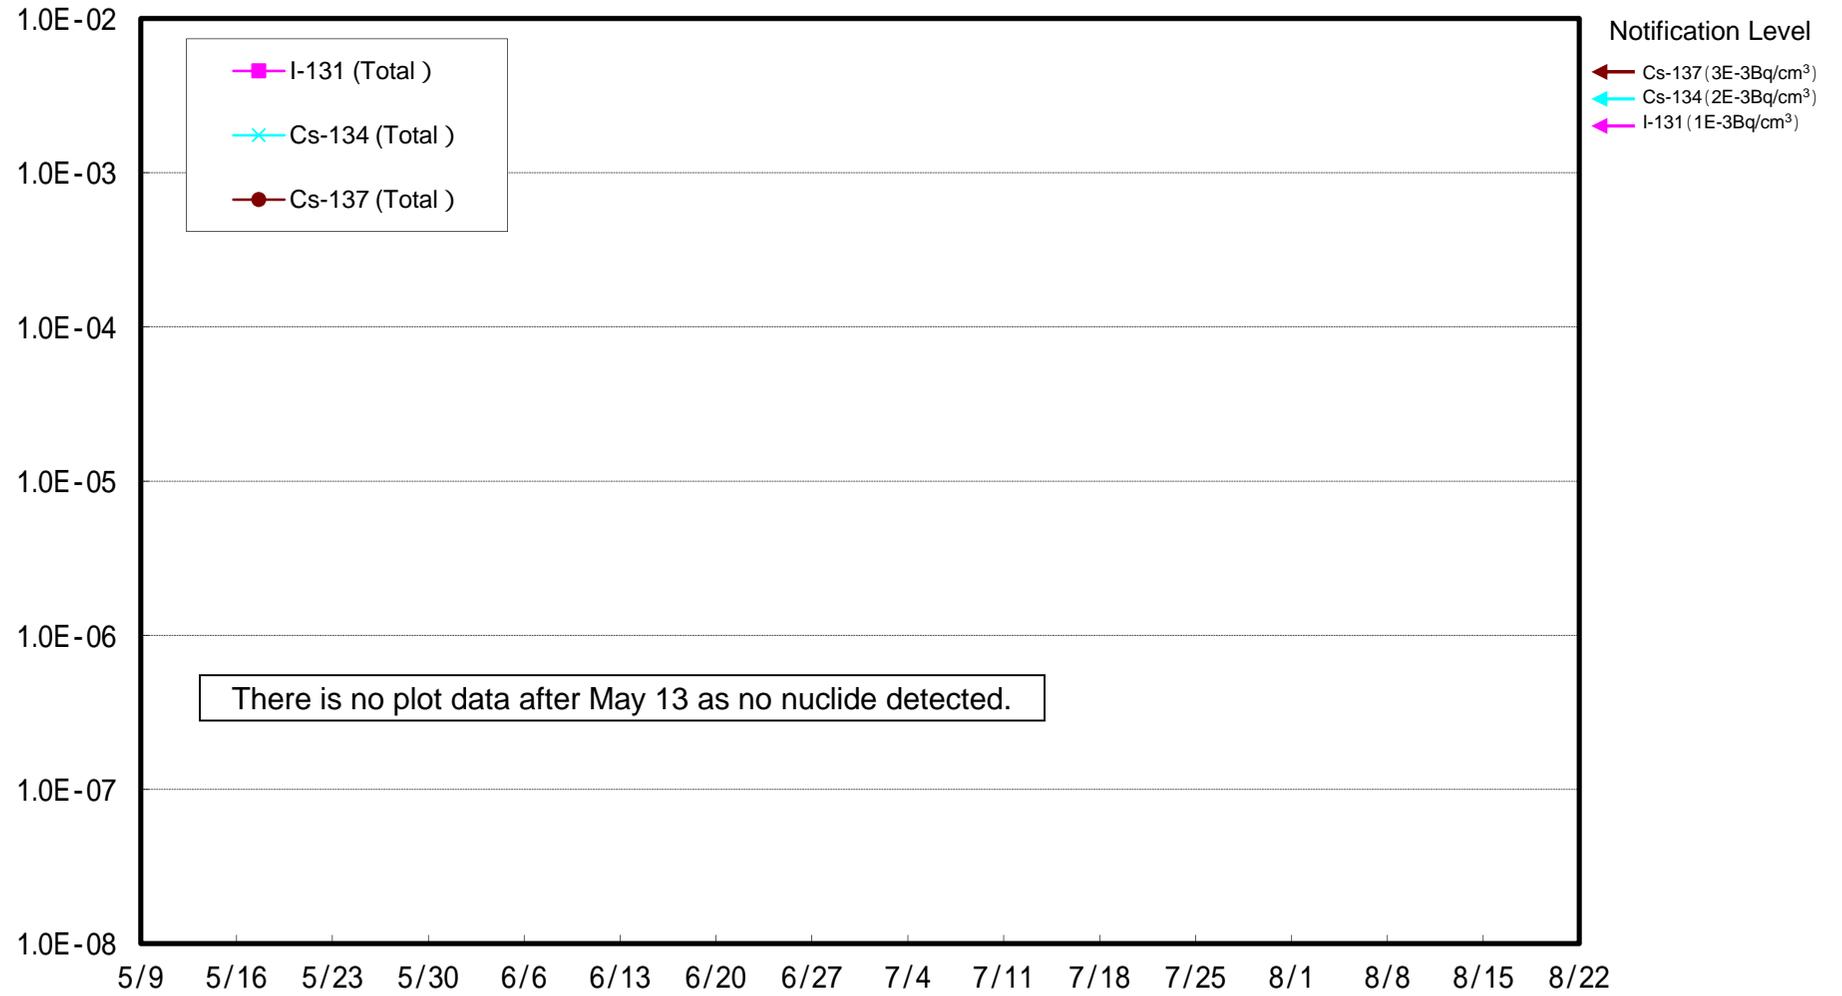

Dust Nuclides Analysis Result: MP-3 at Fukushima Daiichi NPS (Bq/cm³)

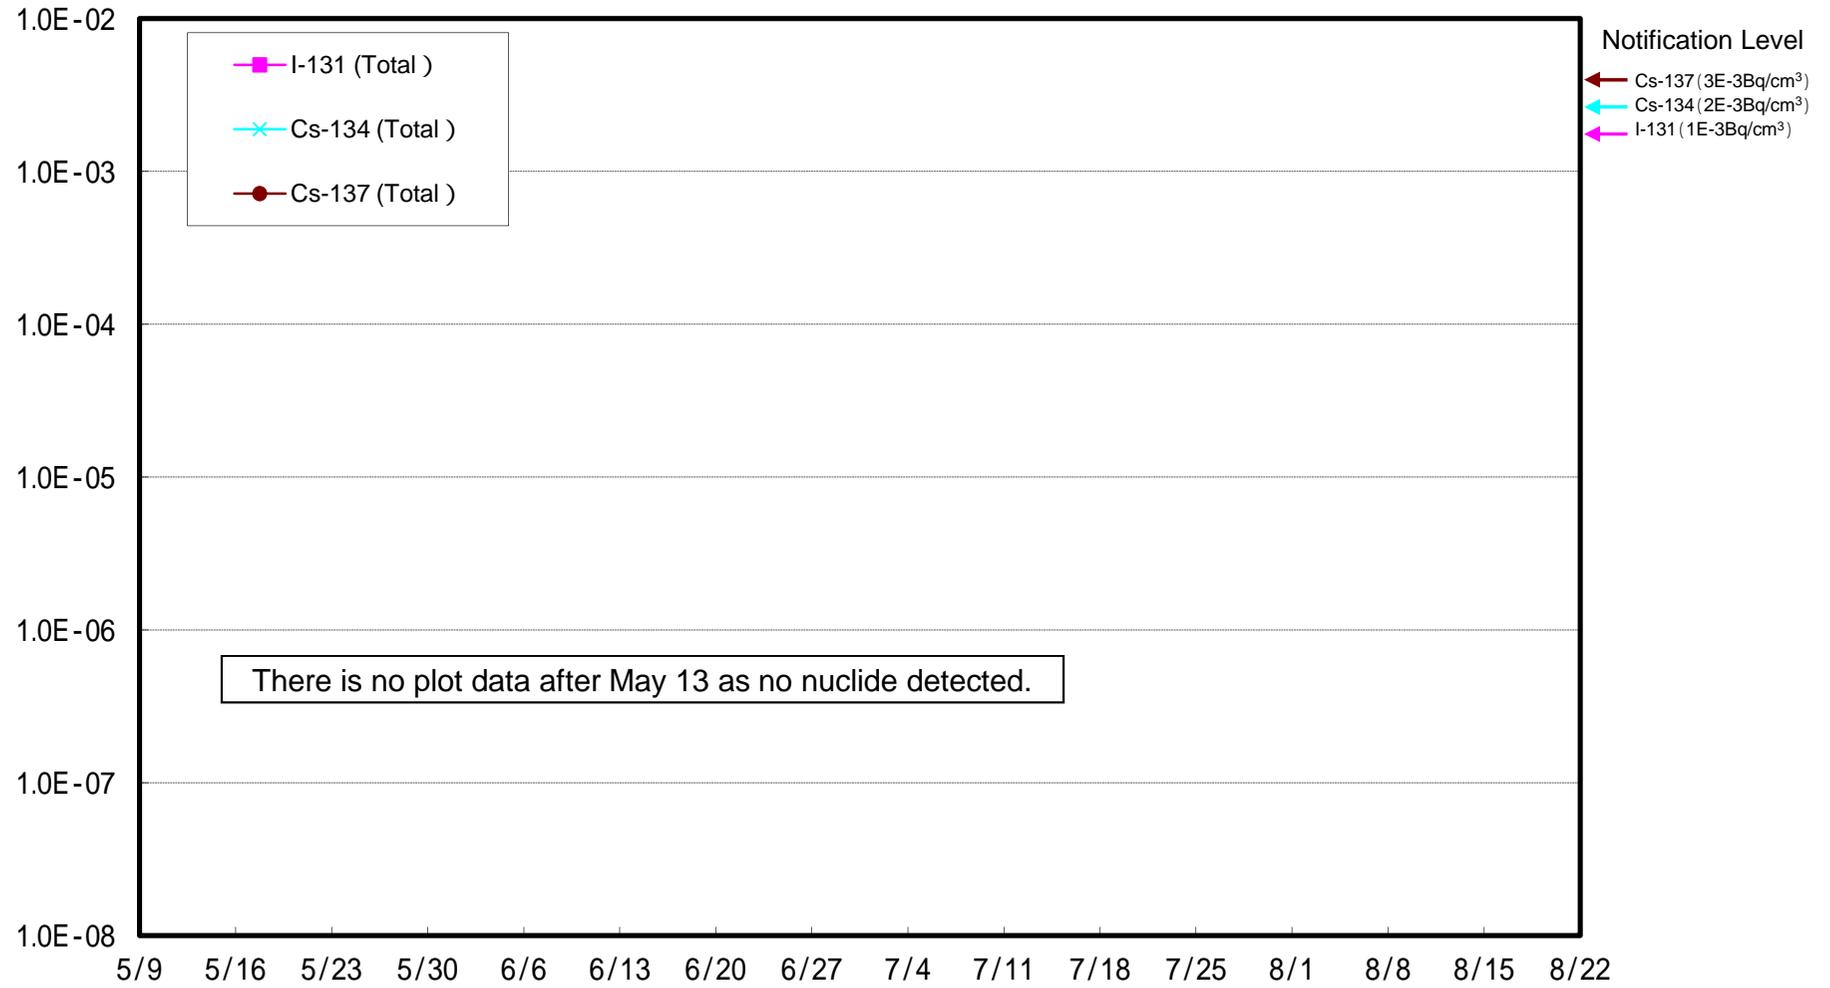

Dust Nuclides Analysis Result: MP-8 at Fukushima Daiichi NPS (Bq/cm³)

