


Analysis Results of Underground Water around Unit 2 Reactor Building in Fukushima Daiichi NPS

- Existing subdrain pit (the purification examination carried out in the past)
- Existing subdrain pit
- New subdrain pit
- Pit for the sampling

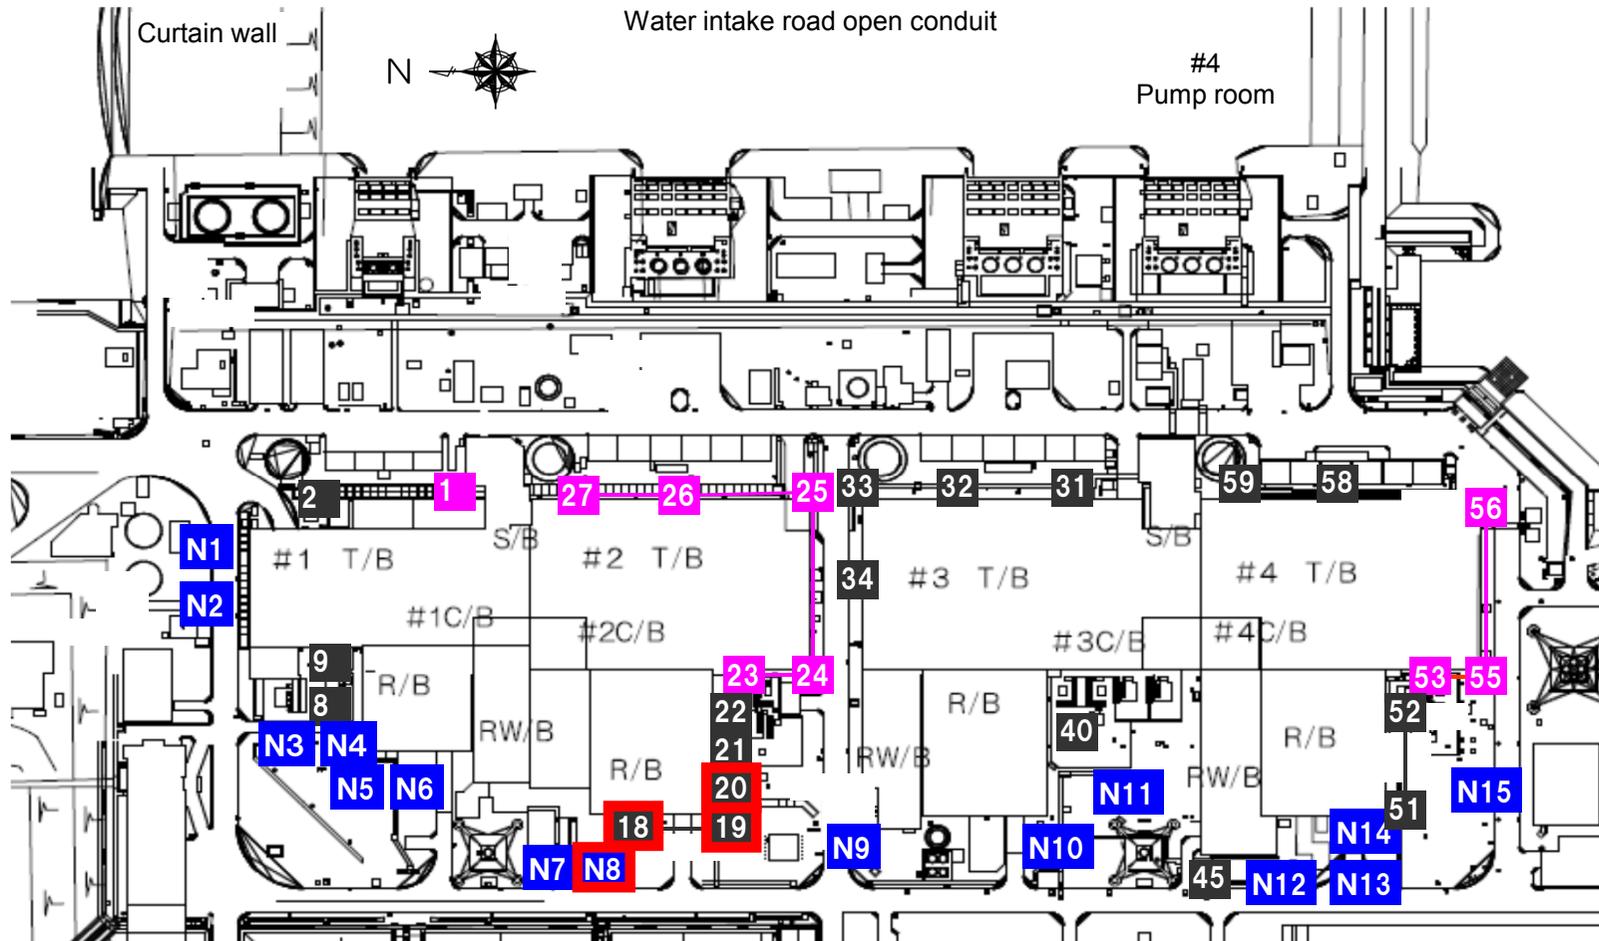

Analysis Results of Underground Water around Unit 2 Reactor Building in Fukushima Daiichi NPS <1/2>

Unit: Bq/L

		Place of Sampling			
		N8	No.18	No.19	No.20
Date of Sampling		Oct 25, 2014	Oct 25, 2014	Oct 25, 2014	Oct 25, 2014
Time of sampling		10:40 AM	10:40 AM	10:40 AM	10:30 AM
Cs-134(Approx. 2 years)		ND(17)	1,100	110	ND(15)
Cs-137(Approx.30 years)		32	3,900	320	37
The other γ					
All β		48	5,000	490	80
H-3(Approx.12 years)		ND(110)	1,400	460	1,300

* Data announced this time is provided in a thick-frame. The other data was announced c October 26, 2014.

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses, except "the other γ".

Analysis Results of Underground Water around Unit 2 Reactor Building in Fukushima Daiichi NPS <2/2>

Unit: Bq/L

	Place of Sampling			
	N8	No.18	No.19	No.20
Date of Sampling	Oct 26, 2014	Oct 26, 2014	Oct 26, 2014	Oct 26, 2014
Time of sampling	9:50 AM	10:00 AM	10:20 AM	10:10 AM
Cs-134(Approx. 2 years)	ND(18)	1,000	110	44
Cs-137(Approx.30 years)	31	3,700	360	94
The other γ				
All β	70	4,400	490	140
H-3(Approx.12 years)	Under analysis	Under analysis	Under analysis	Under analysis

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses, except "the other γ ".