


Analysis Results of Underground Water around Unit 2 Reactor Building in Fukushima Daiichi NPS

- Existing subdrain pit (the purification examination carried out in the past)
- Existing subdrain pit
- New subdrain pit
- Pit for the sampling

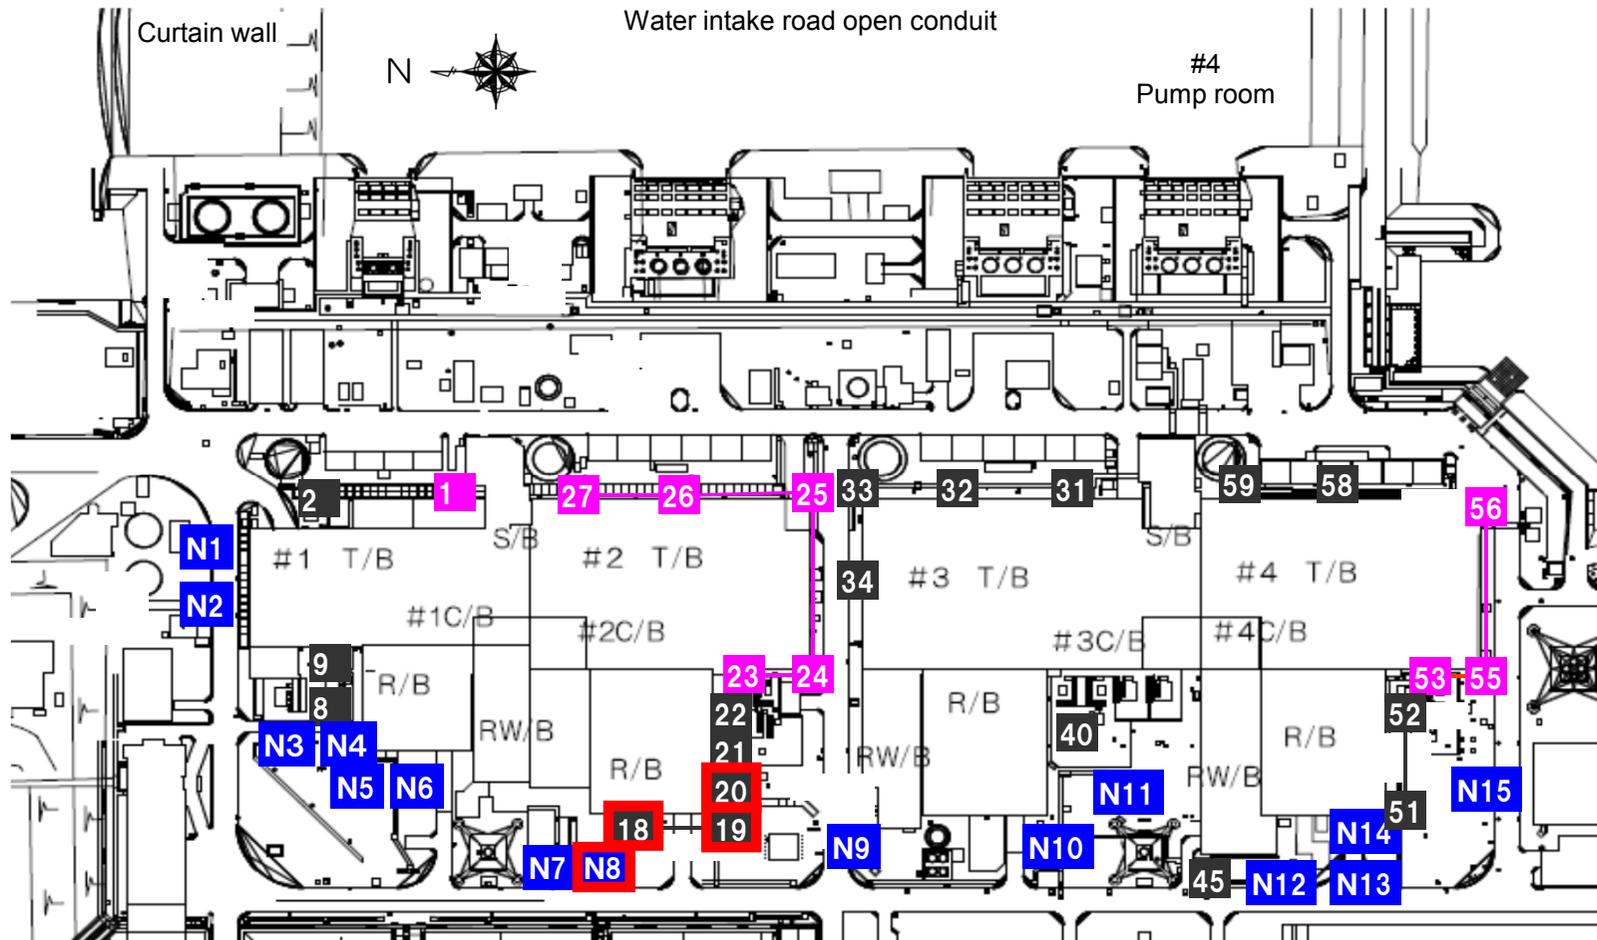

Analysis Results of Underground Water around Unit 2 Reactor Building in Fukushima Daiichi NPS <1/2>

Unit: Bq/L

		Place of Sampling			
		N8	No.18	No.19	No.20
Date of Sampling		Oct 27, 2014	Oct 27, 2014	Oct 27, 2014	Oct 27, 2014
Time of sampling		10:30 AM	10:40 AM	10:50 AM	10:40 AM
Cs-134(Approx. 2 years)		ND(8.4)	940	100	22
Cs-137(Approx.30 years)		41	3,300	330	43
The other γ					
All β		80	6,900	480	110
H-3(Approx.12 years)		ND(120)	1,500	410	1,300

* Data announced this time is provided in a thick-frame. The other data was announced c October 28, 2014.

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses, except "the other γ".

Analysis Results of Underground Water around Unit 2 Reactor Building in Fukushima Daiichi NPS <2/2>

Unit: Bq/L

		Place of Sampling			
		N8	No.18	No.19	No.20
Date of Sampling		Oct 28, 2014	Oct 28, 2014	Oct 28, 2014	Oct 28, 2014
Time of sampling		9:50 AM	10:00 AM	10:00 AM	9:50 AM
Cs-134(Approx. 2 years)		ND(11)	980	89	29
Cs-137(Approx.30 years)		41	3,400	340	53
The other γ					
All β		80	4,400	430	120
H-3(Approx.12 years)		Under analysis	Under analysis	Under analysis	Under analysis

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses, except "the other γ".