


Analysis Results of Underground Water around Unit 2 Reactor Building in Fukushima Daiichi NPS

- Existing subdrain pit (the purification examination carried out in the past)
- Existing subdrain pit
- New subdrain pit
- Pit for the sampling

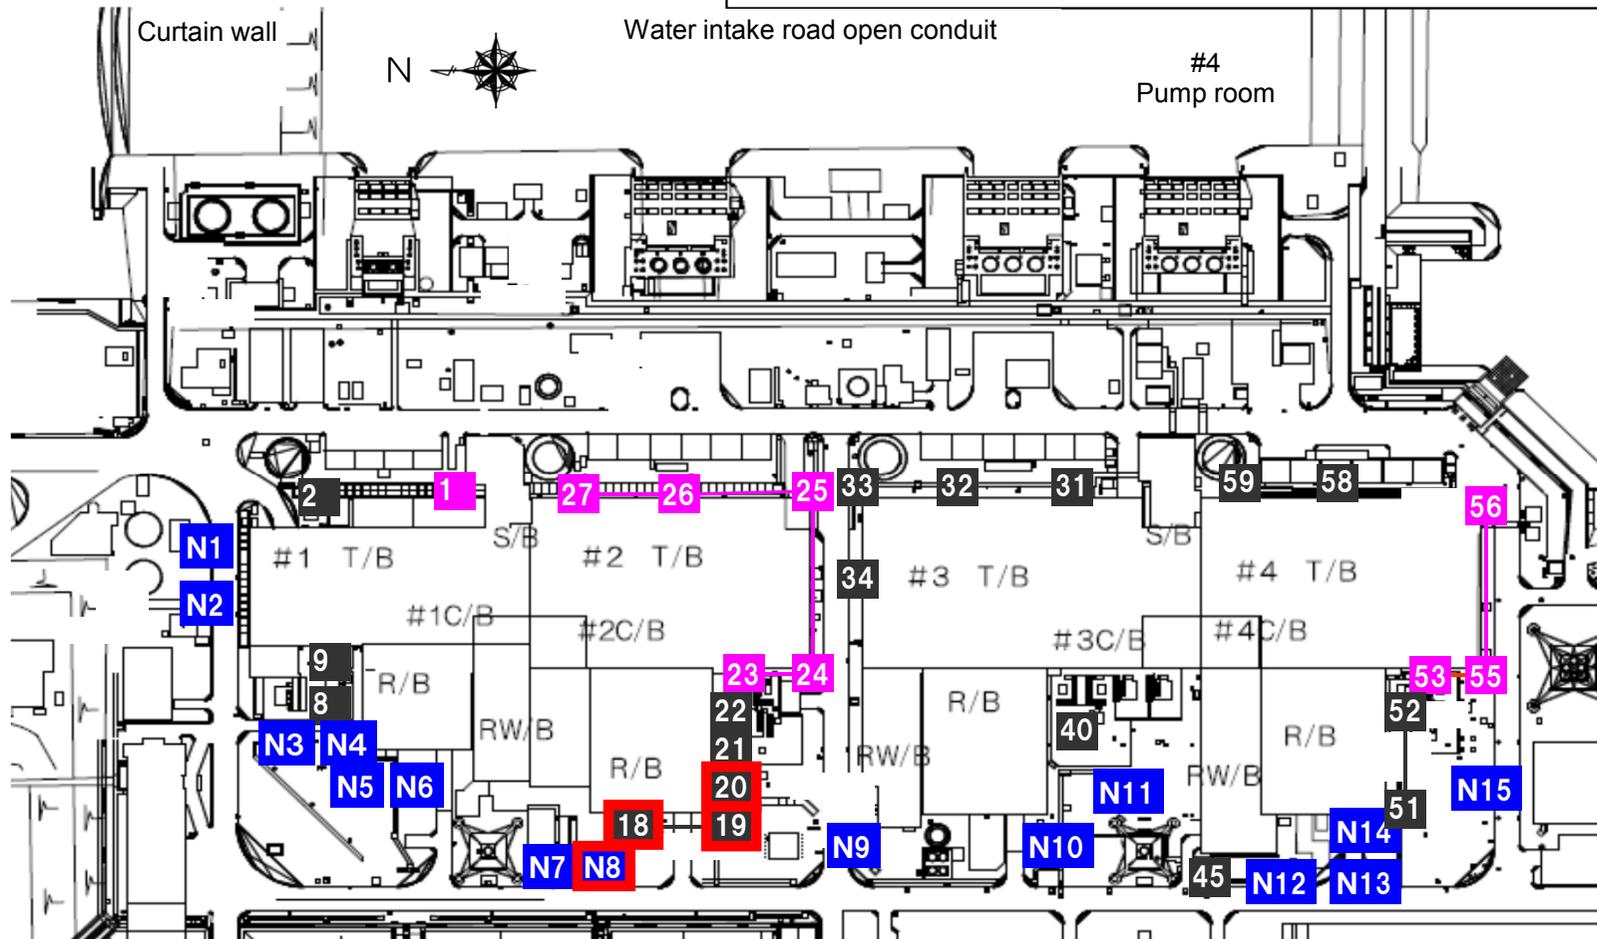

Analysis Results of Underground Water around Unit 2 Reactor Building in Fukushima Daiichi NPS <1/2>

Unit: Bq/L

		Place of Sampling				
		N8	No.16	No.18	No.19	No.20
Date of Sampling		Oct 29, 2014	Oct 29, 2014	Oct 29, 2014	Oct 29, 2014	Oct 29, 2014
Time of sampling		10:00 AM	9:40 AM	10:05 AM	10:05 AM	10:00 AM
Cs-134(Approx. 2 years)		ND(17)	850,000	320	28	20
Cs-137(Approx.30 years)		42	2,900,000	1,100	95	62
The other γ						
All β		51	3,200,000	4,400	380	100
H-3(Approx.12 years)		ND(110)	84,000	1,400	440	1,300

* Data announced this time is provided in a thick-frame. The other data was announced on October 29, 2014.

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses, except "the other γ".

Analysis Results of Underground Water around Unit 2 Reactor Building in Fukushima Daiichi NPS <2/2>

Unit: Bq/L

	Place of Sampling			
	N8	No.18	No.19	No.20
Date of Sampling	Oct 30, 2014	Oct 30, 2014	Oct 30, 2014	Oct 30, 2014
Time of sampling	9:40 AM	9:50 AM	9:50 AM	9:40 AM
Cs-134(Approx. 2 years)	ND(12)	990	85	18
Cs-137(Approx.30 years)	37	3,400	330	49
The other γ				
All β	66	4,400	440	82
H-3(Approx.12 years)	Under analysis	Under analysis	Under analysis	Under analysis

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses, except "the other γ".

*1 The highest measurement value (compared to the previous values provided in the handouts published in 'Analysis Results of Underground Water around Unit 2 Reactor Building in Fukushima Daiichi NPS')