


# Sampling Results Regarding the Influence on the Water Leak at a Tank in the H6 Area in Fukushima Daiichi Nuclear Power Station (Around the H6 Area)

<Reference>  
 October 30, 2014  
 Tokyo Electric Power Company

Unit: Bq/L

	Groundwater around H6 area		
	G-1	G-2	G-3
Date of Sampling	Oct 28, 2014	Oct 28, 2014	Oct 28, 2014
Time of sampling	8:53 AM	8:57 AM	9:02 AM
Gross $\beta$	ND(18)	ND(18)	ND(18)
H-3 (Approx. 12 years)	200	1,100	280

\* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

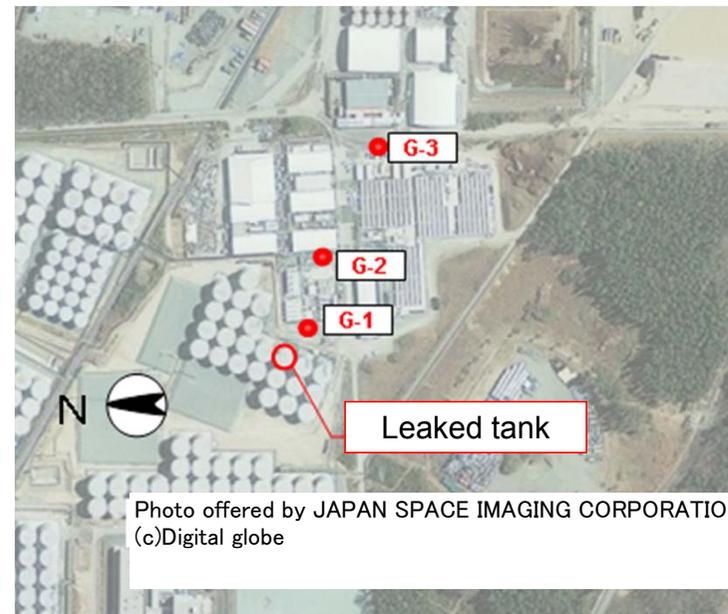

<Reference> The Highest Dose Until the Previous Measurement

Unit: Bq/L

	G-1	G-2	G-3
Gross $\beta$	54 <3/28>	260 <6/10>	46 <7/7>
H-3 (Approx. 12 years)	480 <6/18>	7,000 <3/24, 3/25>	2,600 <5/24>

\* The sampling date is provided in angle brackets.