


Sampling Results Regarding the Influence on the Water Leak at a Tank in the H6 Area in Fukushima Daiichi Nuclear Power Station (Around the H6 Area)

<Reference>
November 6, 2014
Tokyo Electric Power Company

Unit: Bq/L

| | Groundwater around H6 area | | |
|------------------------|----------------------------|-------------|-------------|
| | G-1 | G-2 | G-3 |
| Date of Sampling | Nov 4, 2014 | Nov 4, 2014 | Nov 4, 2014 |
| Time of sampling | 9:37 AM | 9:42 AM | 9:47 AM |
| Gross β | ND(17) | ND(17) | ND(17) |
| H-3 (Approx. 12 years) | 180 | 1,100 | 360 |

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

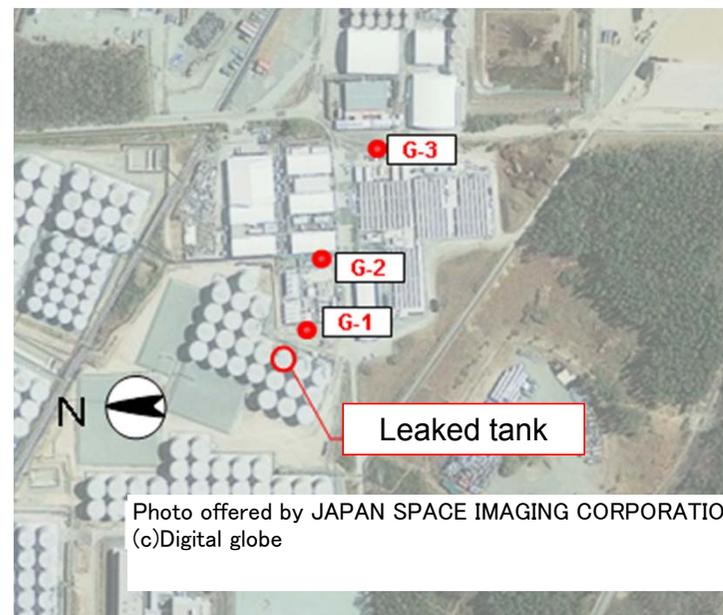

<Reference> The Highest Dose Until the Previous Measurement

Unit: Bq/L

| | G-1 | G-2 | G-3 |
|------------------------|------------|--------------------|--------------|
| Gross β | 54 <3/28> | 260 <6/10> | 46 <7/7> |
| H-3 (Approx. 12 years) | 480 <6/18> | 7,000 <3/24, 3/25> | 2,600 <5/24> |

* The sampling date is provided in angle brackets.