


Sampling Results Regarding the Influence on the Water Leak at a Tank in the H6 Area in Fukushima Daiichi Nuclear Power Station (Around the H6 Area)

<Reference>
November 27, 2014
Tokyo Electric Power Company

Unit: Bq/L

	Groundwater around H6 area		
	G-1	G-2	G-3
Date of Sampling	Nov 25, 2014	Nov 25, 2014	Nov 25, 2014
Time of sampling	9:25 AM	9:30 AM	9:35 AM
Gross β	ND(19)	ND(19)	ND(19)
H-3 (Approx. 12 years)	ND(110)	510	460

* "ND"s indicate that the measurement results are below the detection limits, and the detection limit of each nuclide is provided in parentheses.

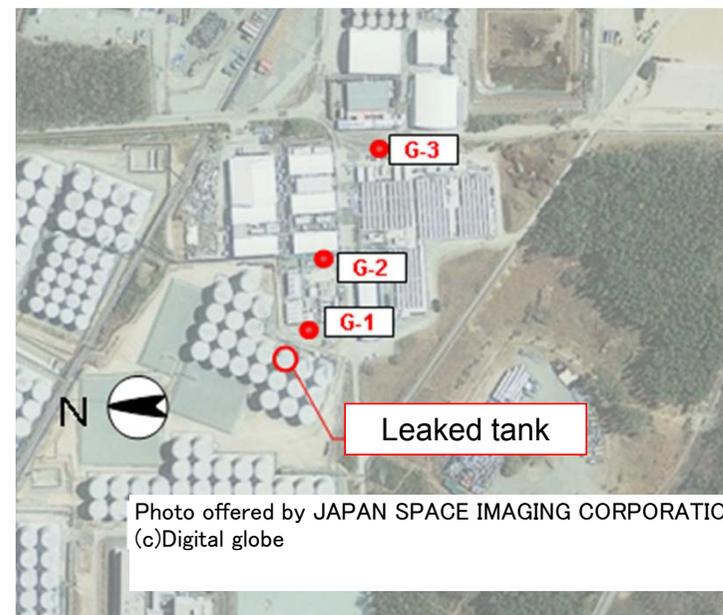

<Reference> The Highest Dose Until the Previous Measurement

Unit: Bq/L

	G-1	G-2	G-3
Gross β	54 <3/28>	260 <6/10>	46 <7/7>
H-3 (Approx. 12 years)	480 <6/18>	7,000 <3/24,3/25>	2,600 <5/24>

* The sampling dates are provided in angle brackets.