Sampling Results Regarding the Discharge of Groundwater Bypass at Fukushima Daiichi Nuclear Power Station (Around South Water Outlet)

Reference>
September 5, 2014
Tokyo Electric Power Company

Unit: Bg/L

•: =4:					
	Seawater of the south water outlet				
	Note (near the drainage channel exit)				
	(T-2)				
Sampling date	Sep 3, 2014				
State	During discharge				
Sampling time	11:35 AM				
Cesium 134	ND(0.62)				
Cesium 137	esium 137 ND(0.63)				
Gross β	9.2				
Tritium	ND(1.7)				

Note: Approx. 330m south from Unit 1-4 water outlet (T-2)

(Reference) Analysis results of temporary storage tanks for groundwater bypass at Fukushima Daiichi Nuclear Power Station*


Unit: Ba/L

					J 24-2
	Gr2 (Group 2)		Operatinal targets	*1 Notification limit	WHO guidelines for drinking-water quality
	TEPCO	Third party organization			
Sampling date	Aug 25, 2014	Aug 25, 2014			
Sampling time	10:14 AM	10:14 AM			
The volume of water in storage [m³]	2,110	2,110			
Cesium 134	ND(0.79)	ND(0.71)	1	60	10
Cesium 137	ND(0.72)	ND(0.63)	1	90	10
Other Gamma Nuclide	Not detected	Not detected	Not to be detected*2		
Gross β	ND(0.80)	ND(0.56)	5(1) (Note)		
Tritium	200	200	1,500	60,000	10,000

^{*} The results were previously announced on August 28.

(Note) The detection limit value for Grossβ of operational targets are defined as "Less than 1 Bg/L", when sampled approx. once per 10 days.

facilities and the protectection of specialized nuclear fuel materials in TEPCO Fukushima Daiichi Nuclear Power Station.

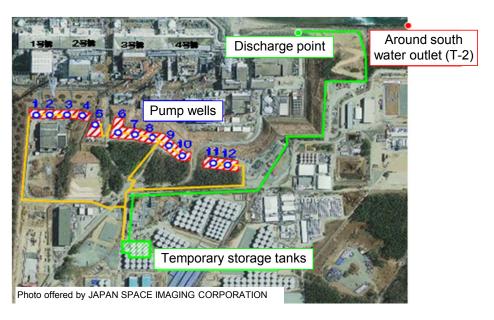

^{* &}quot;ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

^{*} Third party: Japan Chemical Analysis Center

^{* &}quot;ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

^{*1} Notified Concentration Limit Values: Specified in the rules for the safety and maintenance of nuclear reactor

^{*2} Other gamma nuclides (except naturally-occurring nuclides) must not be detected during the analysis Cs-134 and Cs-137.