

May 31, 2015
Tokyo Electric Power Company Holdings, Inc. /

Air Dose Rates inside the Buildings


Sampling Period

Unit 4: from March 1, 2016 to March 31, 2016


Fukushima Daiichi NPS


Unit 4 Reactor Building Semi-Basement Floor


[mSv/h]

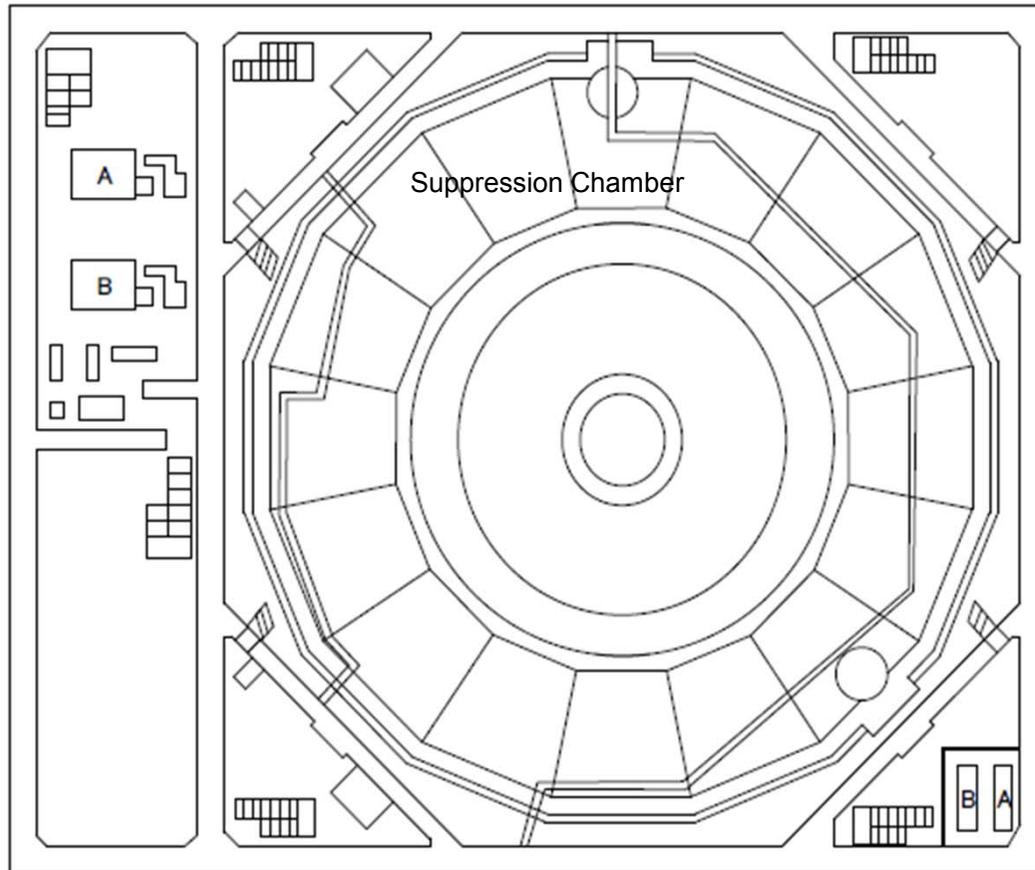



Fukushima Daiichi NPS	Unit 4 Reactor Building 1st Floor	[mSv/h]
-----------------------	-----------------------------------	---------

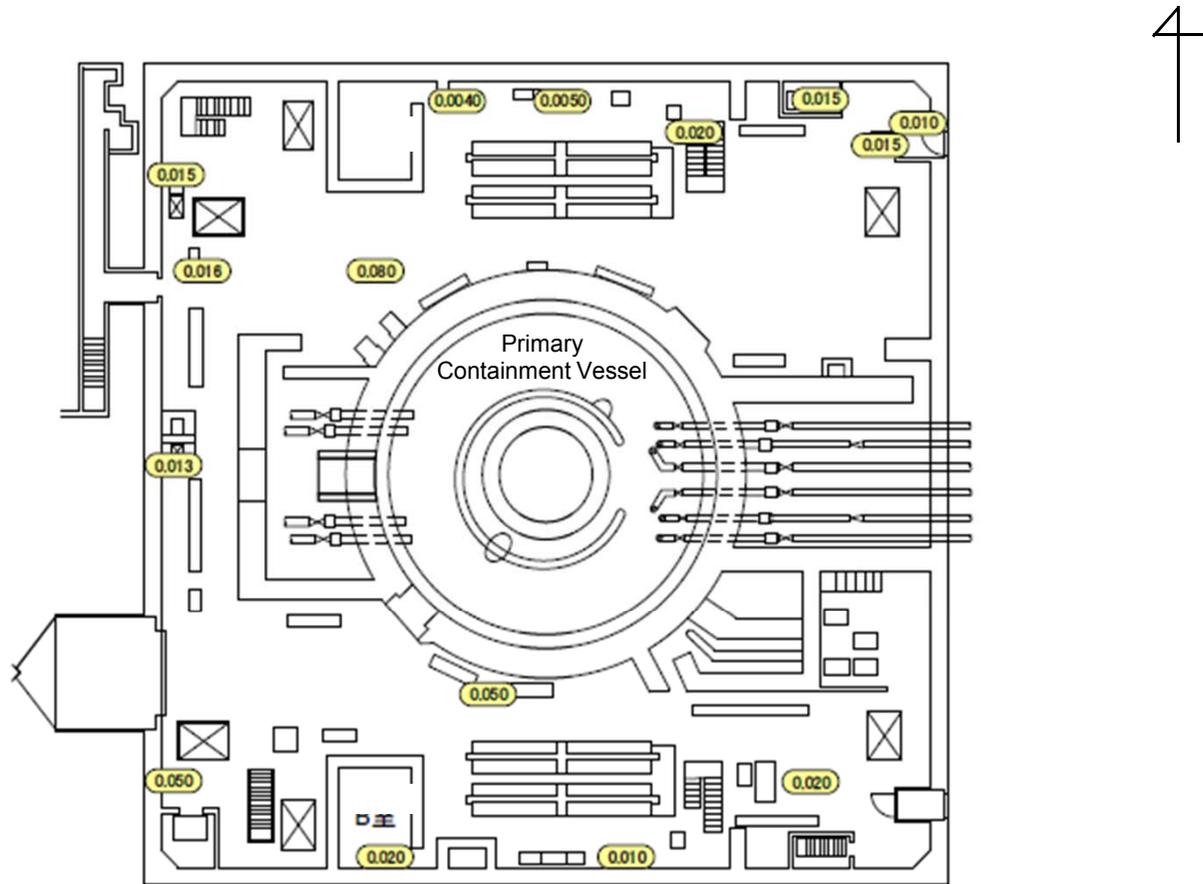


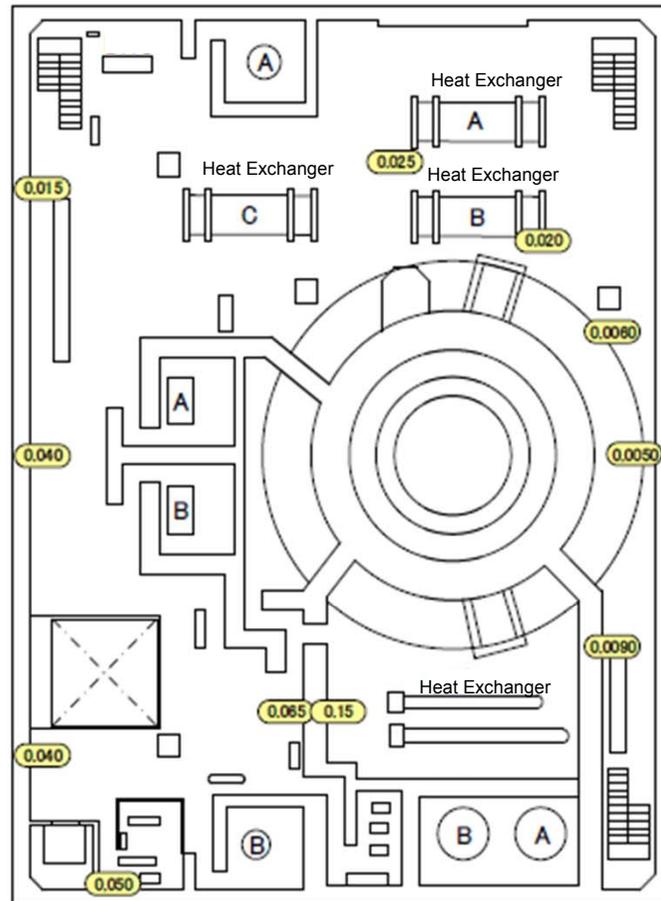

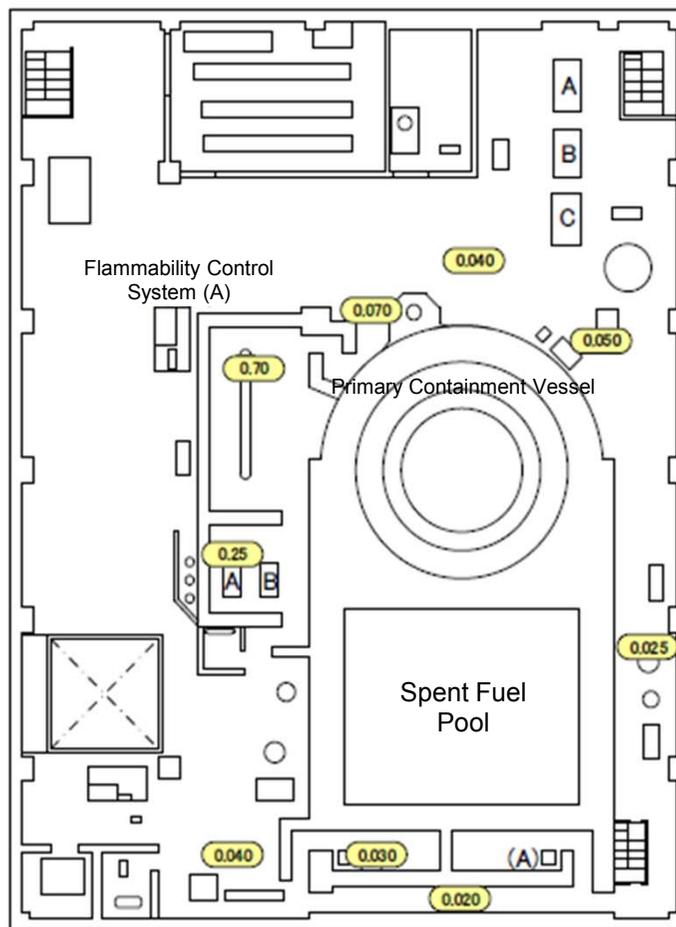

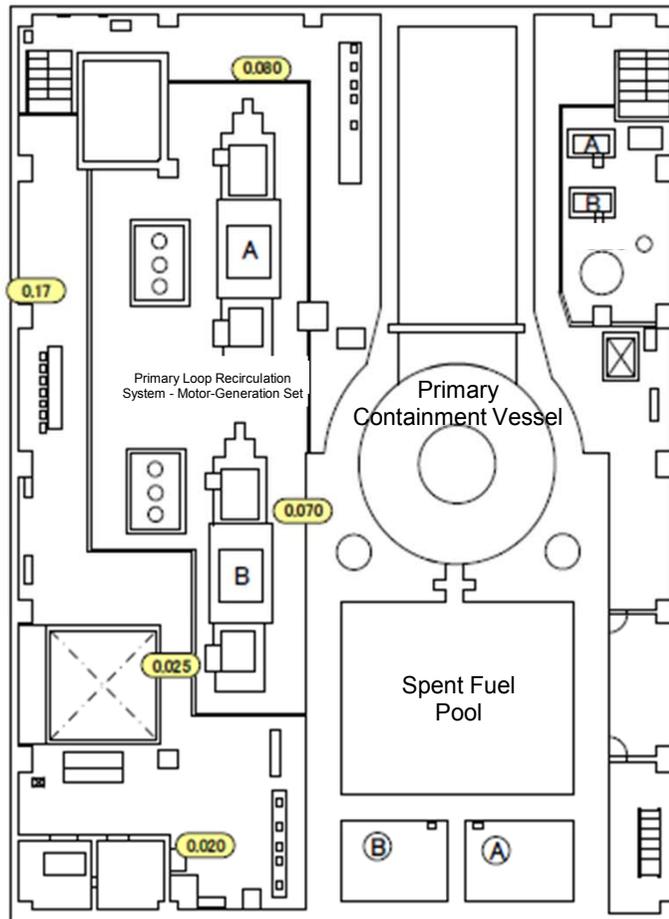


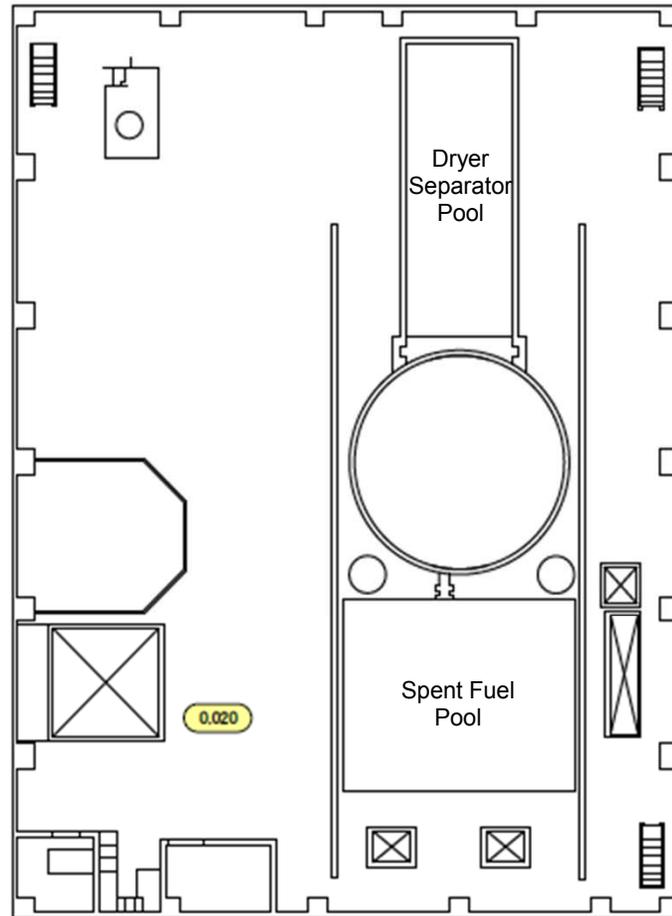


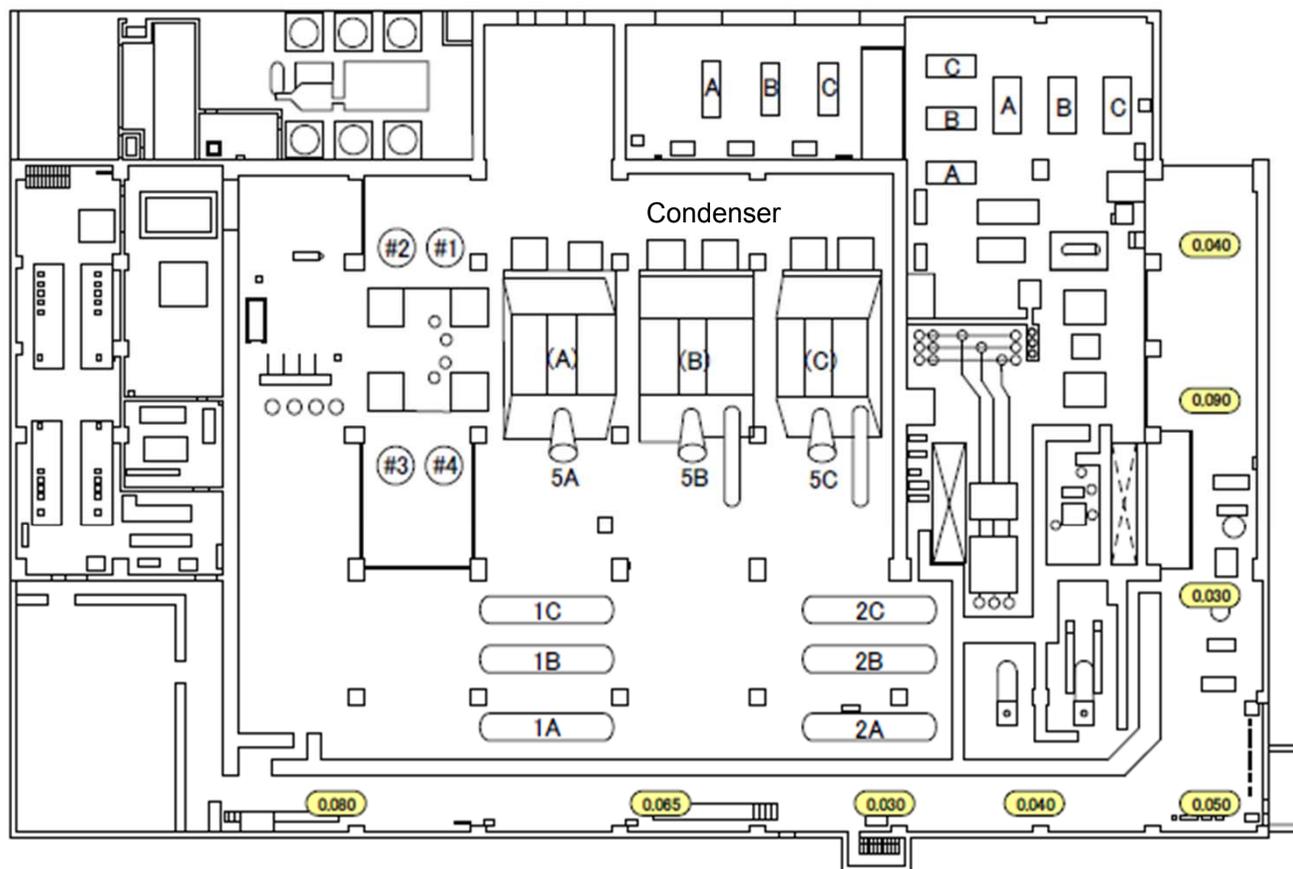

Fukushima Daiichi NPS

Unit 4 Turbine Building 2nd Floor


[mSv/h]

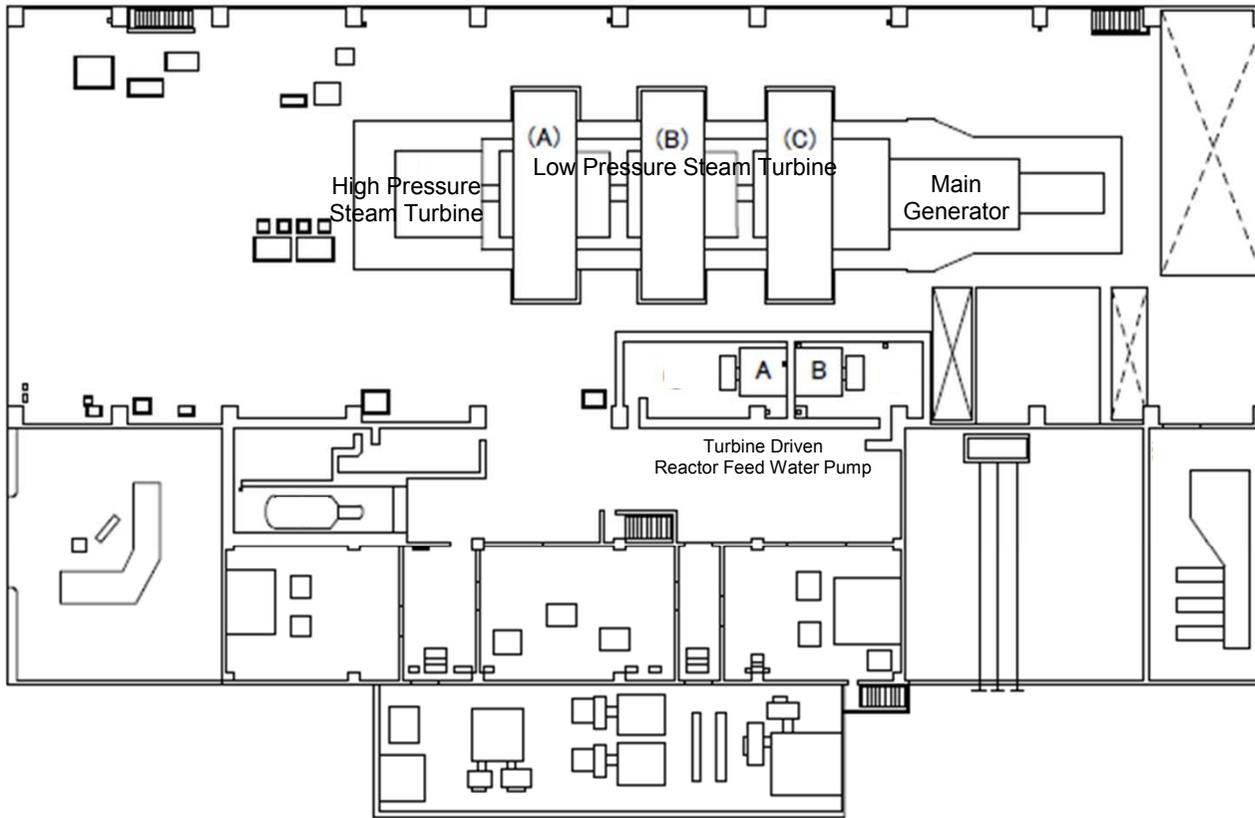


Fukushima Daiichi NPS


Unit 4 Radioactive Waste Treatment Facility 1st Floor

[mSv/h]

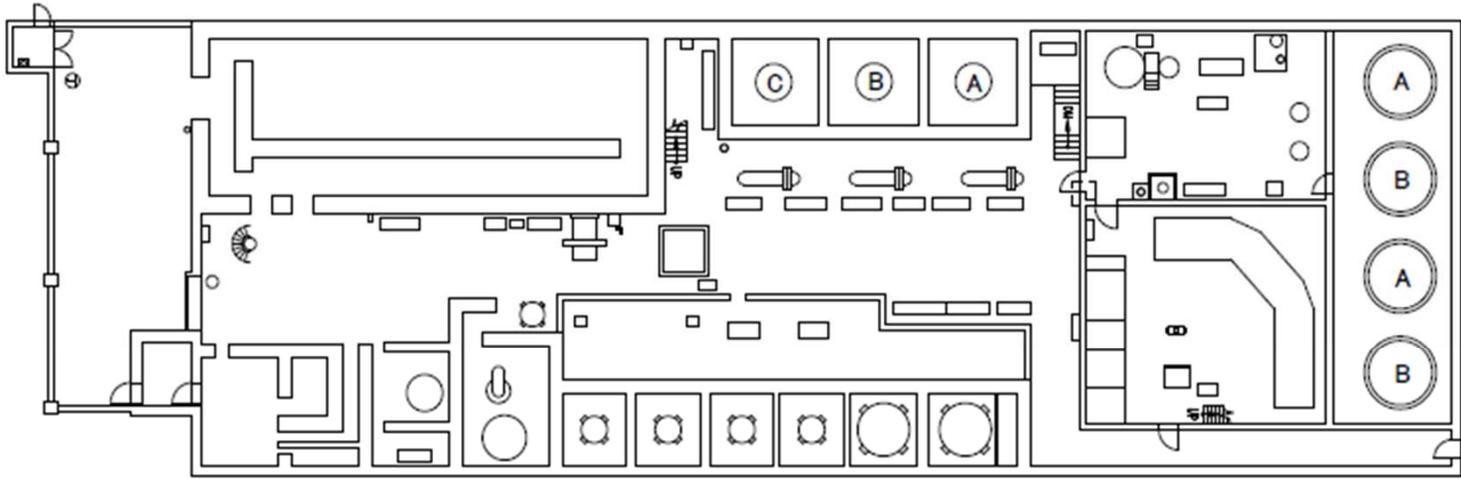

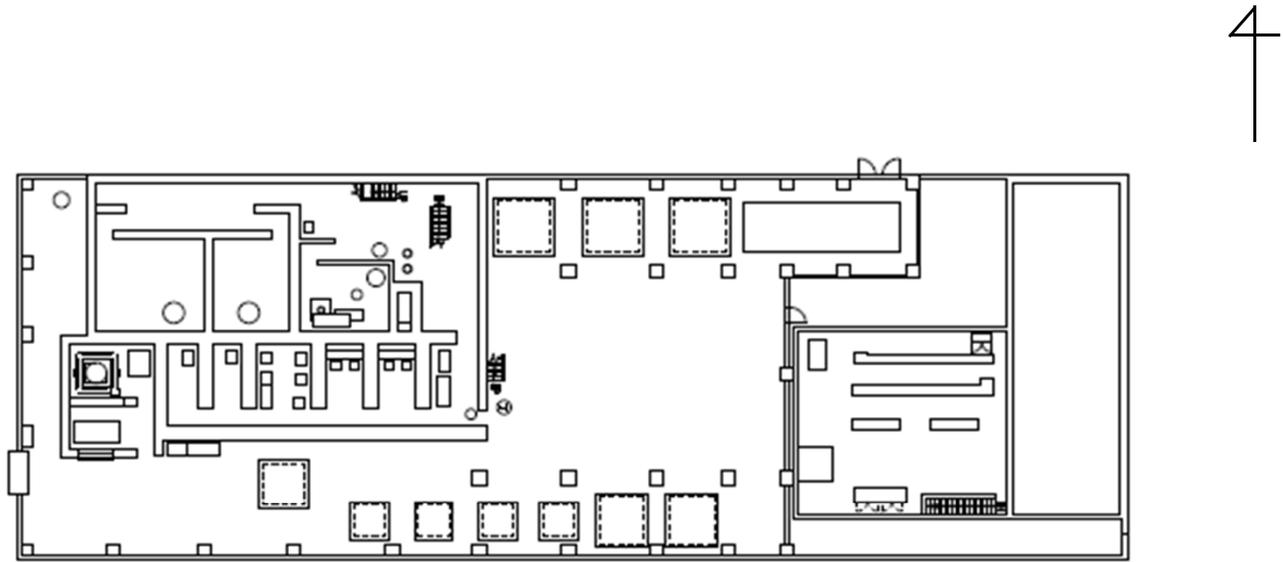

Fukushima Daiichi NPS	Unit 4 Radioactive Waste Treatment Facility 3rd Floor	[mSv/h]
-----------------------	---	---------

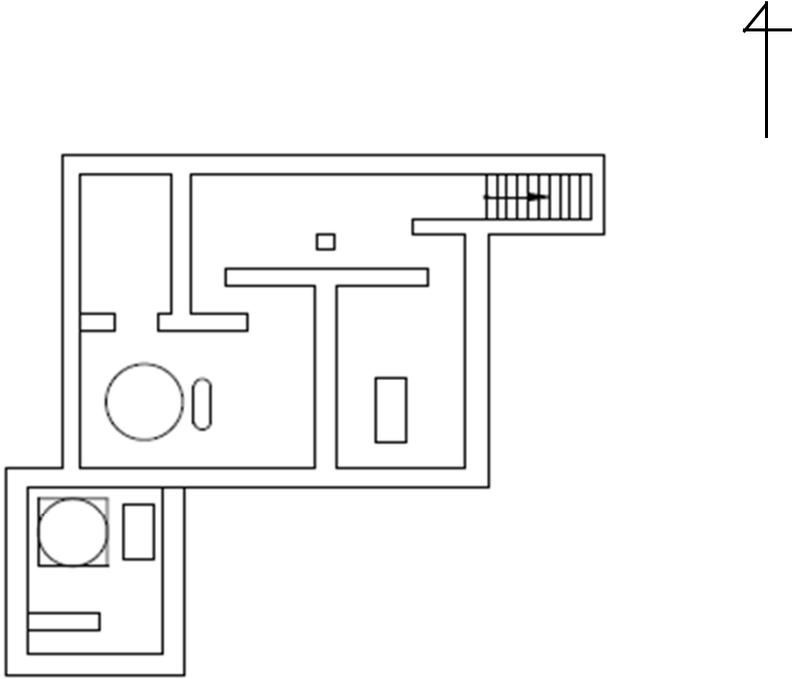

Fukushima Daiichi NPS

Unit 4 Radioactive Waste Treatment Facility 4th Floor

[mSv/h]

