

Revised


*Regarding groundwater movement on the page 10

<Reference>


The Radioactive Material Concentration in the Ground- and Seawater on the East side of the Turbine Building

**October 25, 2013
Tokyo Electric Power Company**

Monitor Plan (Sampling site)

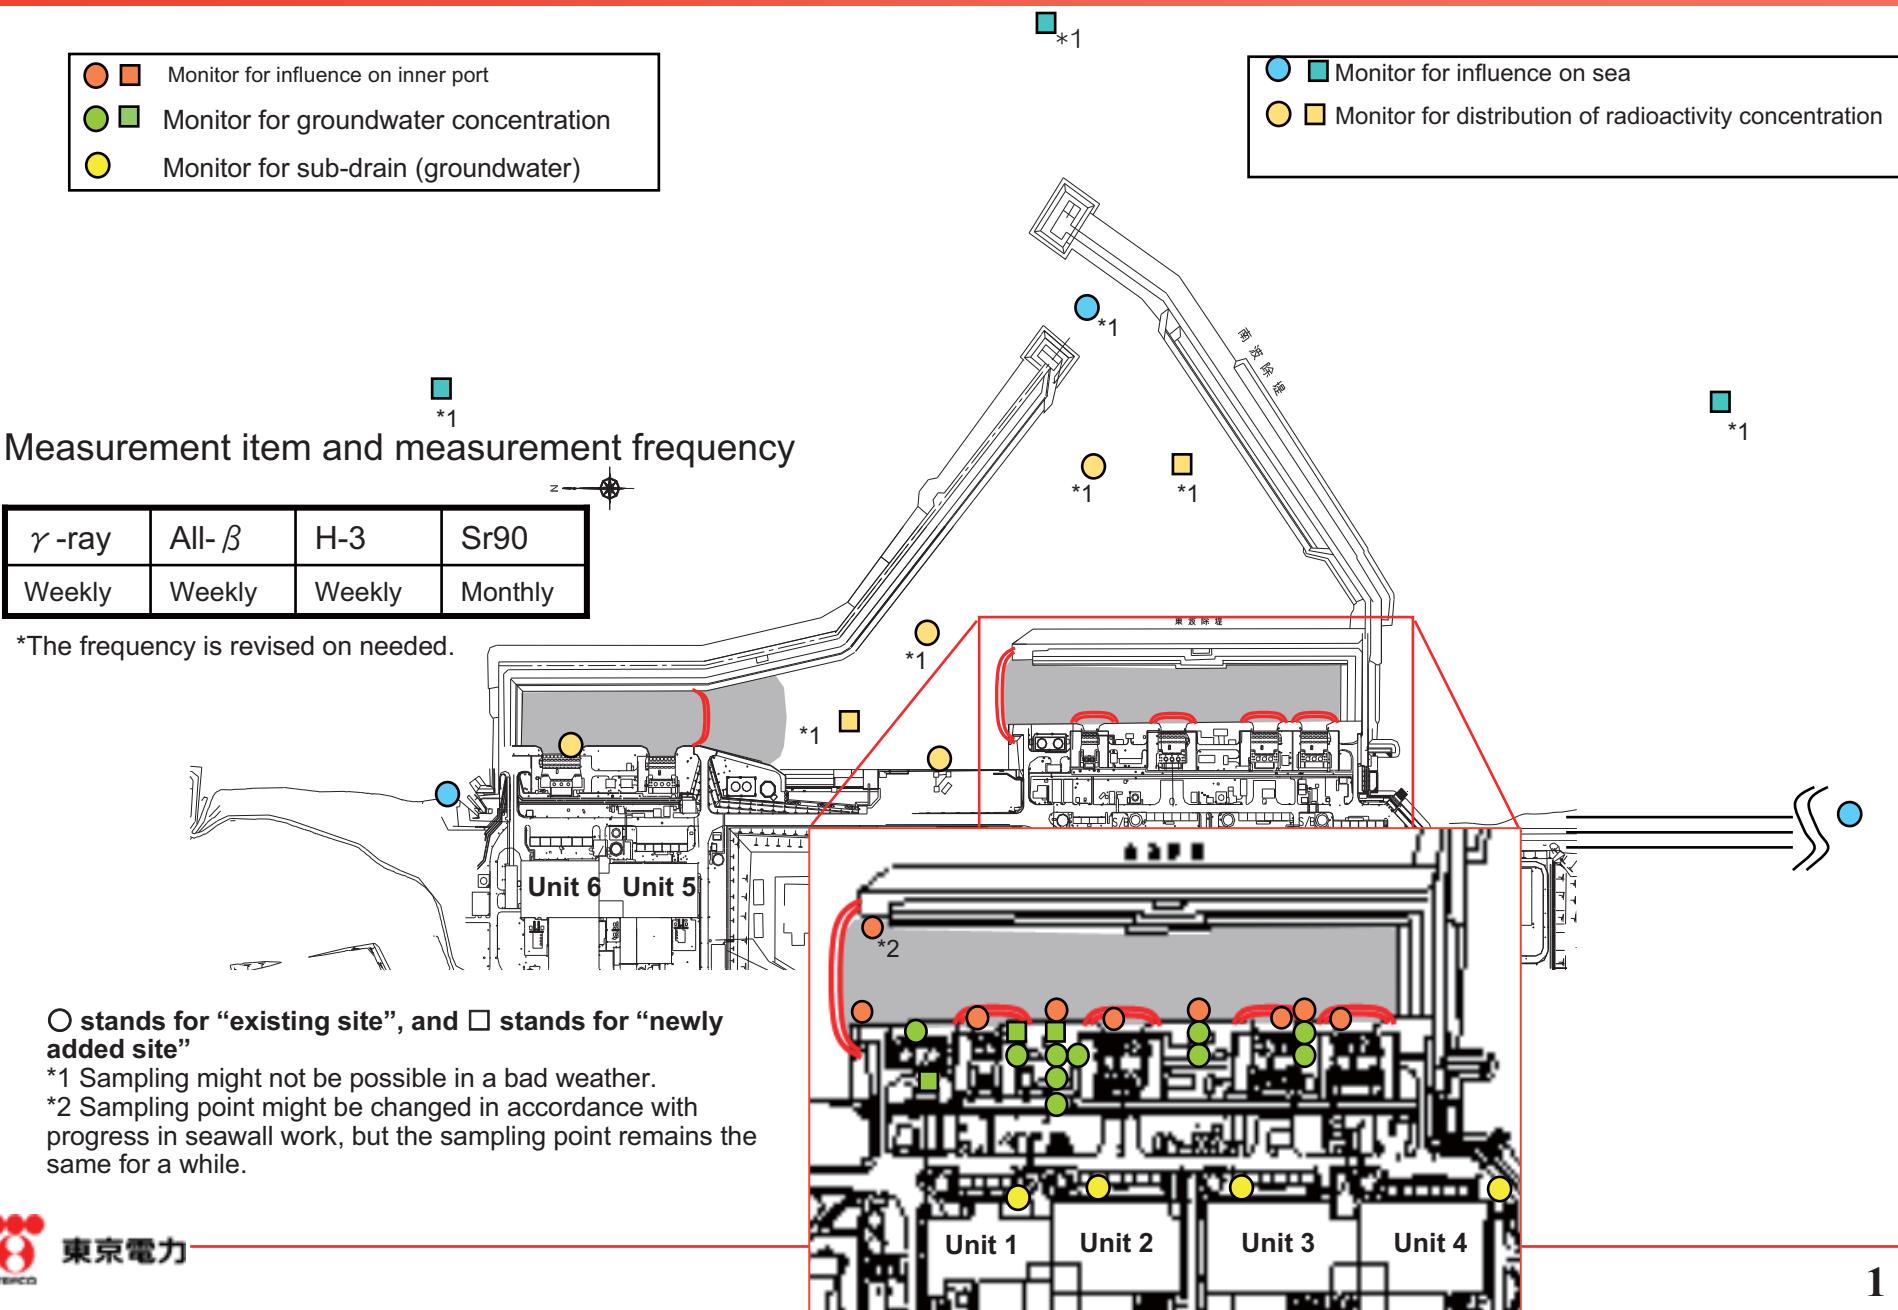


Groundwater concentration distribution (At-site comparison)

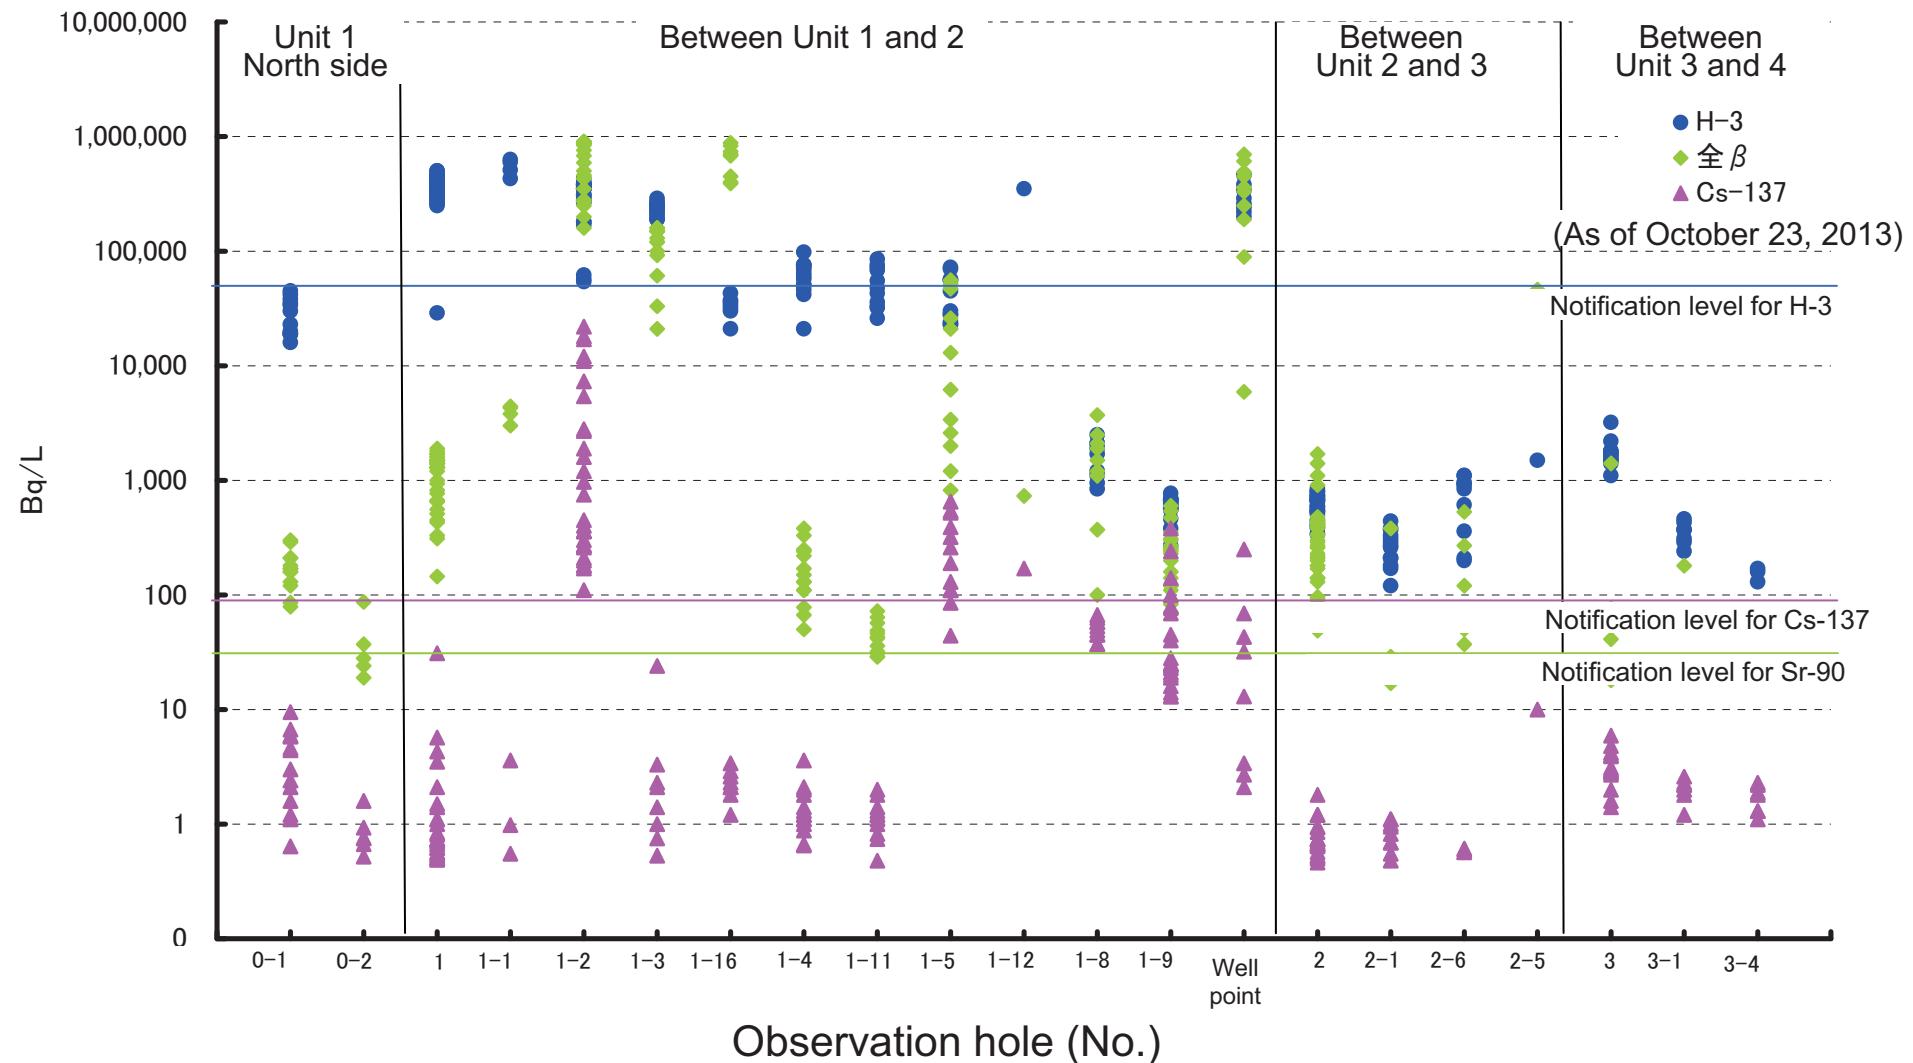


Transition in groundwater tritium concentration (1/2)

As of October 24, 2013

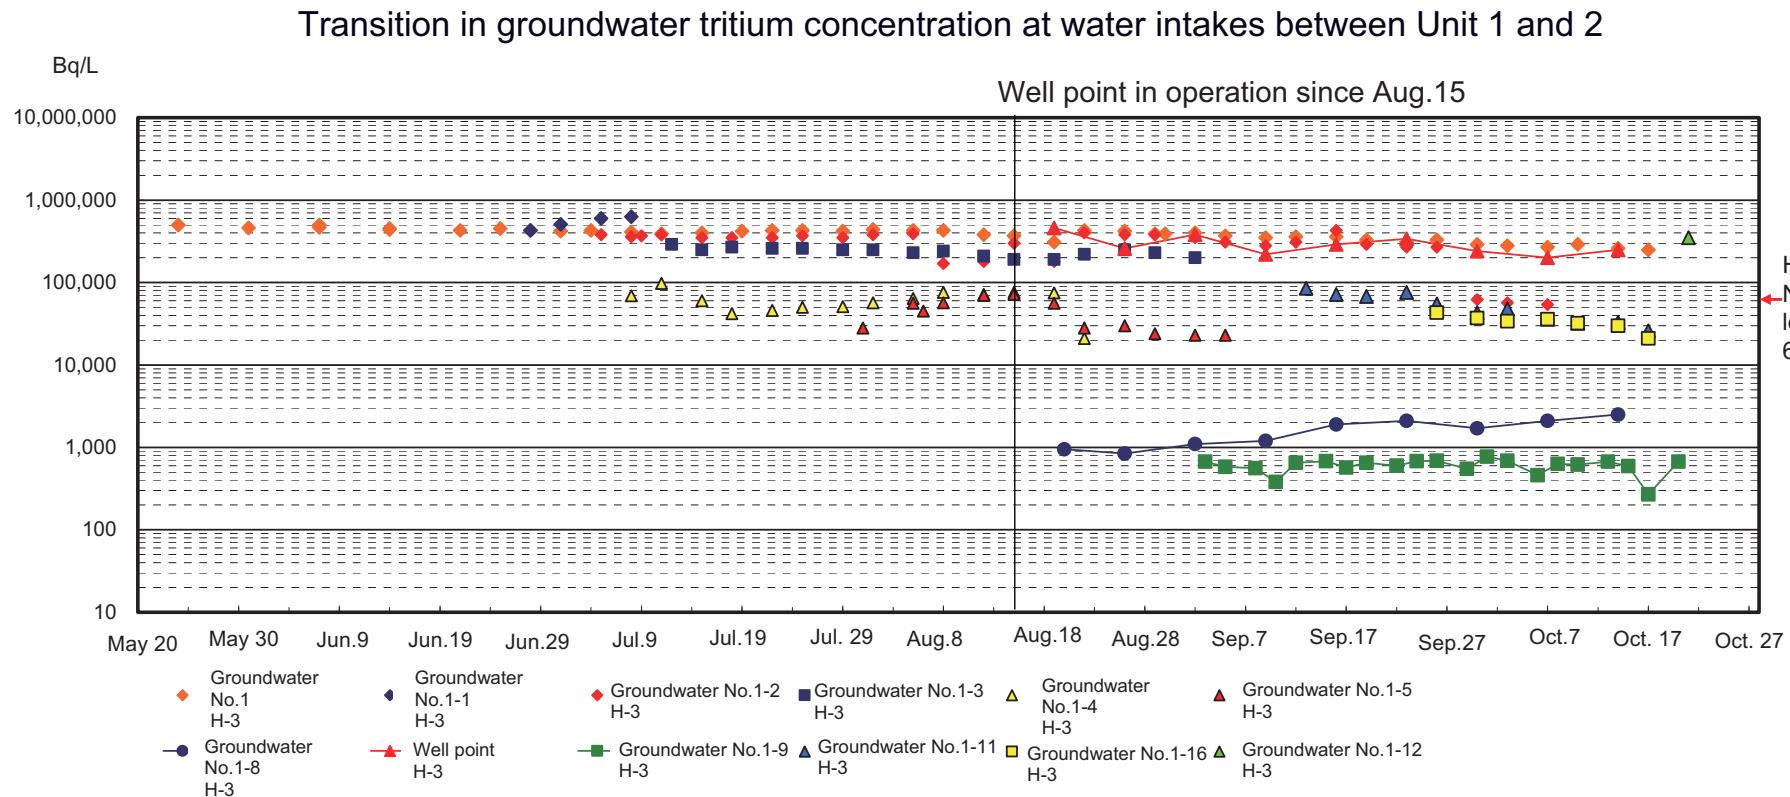


Transition in groundwater tritium concentration (2/2)

As of October 24, 2013

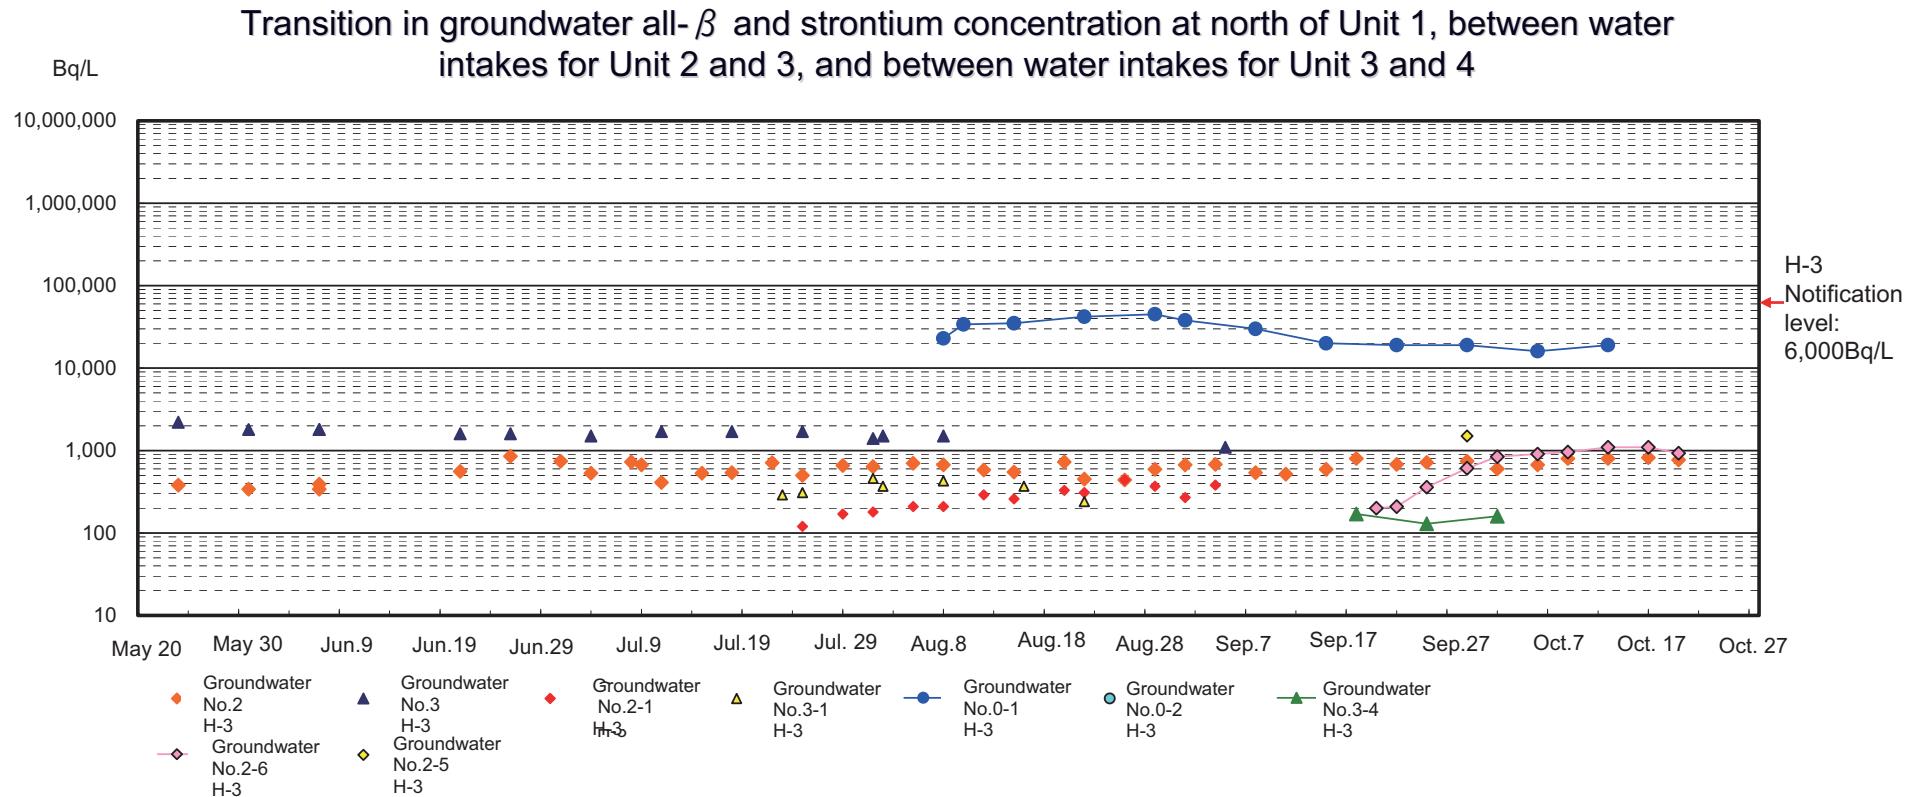


Transition in groundwater all- β and strontium concentration (1/2)

As of October 24, 2013

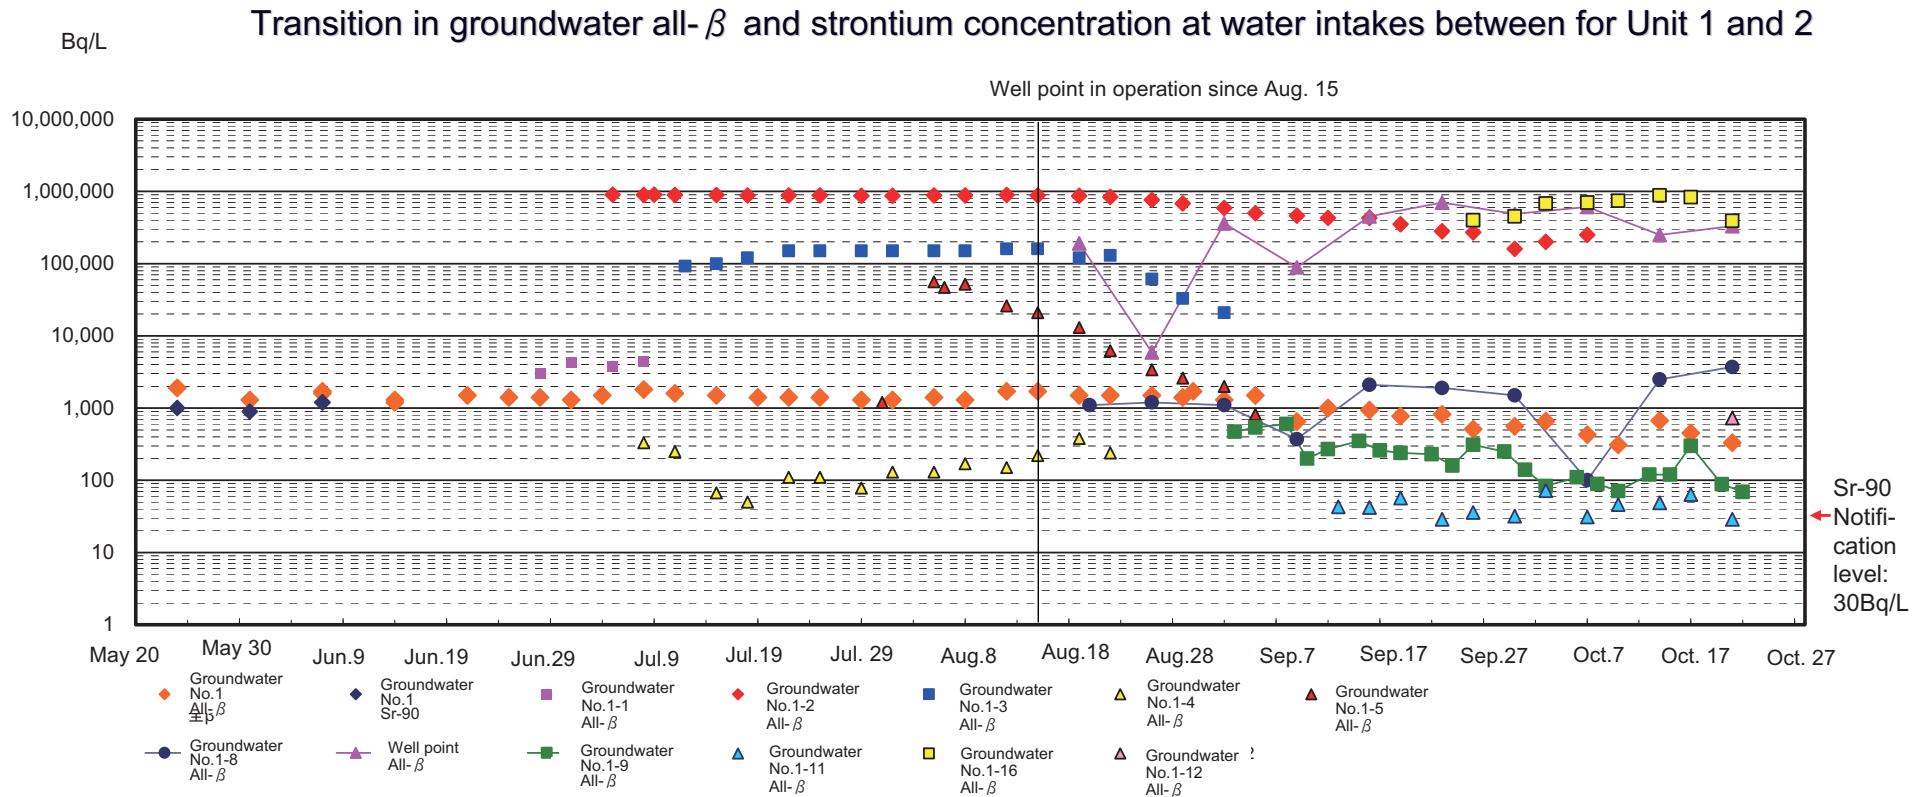


Transition in groundwater all- β and strontium concentration (2/2)

As of October 24, 2013

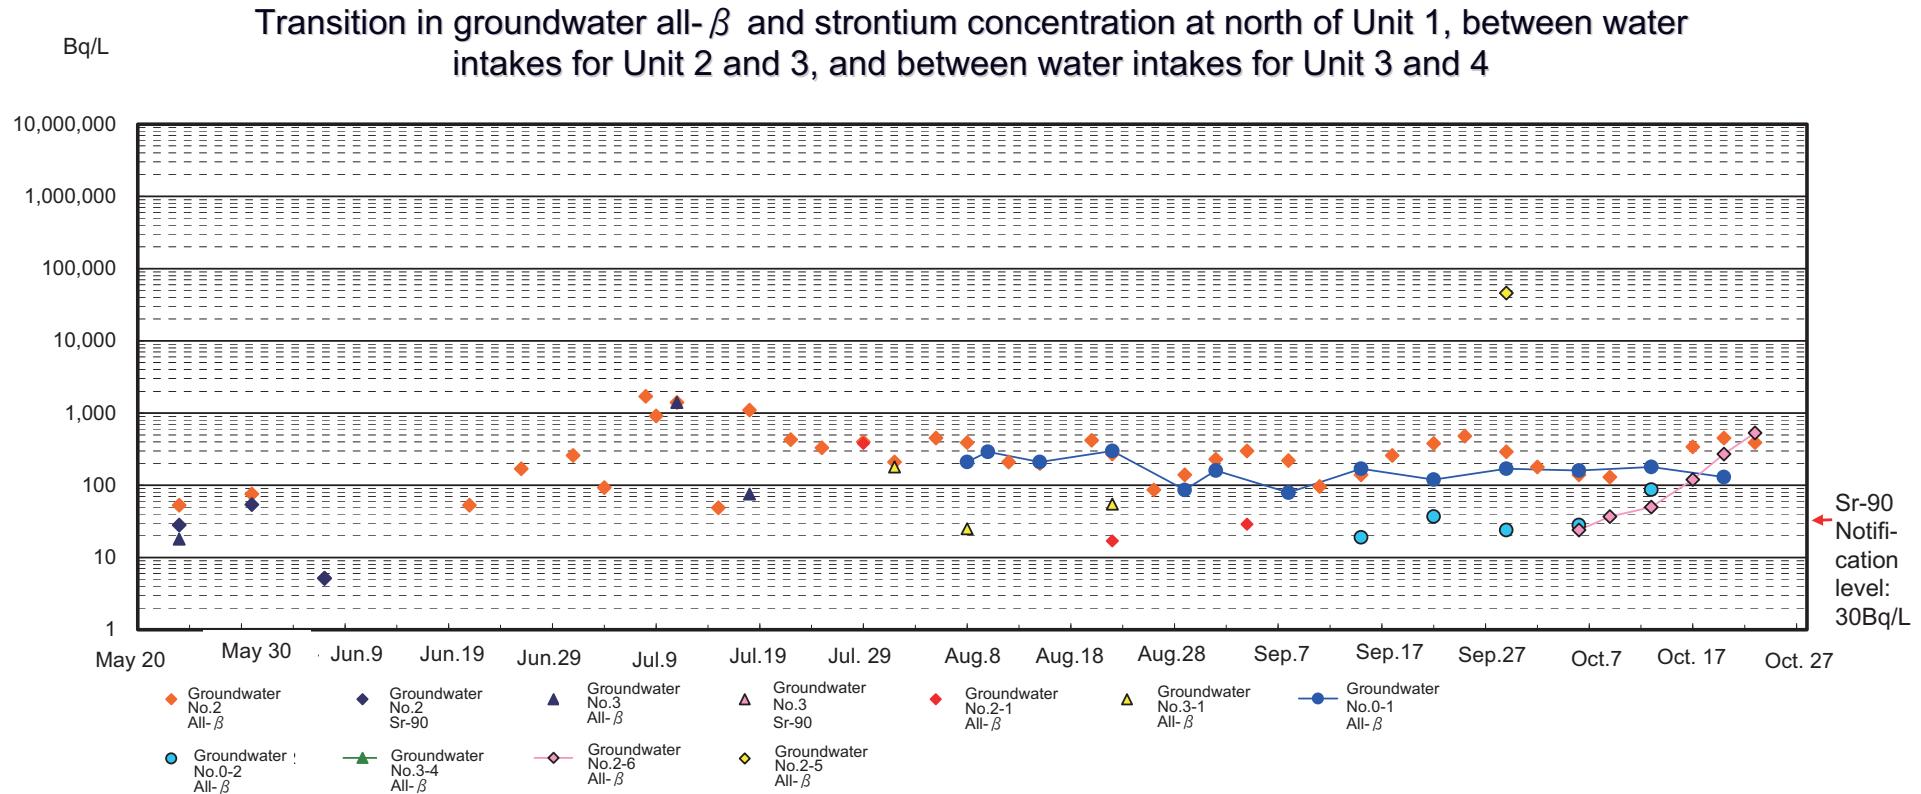


Transition of seawater concentration between water intakes for Unit 1 and 2

As of October 24, 2013

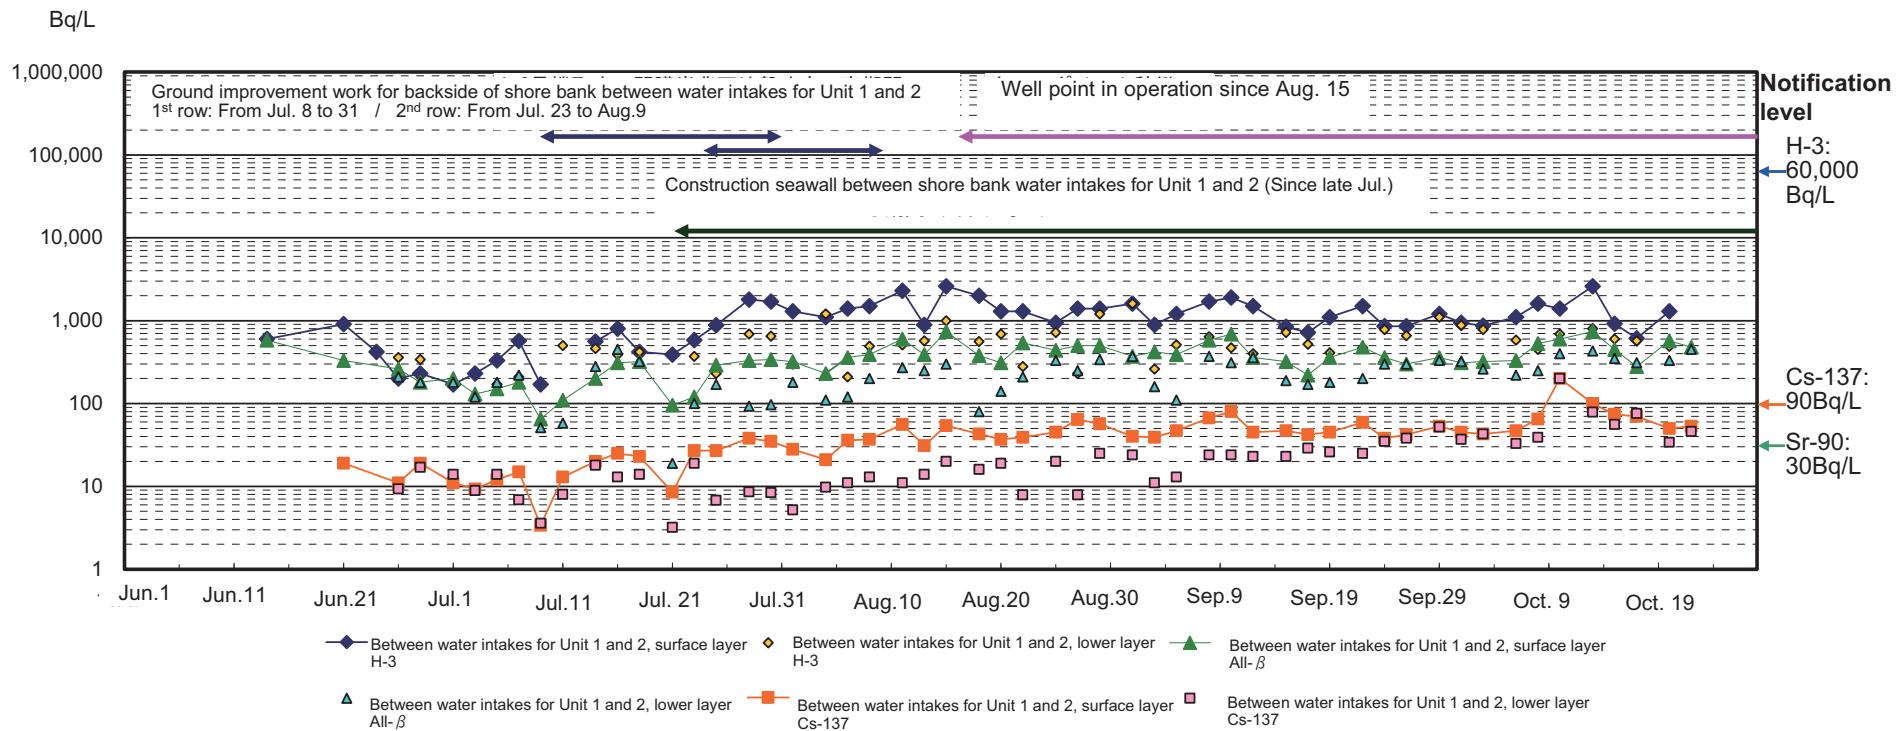


Transition of seawater concentration on the north of water intakes for Unit 1 to 4, and north of east seawall

As of October 24, 2013

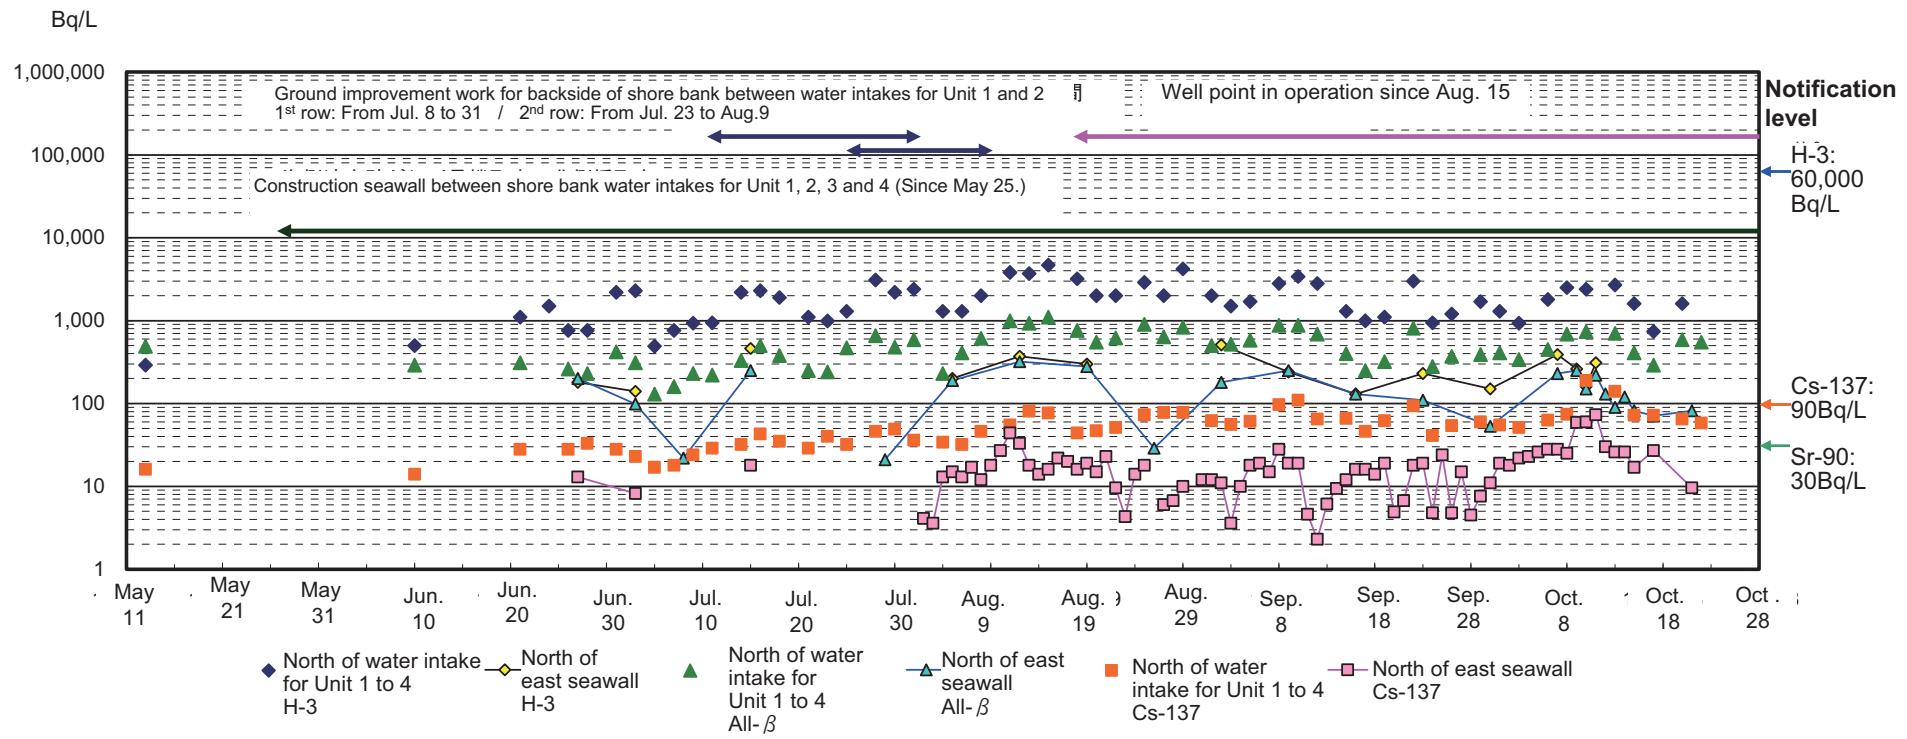


Transition in seawater concentration inside silt fence for Unit 2 and port entrance east side (2/2)


As of October 24, 2013

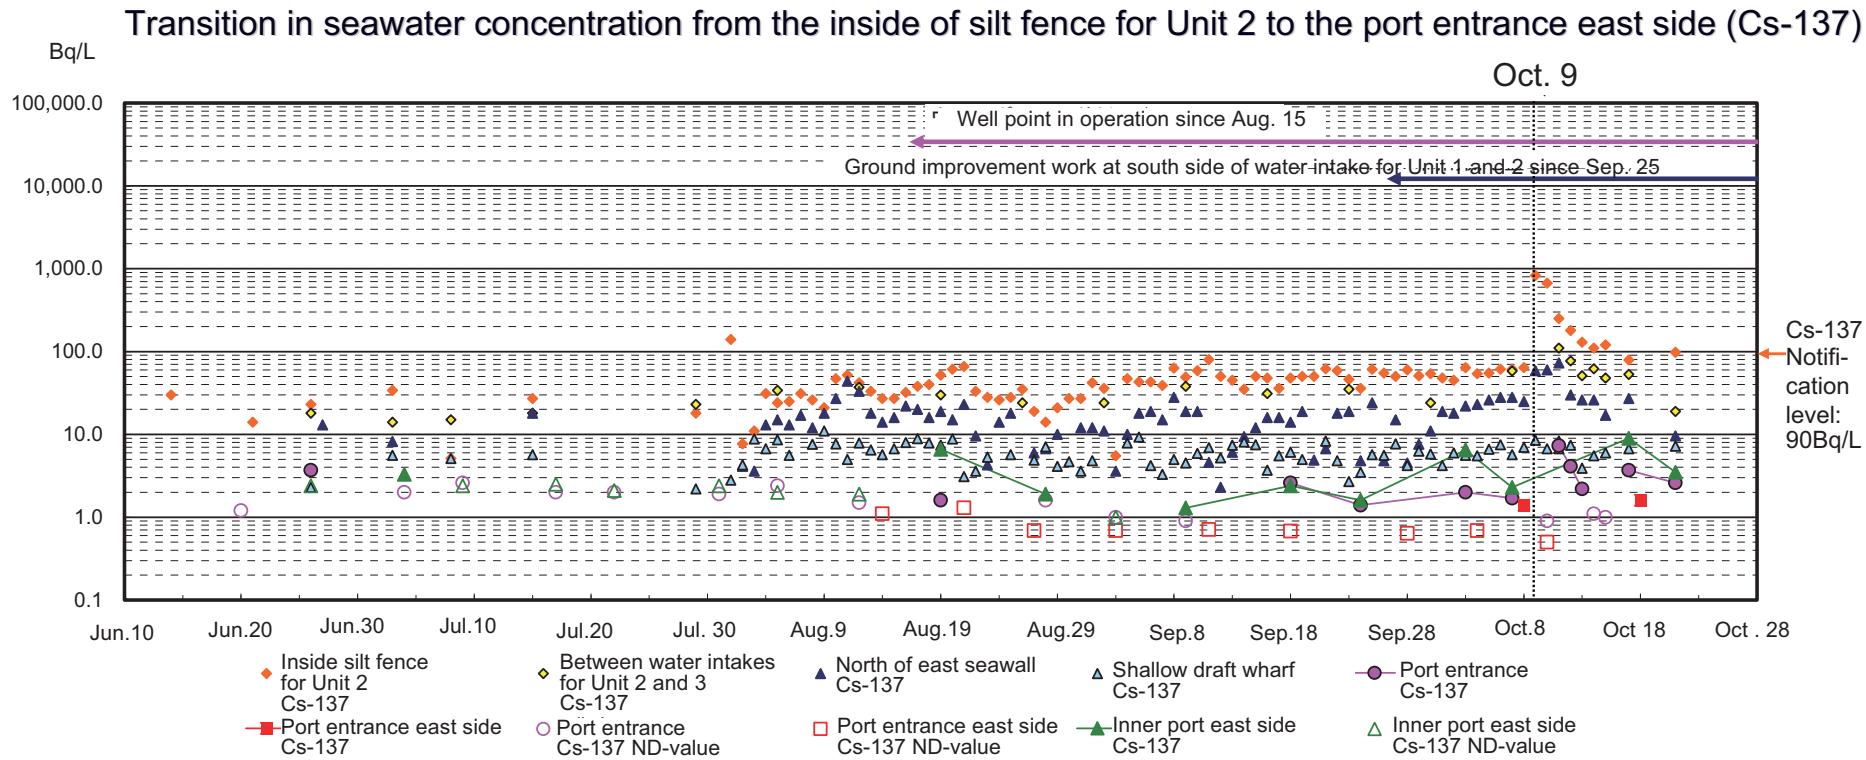

Movement in groundwater level (Between Unit 1 and 2: From Sep. 24 to Oct. 24)

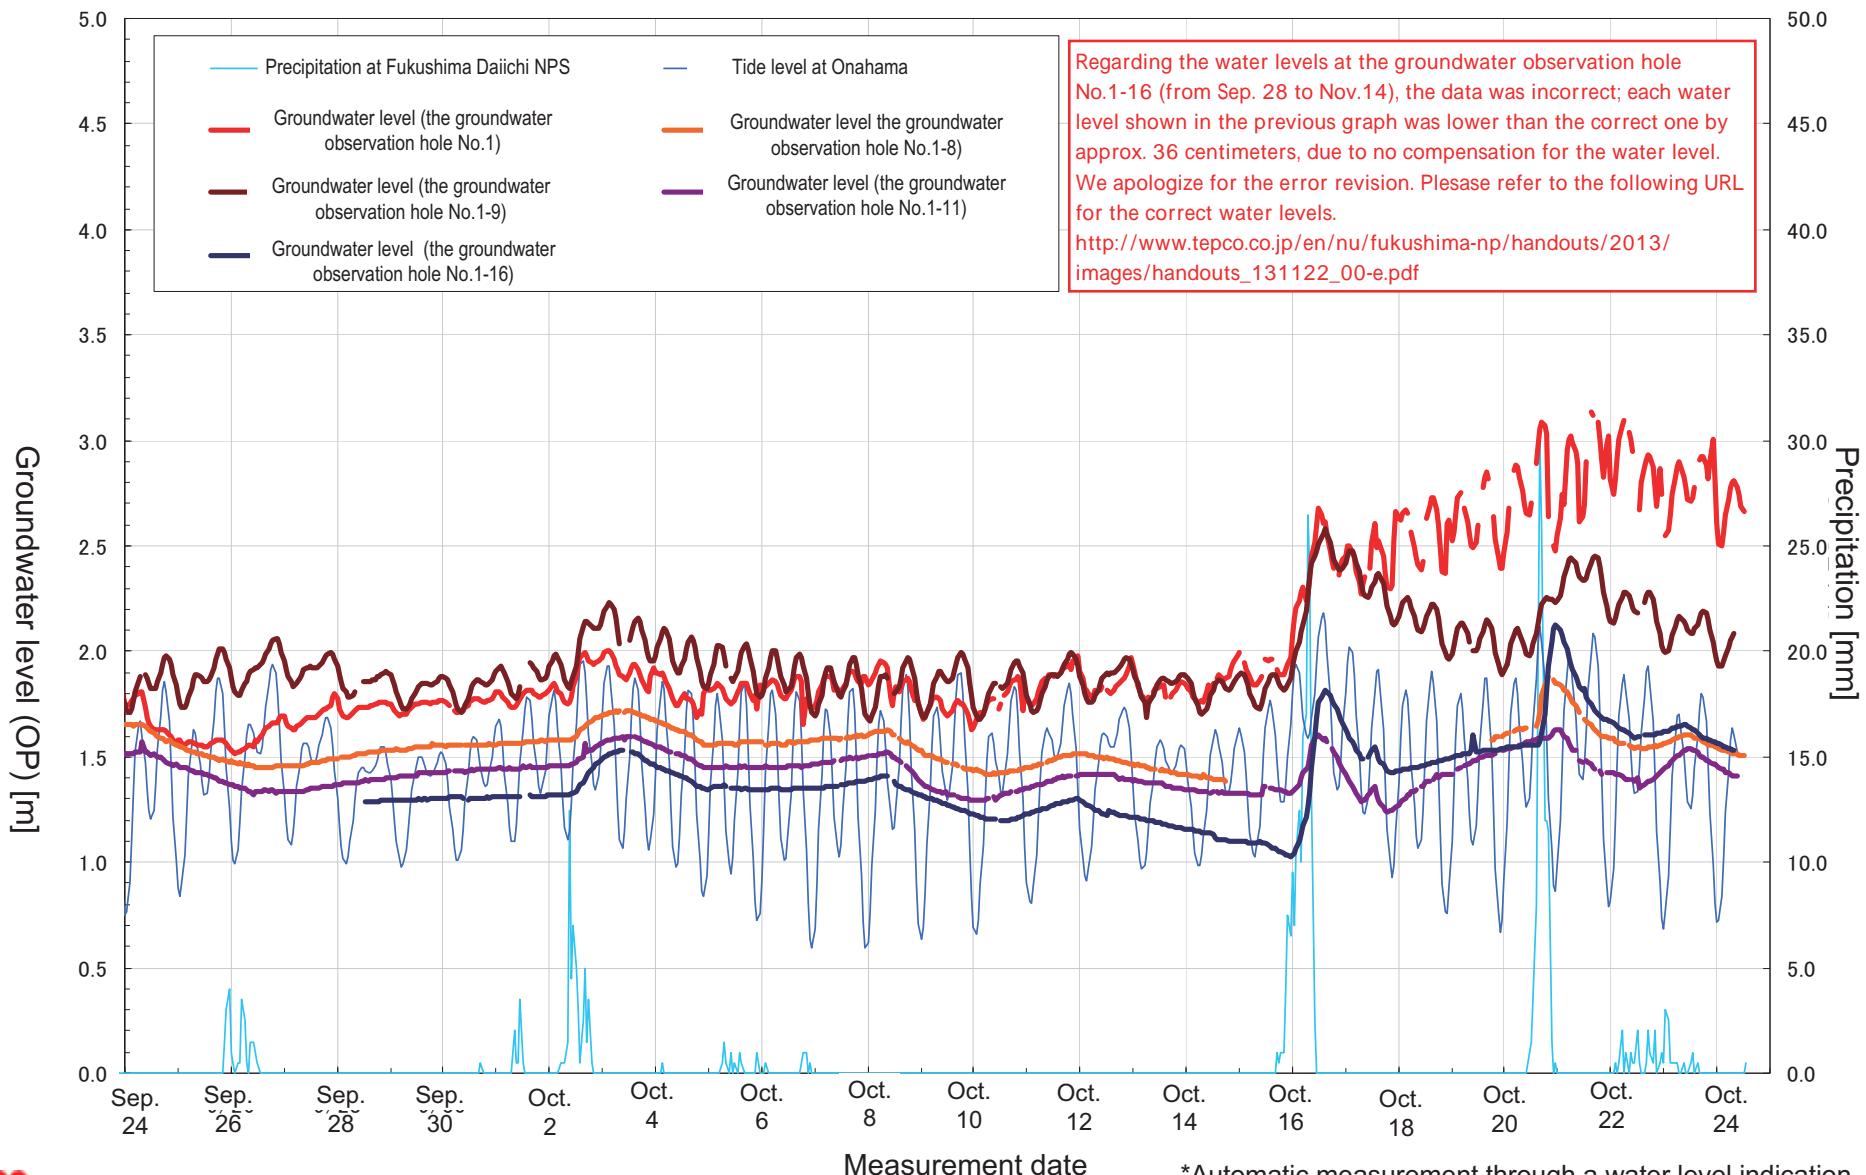


Progress in the ground improvement work between Unit 1 and 2 (As of in the morning on October 24)

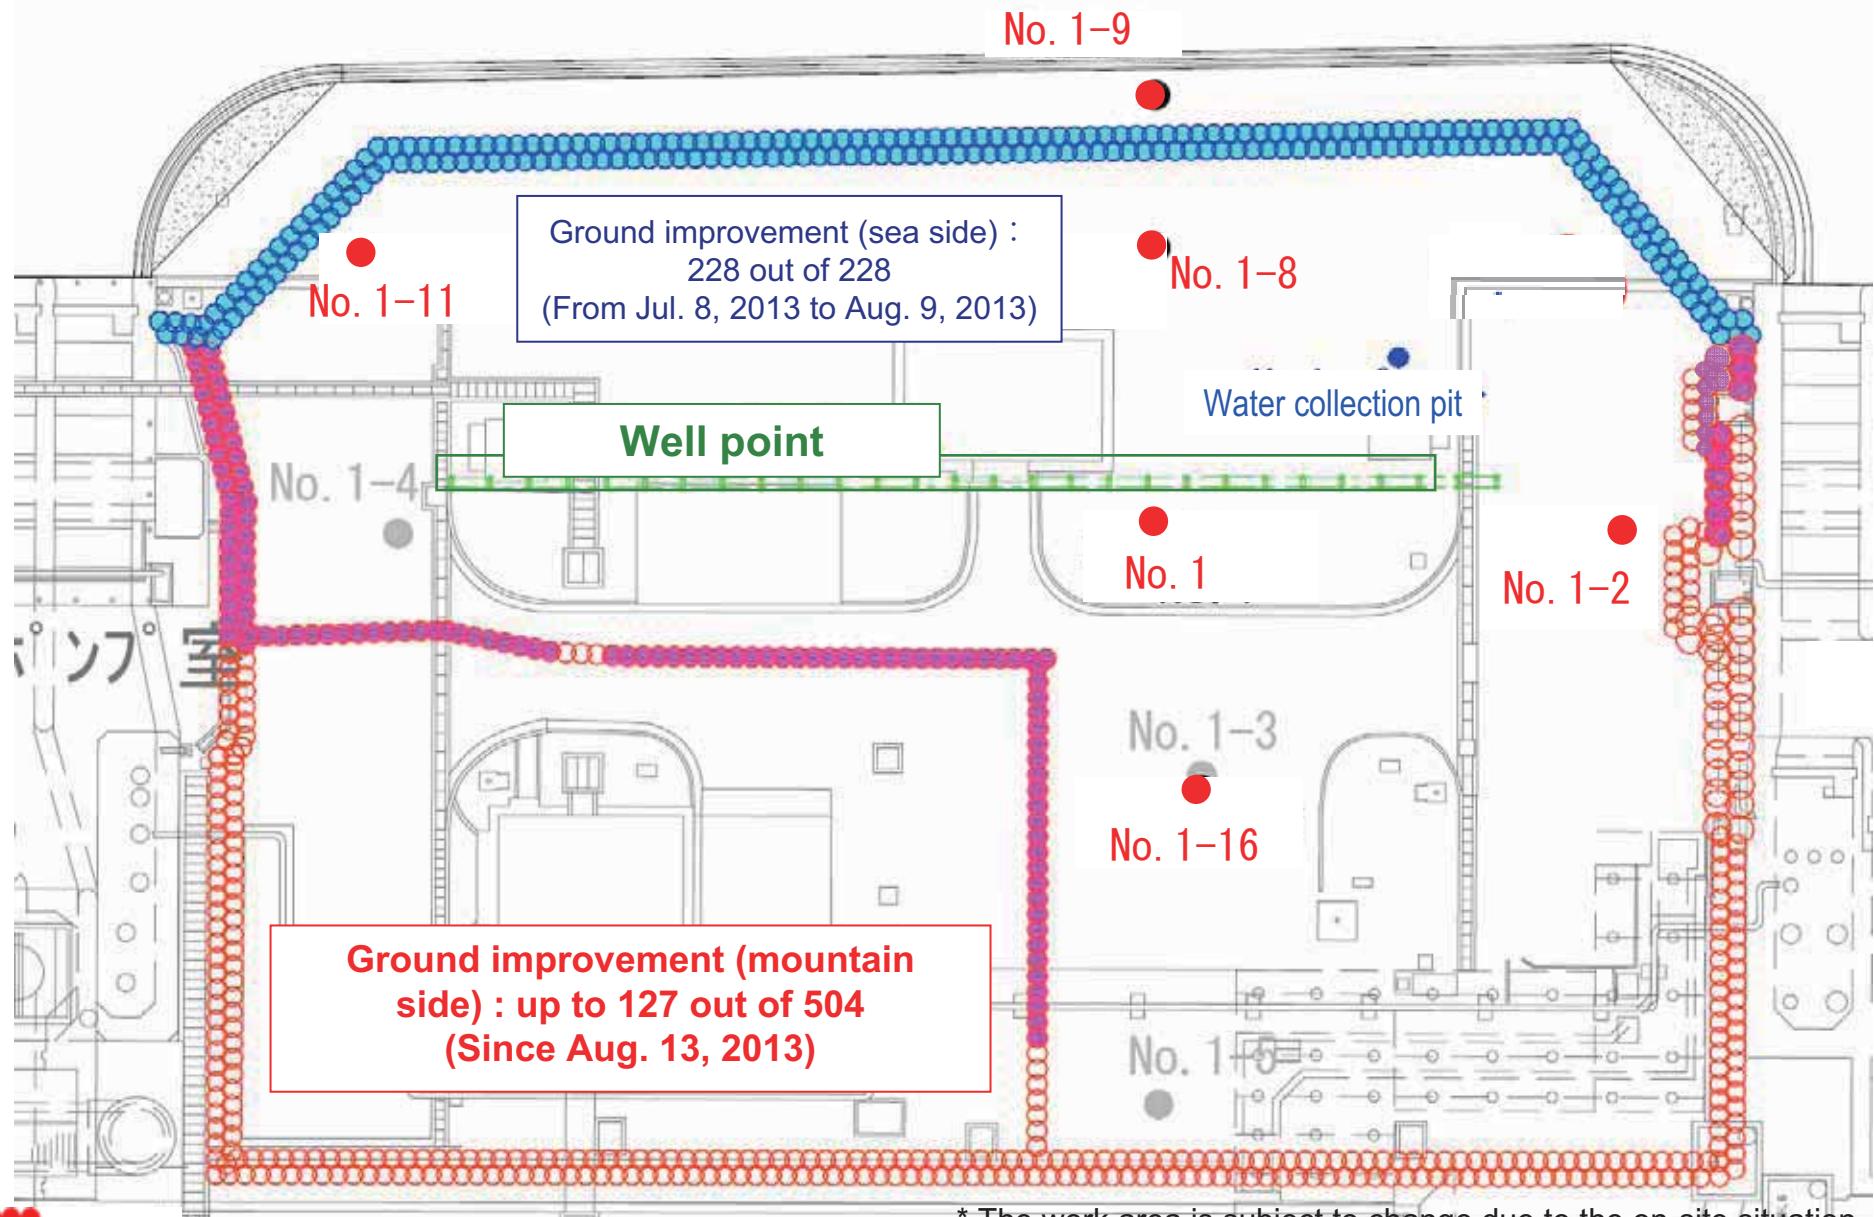


* The work area is subject to change due to the on-site situation.

Movement in groundwater level (Between Unit 2 and 3: From Sep. 24 to Oct. 24)

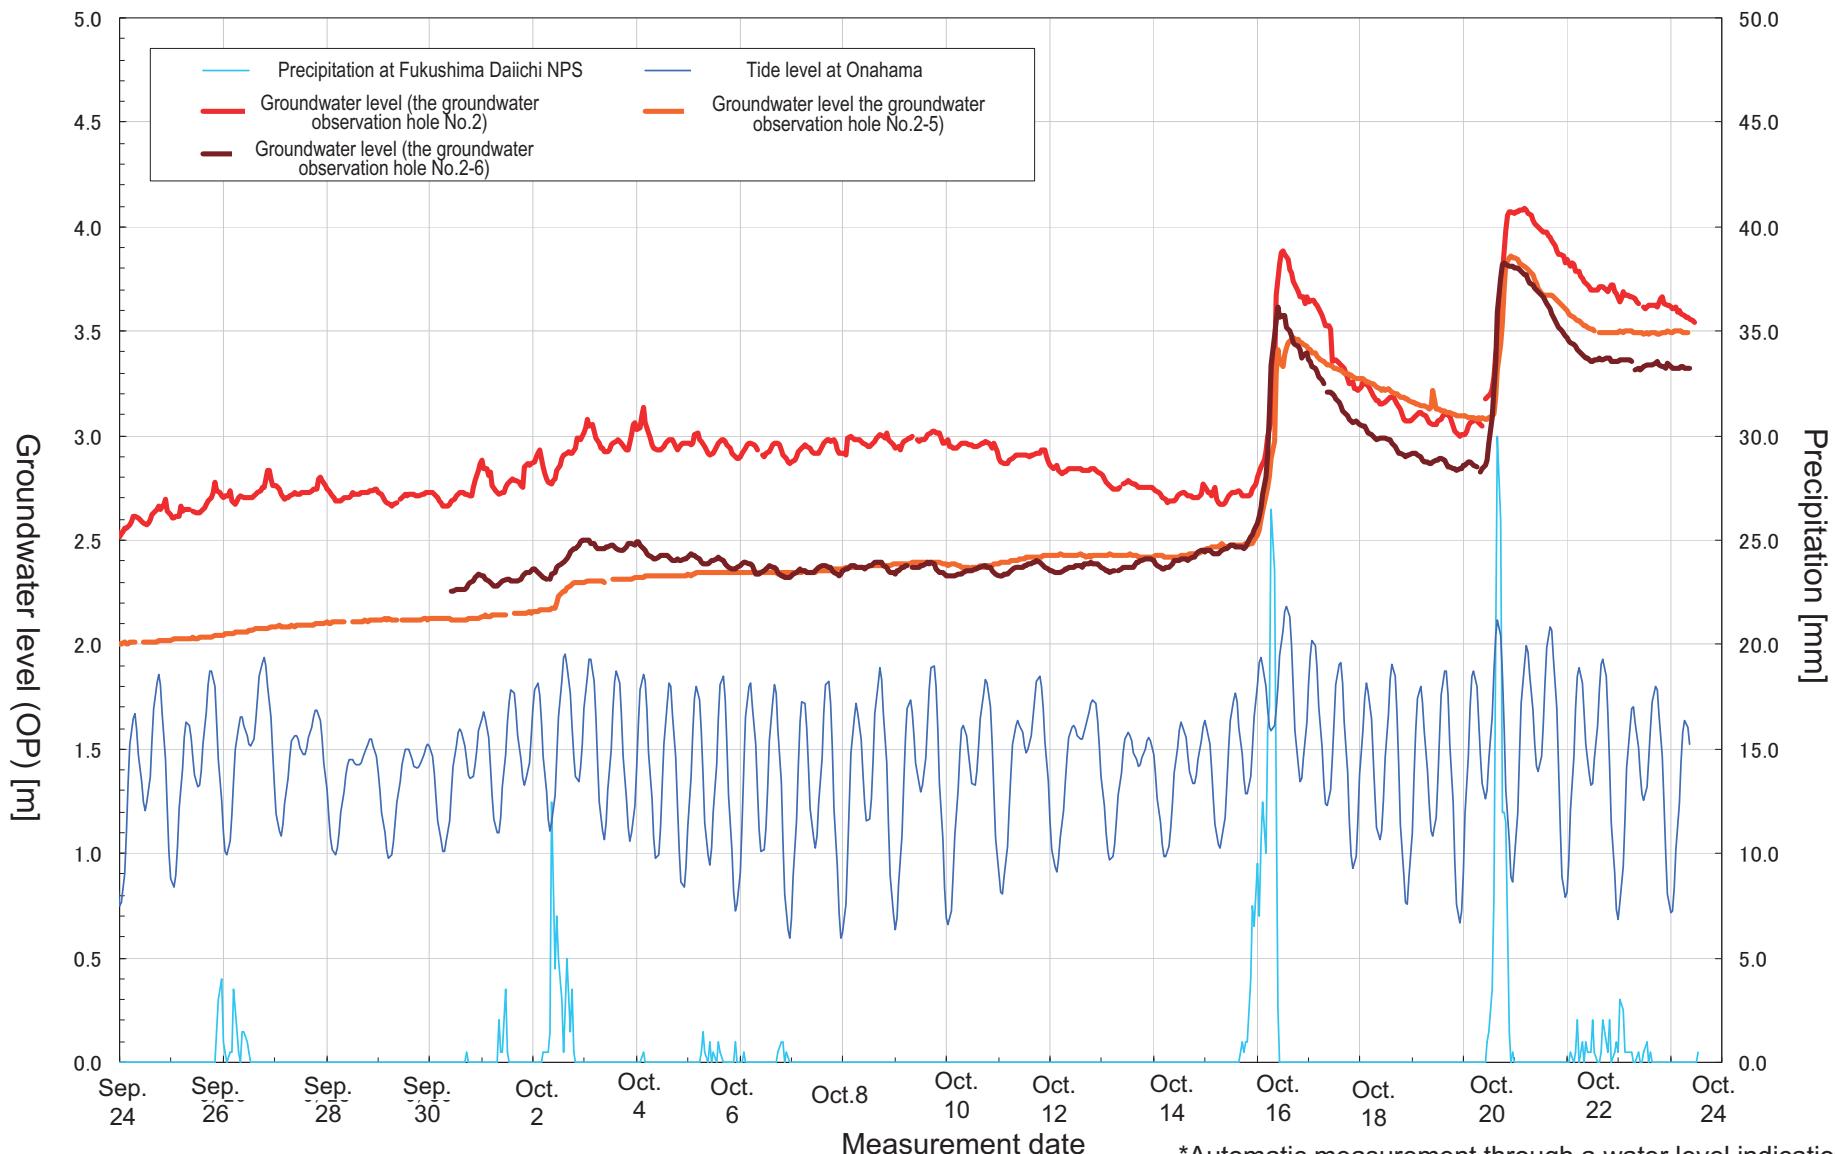


Progress in the ground improvement work between Unit 2 and 3 (As of in the morning on October 24)

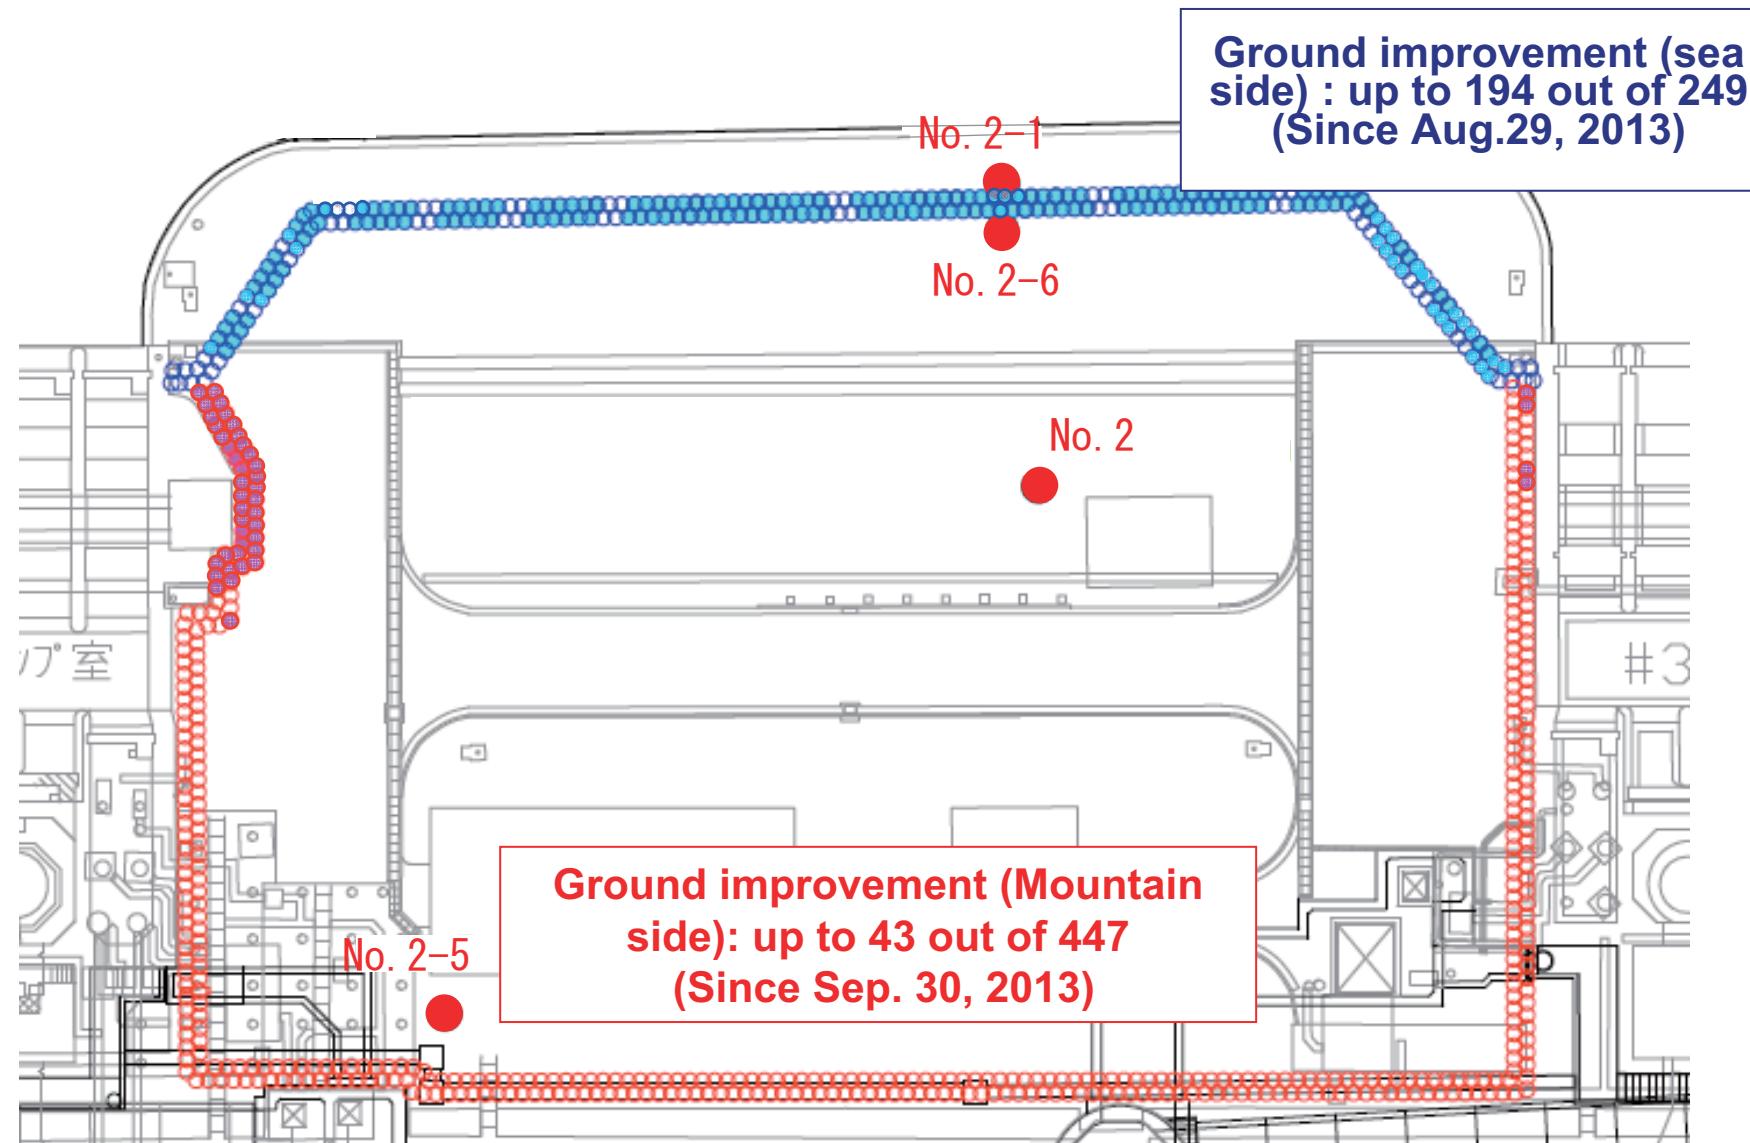


* The work area is subject to change due to the on-site situation.

Movement in groundwater level (Between Unit 3 and 4: From Sep. 24 to Oct. 24)

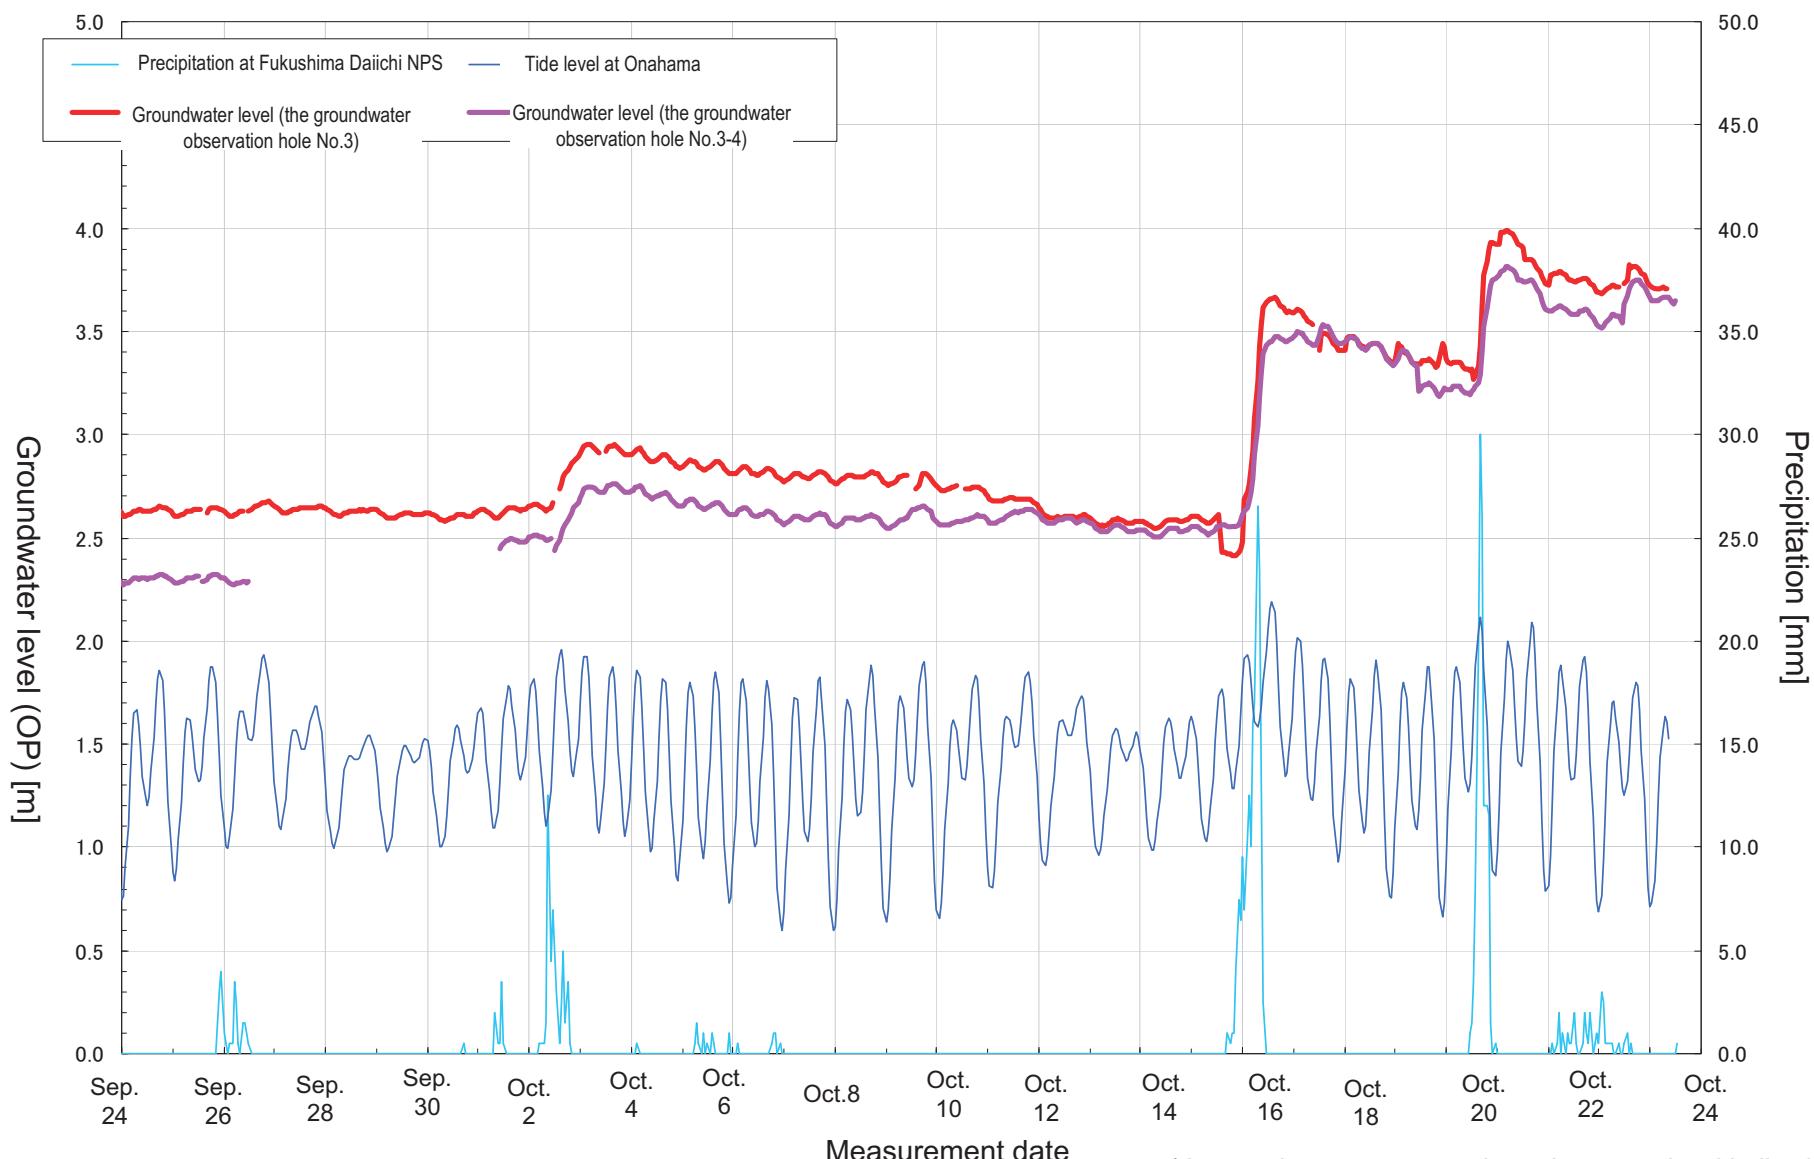

Progress in the ground improvement work between Unit 3 and 4 (As of in the morning on October 24)

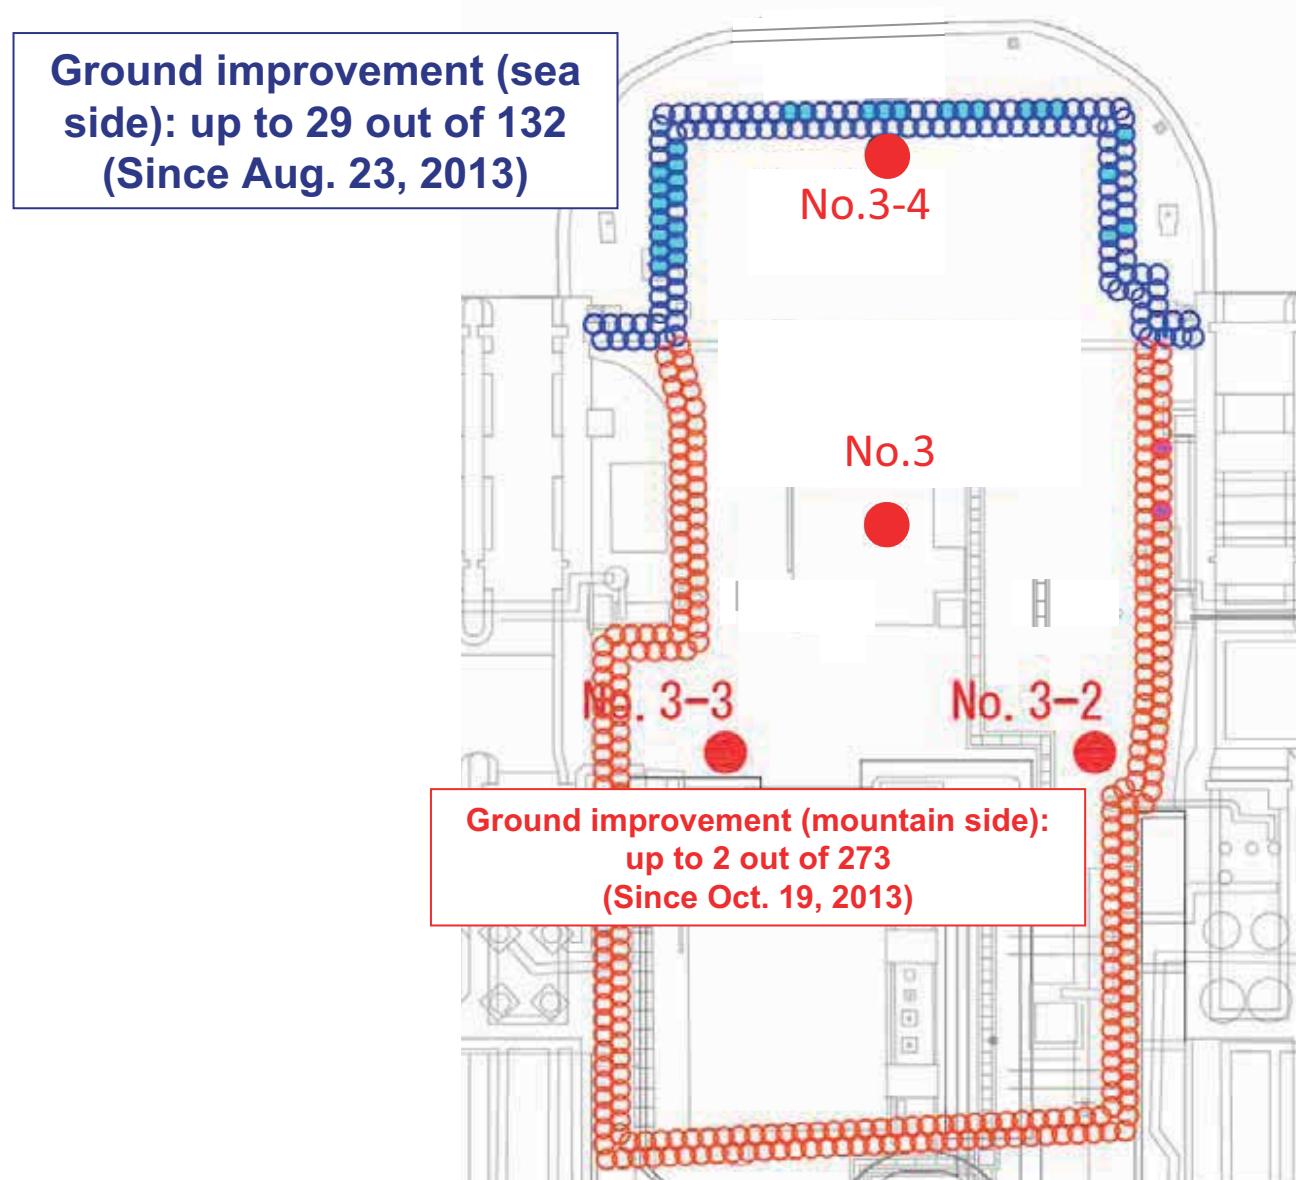

* The work area is subject to change due to the on-site situation.

Groundwater observation hole No.0-1 (Bq/L)

Sampling date	2013/8/8	2013/8/8 Remeasurement	2013/8/10	2013/8/15	2013/8/22	2013/8/29	2013/9/1	2013/9/8	2013/9/15	2013/9/22	2013/9/29	2013/10/6	2013/10/13	2013/10/20
Sampling time	2:15 PM	2:15 PM	9:35 AM	10:52 AM	9:41 AM	9:50 AM	11:03 AM	12:02 PM	9:52 AM	10:25 AM	9:54 AM	9:45 AM	9:50 AM	9:37 AM
Cs-134	0.61		0.66	0.39	ND (0.42)	1.4	0.80	0.92	1.7	2.1	3.0	2.3	2.9	5.1
Cs-137	1.6		1.2	1.1	0.64	3.0	2.1	2.4	4.4	4.6	5.8	5.9	6.7	9.5
Ru-106	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND		ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	210		290	210	300	86	160	79	170	120	170	160	180	130
H-3	23,000	23,000	34,000	35,000	42,000	45,000	38,000	30,000	20,000	19,000	19,000	16,000	19,000	
Sr-90	Under measurement		--	--	--	--	--	--	--	--	--	--	--	--

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.0-2 (Bq/L)

Sampling date	2013/9/2	2013/9/8	2013/9/15	2013/9/22	2013/9/29	2013/10/6	2013/10/13	2013/10/20
Sampling time	9:51 AM	12:35 PM	10:32 AM	11:15 AM	10:52 AM	11:20 AM	11:08 AM	11:04 AM
Cs-134	ND (0.47)	ND (0.46)	ND (0.42)	ND (0.45)	ND (0.39)	ND (0.34)	0.61	ND (0.41)
Cs-137	0.75	0.67	0.93	ND (0.55)	ND (0.46)	0.52	1.6	0.76
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND
All β	ND (24)	ND (17)	19	37	24	28	87	ND (15)
H-3	ND (120)	ND (130)	ND (120)	ND (121)	ND (120)	ND (110)	ND (120)	Under measurement
Sr-90	Under measurement	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1 (Bq/L)

Sampling date	2012/12/8 ²	2013/5/24	2013/5/31	2013/6/7 ①	2013/6/7 ②	2013/6/14 ①	2013/6/14 ②	2013/6/21	2013/6/25	2013/6/28	2013/7/1	2013/7/4	2013/7/8	2013/7/11	2013/7/15	2013/7/19
Sampling time	11:00 AM	4:19 PM	3:01 PM	3:45 PM	3:45 PM	2:29 PM	2:29 PM	9:01 AM	1:39 PM	5:50 PM	3:05 PM	11:50 AM	1:30 PM	12:51 PM	1:00 PM	8:02 AM
Cs-134	ND (0.59)	ND (0.45)	0.53	ND (0.42)	ND (0.40)	ND (0.37)	ND (0.37)	ND (0.36)	ND (0.39)	ND (0.40)	1.1	ND (0.64)	ND (0.50)	ND (0.61)	ND (0.43)	ND (0.48)
Cs-137	ND (0.72)	ND (0.45)	0.57	ND (0.53)	0.49	ND (0.43)	0.51	0.53	ND (0.49)	ND (0.43)	1.5	ND (0.47)	1.0	ND (0.49)	0.73	
Ru-106	ND	26	19	19	21	18	19	16	20	16	ND	24	16	15	18	17
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.50
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	150	1,900	1,300	1,700	1,600	1,200	1,300	1,500	1,400	1,400	1,300	1,500	1,800	1,600	1,500	1,400
H-3	29,000	500,000	460,000	500,000	470,000	450,000	440,000	430,000	450,000	430,000	420,000	430,000	410,000	390,000	400,000	420,000
Sr-90	8.6	1,000	890	1,200	1,200	Under measurement										

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

² As of γ nuclide measurement, the amount is lower than true value since the high BG is in use.

Sampling date	2013/7/22	2013/7/25	2013/7/29	2013/8/1	2013/8/5	2013/8/8	2013/8/12	2013/8/15	2013/8/19	2013/8/22	2013/8/26	2013/8/29	2013/8/30	2013/9/2	2013/9/5	2013/9/9
Sampling time	1:21 PM	1:15 PM	11:50 AM	11:55 AM	12:23 PM	1:29 AM	10:46 AM	12:01 PM	10:21 AM	10:58 AM	10:36 AM	10:15 AM	11:25 AM	10:07 AM	9:40 AM	10:51 AM
Cs-134	ND (0.42)	ND (0.42)	ND (0.46)	ND (0.44)	ND (0.52)	0.52	ND (0.42)	ND (0.54)	3.2	ND (0.57)	ND (0.47)	13	0.98	1.5	2.5	ND (0.40)
Cs-137	ND (0.45)	ND (0.55)	0.55	0.62	1.1	0.50	ND (0.49)	4.3	0.66	0.84	31	2.1	3.5	5.7	0.72	
Ru-106	ND	12	17	14	17	15	12	11	14	7.9	14	17	17	11	12	12
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	1,400	1,400	1,300	1,300	1,400	1,300	1,700	1,700	1,500	1,500	1,500	1,400	1,700	1,300	1,500	650
H-3	430,000	430,000	420,000	440,000	430,000	430,000	380,000	370,000	310,000	430,000	420,000	390,000	390,000	400,000	370,000	350,000
Sr-90	-	-	Under measurement	-	-	-	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1-1 (Bq/L)

Sampling date	2013/6/28	2013/7/1	2013/7/5	2013/7/8
Sampling time	4:40 PM	4:05 PM	11:00 AM	2:35 PM
Cs-134	ND (0.41)	ND (0.44)	ND (0.42)	1.9
Cs-137	ND (0.51)	0.98	0.55	3.6
Ru-106	-	7.8	7.7	7.9
Mn-54	0.52	0.92	1.0	0.78
Co-60	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND
All β	3,000	4,300	3,800	4,400
H-3	430,000	510,000	600,000	630,000
Sr-90	Under measurement	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1-2 (Bq/L)

Sampling date	2013/7/5	2013/7/8	2013/7/8 (Filtration)	2013/7/9	2013/7/9 (Residue)	2013/7/9 (Filtration)	2013/7/11	2013/7/11 (Filtration)	2013/7/15	2013/7/15 (Filtration)	2013/7/16	2013/7/16 (Filtration)	2013/7/22	2013/7/22 (Filtration)	2013/7/25	2013/7/25 (Filtration)
Sampling time	12:10 PM	2:00 PM	2:00 PM	1:00 PM	1:00 PM	1:00 PM	1:25 PM	1:25 PM	1:23 PM	1:23 PM	1:23 PM	1:23 PM	1:47 PM	1:47 PM	2:00 PM	2:00 PM
Cs-134	99	9,000	94	11,000	130	10,000	8,200	98	5,900	ND (21)	5,400	ND (25)	3,500	50	2,600	ND (22)
Cs-137	210	18,000	190	22,000	270	20,000	17,000	150	12,000	ND (21)	11,000	ND (25)	7,300	71	5,400	25
Ru-106	95	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	62	25	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	1.2	3.1	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	35	ND	ND	ND	ND	ND	ND	ND	250	ND	ND	ND	ND	ND	ND	ND
All β	900,000	890,000	920,000	900,000	890,000	890,000	890,000	890,000	880,000	880,000	880,000	880,000	880,000	880,000	880,000	880,000
H-3	380,000	360,000	370,000	370,000	380,000	350,000	350,000	350,000	350,000	350,000	350,000	350,000	350,000	370,000	370,000	370,000
Sr-90	Under measurement	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/8/1	2013/8/1 (Filtration)	2013/8/5	2013/8/5 (Filtration)	2013/8/8	2013/8/8 (Filtration)	2013/8/12	2013/8/12 (Filtration)	2013/8/15	2013/8/15 (Filtration)	2013/8/19	2013/8/19 (Filtration)	2013/8/22	2013/8/22 (Filtration)	
Sampling time	12:25 PM	12:25 PM	12:46 PM	12:46 PM	1:38 PM	1:38 PM	12:27 PM	12:27 PM	1:36 PM	1:35 PM	12:06 PM	12:06 PM	12:33 PM	12:33 PM	
Cs-134	760	ND (26)	350	ND (18)	200	19	180	ND (20)	150	ND (18)	880	53	150	110	
Cs-137	1,600	45	750	ND (22)	400	29	400	ND (23)	360	38	1,900	97	360	230	
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	160	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	110	ND	110	ND	170	ND	130	ND	95	ND	200	ND	ND	ND	ND
All β	870,000	880,000	880,000	880,000	890,000	890,000	880,000	880,000	870,000	870,000	840,000	840,000	840,000	840,000	840,000
H-3	380,000	390,000	370,000	370,000	380,000	300,000	300,000	300,000	180,000	180,000	400,000	400,000	400,000	270,000	270,000
Sr-90	-	-	-	-	Under measurement	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/8/26	2013/8/26 (Filtration)	2013/8/29	2013/8/29 (Filtration)	2013/9/2	2013/9/2 (Filtration)	2013/9/5	2013/9/5 (Filtration)	2013/9/9	2013/9/9 (Filtration)	2013/9/12	2013/9/12 (Filtration)	2013/9/16	2013/9/16 (Filtration)	2013/9/19	2013/9/19 (Filtration)	2013/9/23	2013/9/23 (Filtration)
Sampling time	12:35 PM	12:35 PM	11:42 AM	11:42 AM	11:56 AM	11:56 AM	1:40 PM	1:40 PM	1:37 PM	1:37 PM	9:58 AM	9:58 AM	10:54 AM	10:54 AM	10:26 AM	10:26 AM	10:45 AM	10:45 AM
Cs-134	110	80	120	75	140	66	82	52	54	41	110	35	78	90	23	71	42	
Cs-137	270	170	260	160	300	150	180	100	110	94	270	100	180	200	200	100	170	75
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
All β	760,000	680,000	590,000	590,000	500,000	460,000	430,000	430,000	430,000	430,000	350,000	350,000	350,000	280,000	280,000	280,000	280,000	
H-3	380,000	380,000	350,000	350,000	310,000	280,000	310,000	310,000	310,000	310,000	430,000	430,000	290,000	290,000	290,000	270,000	270,000	
Sr-90	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	

Groundwater observation hole No.1-3 (Bq/L)

Sampling date	2013/9/23	2013/9/23 (Filtration)	2013/9/26	2013/9/26 (Filtration)	2013/9/30	2013/9/30 (Filtration)	2013/10/3	H25.10.3 (Filtration)	2013/10/7
Sampling time	10:45 AM	10:45 AM	11:55 AM	12:35 PM	11:09 AM	11:09 AM	11:05 AM	11:05 AM	12:06 PM
Cs-134	71	42	150	58	520	370	440	330	1,400
Cs-137	170	75	360	140	1,200	800	970	710	2,800
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	280,000	270,000	270,000	270,000	160,000	200,000	200,000	250,000	
H-3	270,000	270,000	270,000	270,000	62,000	57,000	57,000	54,000	
Sr-90	-	-	-	-	-	-	-	-	

Cs-137	1.4	ND (0.54)	0.53	ND (0.58)	ND (0.62)	ND (0.47)	0.75	ND (0.60)	1.0	ND (0.67)	ND (0.76)	ND (0.65)	2.3	2.1	3.3	24
Ru-106	16	14	15	17	11	16	15	11	17	12	11	14	12	5.1	4.6	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	1.4	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	92,000	100,000	120,000	150,000	150,000	150,000	150,000	150,000	150,000	160,000	160,000	120,000	130,000	61,000	33,000	21,000
H-3	290,000	250,000	270,000	260,000	260,000	250,000	250,000	230,000	240,000	210,000	190,000	190,000	220,000	250,000	230,000	200,000
Sr-90	Under measurement	-	-	-	-	-	-	-	Under measurement	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1-4 (Bq/L)

Sampling date	2013/7/8	2013/7/11	2013/7/15	2013/7/18	2013/7/22	2013/7/25	2013/7/29	2013/8/1	2013/8/5	2013/8/8	2013/8/12	2013/8/15	2013/8/19	2013/8/22
Sampling time	3:30 PM	12:25 PM	11:55 AM	12:03 PM	12:18 PM	12:00 PM	10:51 AM	10:43 AM	10:40 AM	11:00 AM	10:21 AM	11:30 AM	9:50 AM	10:20 AM
Cs-134	1.5	0.91	ND (0.41)	0.67	ND (0.43)	0.49	0.48	0.50	ND (0.46)	0.55	ND (0.41)	ND (0.47)	1.1	1.0
Cs-137	3.6	2.0	0.67	1.0	1.1	0.88	1.1	1.4	0.65	1.2	1.3	1.2	2.1	1.8
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	ND	3.1	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	330	250	67	50	110	110	78	130	130	170	150	220	380	240
H-3	69,000	98,000	60,000	42,000	46,000	50,000	51,000	57,000	64,000	76,000	72,000	76,000	75,000	21,000
Sr-90	Under measurement	-	-	-	-	-	-	-	Under measurement	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1-5 (Bq/L)

Sampling date	2013/7/31	2013/8/5	2013/8/6	2013/8/8	2013/8/12	2013/8/15	2013/8/19	2013/8/22	2013/8/26	2013/8/29	2013/9/2	2013/9/5
Sampling time	1:05 PM	11:55 AM	10:38 AM	1:05 PM	12:00 PM	1:02 PM	11:40 AM	12:00 PM	12:00 PM	11:13 AM	11:16 AM	12:58 PM
Cs-134	21	310	260	250	190	150	130	91	53	62	40	50
Cs-137	44	650	540	520	390	320	260	190	110	130	85	110
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	6.7	12	8.9	9.3	ND	ND	ND	ND	ND	ND
All β	1,200	56,000	47,000	52,000	26,000	21,000	13,000	6,200	3,400	2,600	2,000	820
H-3	28,000	56,000	45,000	57,000	70,000	72,000	56,000	28,000	30,000	24,000	23,000	23,000
Sr-90	Under measurement	-	-	-	-	-	-	Under measurement	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1-8 (Bq/L)

Sampling date	2013/8/20	2013/8/26	2013/9/2	2013/9/9	2013/9/16	2013/9/23	2013/9/30	2013/10/7	2013/10/14	2013/10/21
Sampling time	9:40 AM	9:36 AM	9:37 AM	10:15 AM	10:00 AM	9:40 AM	9:00 AM	9:36 AM	9:30 AM	11:00 AM
Cs-134	21	26	30	17	31	20	17	23	24	24
Cs-137	45	58	63	37	67	45	37	49	53	58
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	0.52	ND	ND	0.76	0.46	ND	1.0	0.67	0.64
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	1,100	1,200	1,100	370	2,100	1,900	1,500	100	2,500	3,700
H-3	950	840	1,100	1,200	1,900	2,100	1,700	2,100	2,500	Under measurement
Sr-90	Under measurement	-	-	-	Under measurement	-	-	-	Under measurement	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1-9 (Bq/L)

Sampling date	2013/9/3	2013/9/3 (Filtration)	2013/9/5	2013/9/5 (Filtration)	2013/9/8	2013/9/10	2013/9/12	2013/9/15	2013/9/17	2013/9/19	2013/9/22	2013/9/24	2013/9/26	2013/9/29	2013/10/1	2013/10/3
Sampling time	10:20 AM	10:20 AM	10:20 AM	10:20 AM	8:40 AM	6:20 AM	6:55 AM	6:06 AM	6:30 AM	6:24 AM	6:22 AM	6:16 AM	6:16 AM	6:18 AM	6:23 AM	6:15 AM
Cs-134	170	66	110	41	59	33	8.7	45	29	19	17	10	11	11	12	9.5
Cs-137	380	120	240	110	140	77	20	100	69	45	40	23	23	25	28	25
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	470	ND	ND	540	ND	600	200	270	350	260	240	230	160	310	250	140
H-3	670	ND	580	ND	560	380	650	680	570	650	600	680	690	550	770	690
Sr-90	Under measurement	-	-	-	-	-	-	-	-	-	-	-	-	-	-	Under measurement

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1-10 (Bq/L)

Sampling date	2013/10/6	2013/10/8	2013/10/10	2013/10/13	2013/10/15	2013/10/17	2013/10/20	2013/10/22
Sampling time	6:22 AM	6:30 AM	6:25 AM	5:58 AM	6:13 AM	6:39 AM	6:18 AM	6:29 AM
Cs-134	7.9	6.7	9.2	10	5.4	36	5.7	4.9
Cs-137	19	16	21	24	13	79	13	14
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND
All β	110	89	71	120	120	300	88	69
H-3	460	630	620	670	590	270	670	Under measurement
Sr-90	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/9/13	2013/9/16	2013/9/19	2013/9/23	2013/9/26	2013/9/30	2013/10/3	2013/10/7	2013/10/10	2013/10/14	2013/10/17	2013/10/21
Sampling time	10:35 AM	9:35 AM	9:35 AM	10:10 AM	9:25 AM	9:23 AM	9:22 AM	10:02 AM	9:34 AM	9:57 AM	9:30 AM	11:57 AM
Cs-134	ND (0.36)	ND (0.40)	ND (0.48)	0.44	0.45	ND (0.48)	0.43	0.55	0.67	0.92	0.56	ND (0.41)
Cs-137	0.48	ND (0.58)	0.74	1.2	1.1	1.0	1.4	0.82	2.00	1.8	1.3	1.2

Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	43	42	57	29	36	32	72	31	46	49	64	29
H-3	85,000	72,000	68,000	76,000	55,000	43,000	48,000	36,000	32,000	33,000	26,000	Under measurement
Sr-90	Under measurement	-	-	-	-	-	-	-	-	Under measurement	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1-12 (Bq/L)

Sampling date	2013/10/21
Sampling time	11:22 AM
Cs-134	74
Cs-137	170
Ru-106	ND
Mn-54	ND
Co-60	ND
Sb-125	61
All β	730
H-3	350,000
Sr-90	Under measurement

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.1-16 (Bq/L)

Sampling date	2013/9/26	2013/9/30	2013/10/3	2013/10/7	2013/10/10	2013/10/14	2013/10/17	2013/10/21
Sampling time	11:30 AM	10:38 AM	10:05 AM	11:02 AM	10:24 AM	12:43 PM	9:50 AM	11:54 AM
Cs-134	ND (0.99)	ND (0.18)	1.5	1.4	ND (1.0)	ND (0.96)	ND (0.98)	ND (0.71)
Cs-137	2.1	2.3	2.9	2.6	3.4	2.1	1.8	1.2
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	0.54	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND
All β	400,000	450,000	680,000	700,000	740,000	880,000	830,000	390,000
H-3	43,000	37,000	34,000	36,000	32,000	30,000	21,000	Under measurement
Sr-90	Under measurement	-	-	-	-	Under measurement	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater pumped up from the well point (Bq/L)

Sampling date	2013/8/19	2013/8/26	2013/9/2	2013/9/9	2013/9/16	2013/9/23	2013/9/30	2013/10/7	2013/10/14	2013/10/21
Sampling time	11:20 AM	10:30 AM	9:35 AM	1:30 PM	9:45 AM	9:30 AM	8:55 AM	9:35 AM	9:15 AM	10:45 AM
Cs-134	1.5	1.0	ND (1.6)	ND (0.63)	15	110	30	20	0.96	5.0
Cs-137	3.4	2.1	ND (1.6)	ND (0.68)	32	250	69.0	43	2.7	13
Ru-106	17	9.7	25	9.0	12	ND	ND	ND	12	8.2
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	190,000	5,900	360,000	89,000	450,000	700,000	490,000	610,000	250,000	330,000
H-3	460,000	260,000	380,000	220,000	290,000	340,000	37,000	200,000	250,000	Under measurement
Sr-90	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.2 (Bq/L)

Sampling date	2012/12/8 ^②	2013/5/24	2013/5/31	2013/6/7 ①	2013/6/7 ②	2013/6/21	2013/6/26	2013/7/1	2013/7/4	2013/7/8	2013/7/9	2013/7/11	2013/7/15	2013/7/18	2013/7/22	2013/7/25
Sampling time	11:00 AM	4:12 PM	3:16 PM	4:05 PM	4:05 PM	5:44 PM	2:30 PM	4:55 PM	1:05 PM	1:00 PM	12:25 PM	11:30 AM	10:50 AM	11:22 AM	11:37 AM	11:04 AM
Cs-134	ND (0.61)	ND (0.37)	ND (0.41)	0.47	ND (0.37)	ND (0.32)	ND (0.40)	0.48	ND (0.39)	ND (0.49)	0.50	ND (0.47)	ND (0.37)	ND (0.36)	ND (0.44)	ND (0.39)
Cs-137	ND (0.81)	ND (0.41)	0.95	0.73	ND (0.48)	ND (0.37)	ND (0.48)	0.66	ND (0.46)	0.74	0.74	1.2	ND (0.44)	0.50	ND (0.53)	0.46
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	55	53	76	ND (18)	ND (18)	53	170	260	93	1,700	910	1,400	49	1,100	430	330
H-3	410	380	340	390	340	560	850	740	530	730	670	410	530	540	710	500
Sr-90	8.2	28	54	5.2	5.1	Under measurement	-	-	-	-	-	-	-	-	-	-

*1 "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

*2 As of γ nuclide measurement, the amount is lower than true value since the high BG is in use.

Sampling date	2013/7/29	2013/8/1	2013/8/5	2013/8/8	2013/8/12	2013/8/15	2013/8/19	2013/8/22	2013/8/26	2013/8/29	2013/9/1	2013/9/4	2013/9/8	2013/9/11	2013/9/15	2013/9/18
Sampling time	11:30 AM	12:05 PM	11:18 AM	11:36 AM	11:10 AM	11:32 AM	9:57 AM	9:25 AM	10:15 AM	10:10 AM	10:00 AM	10:10 AM	11:50 AM	9:27 AM	11:05 AM	9:24 AM
Cs-134	ND (0.40)	ND (0.35)	ND (0.42)	ND (0.29)	ND (0.38)	ND (0.46)	ND (0.42)	ND (0.41)	ND (0.43)	ND (0.41)	ND (0.44)	ND (0.47)	0.36	ND (0.36)	ND (0.37)	ND (0.44)
Cs-137	ND (0.47)	1.2	ND (0.53)	ND (0.49)	ND (0.48)	ND (0.53)	0.68	0.74	0.66	ND (0.54)	ND (0.55)	0.53	0.70	0.64	0.85	ND (0.44)
Ru-106	ND	ND	ND	ND	ND											
Mn-54	ND	ND	ND	ND	ND											
Co-60	ND	ND	ND	ND	ND											
Sb-125	ND	ND	ND	ND	ND											
All β	400	210	450	390	210	200	420	270	86	140	230	300	220	96	140	260
H-3	660	640	700	670	590	550	730	450	440	590	670	680	540	520	590	800
Sr-90	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.2-1 (Bq/L)

Sampling date	2013/9/22	2013/9/25	2013/9/29	2013/10/2	2013/10/6	2013/10/9	2013/10/13	2013/10/17	2013/10/20	2013/10/23
Sampling time	9:34 AM	9:31 AM	9:33 AM	9:17 AM	9:20 AM	9:40 AM	9:21 AM	10:39 AM	9:45 AM	10:30 AM
Cs-134	ND (0.48)	ND (0.42)	0.49	ND (0.44)	ND (0.46)	ND (0.35)	ND (0.42)	ND (0.41)	ND (0.36)	ND (0.39)
Cs-137	0.67	0.52	0.94	ND (0.45)	ND (0.53)	ND (0.46)	ND (0.47)	ND (0.51)	ND (0.50)	0.57
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	380	480	290	180	140	130	180	340	450	390
H-3	680	720	740	600	670	800	800	820	770	Under measurement
Sr-90	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.2-5 (Bq/L)

Sampling date	2013/9/29 ¹	2013/9/29 ¹
Sampling time	9:50 AM	9:50 AM
Cs-134	3.1	3.7
Cs-137	6.9	10.00
Ru-106	ND	ND
Mn-54	0.62	0.77
Co-60	ND	ND
Sb-125	26	18
All β	32,000	46,000
H-3	-	1,500.00
Sr-90	-	Under measurement

¹We provided with the measurement result of γ and all β before, but we reanalyzed the sampling. As for the data at No.2-5, it is only for reference because too small an amount of water hindered the ordinary analysis. * "ND" indicates that the measurement result is below the detection limit.

Groundwater observation hole No.2-6 (Bq/L)

Sampling date	2013/9/20	2013/9/22	2013/9/25	2013/9/29	2013/10/2	2013/10/6	2013/10/9	2013/10/13	2013/10/17	2013/10/20	2013/10/23
Sampling time	10:53 AM	10:51 AM	12:13 PM	10:30 AM	10:01 AM	9:50 AM	10:15 AM	10:00 AM	11:08 AM	10:25 AM	9:55 AM
Cs-134	ND (0.39)	0.42	ND (0.44)	ND (0.41)	ND (0.44)	ND (0.38)	ND (0.48)	ND (0.42)	ND (0.43)	ND (0.44)	ND (0.40)
Cs-137	ND (0.45)	0.57	ND (0.56)	0.57	ND (0.58)	ND (0.46)	ND (0.58)	0.61	ND (0.48)	0.60	ND (0.52)
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
All β	ND (18)	ND (17)	ND (18)	ND (18)	ND (19)	24	37	50	120	270	530
H-3	200	210	360	610	840	910	960	1,100	1,100	930	Under measurement
Sr-90	Under measurement	-	-	-	-	-	-	-	-	-	-

¹We provided with the measurement result of γ and all β before, but we reanalyzed the sampling. As for the data at No.2-5, it is only for reference because too small an amount of water hindered the ordinary analysis. * "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.3 (Bq/L)

Sampling date	H24.12.12 ²	2013/5/24	2013/5/31	2013/6/7 (1)	2013/6/7 (2)	2013/6/21	2013/6/26	2013/7/4	2013/7/11	2013/7/18	2013/7/25	2013/8/1	2013/8/2	2013/8/8	2013/9/5
Sampling time	11:00 AM	4:52 PM	3:32 PM	3:58 PM	3:58 PM	5:01 PM	3:50 PM	2:00 PM	10:55 AM	10:45 AM	1:30 PM	12:59 PM	2:25 PM	2:19 PM	9:20 AM
Cs-134	ND (0.60)	0.87	1.6	0.9	0.5	1.7	0.96	1.5	1.9	1.2	3.5	1.8	2.4	2.2	3.0
Cs-137	ND (0.79)	1.4	2.7	2.0	1.6	2.9	2.9	2.8	4.8	3.1	3.9	4.2	4.0	5.9	3.0
Ru-106	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	1.1
All β	41	18	ND (17)	ND (18)	ND (18)	ND (17)	ND (21)	ND (18)	1,400	76	ND (17)	ND (17)	ND (18)	ND (18)	ND (24)
H-3	3,200	2,200	1,800	1,800	1,800	1,600	1,800	1,500	1,700	1,700	1,700	1,400	1,500	1,500	1,100
Sr-90	8.3	ND (1.0)	0.25	ND (0.24)	ND (0.27)	Under measurement	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

²As of γ nuclide measurement, the amount is lower than true value since the high BG is in use.

Groundwater observation hole No.3-1 (Bq/L)

Sampling date	2013/7/23	2013/7/25	2013/8/1	2013/8/2	2013/8/8	2013/8/16	2013/8/22
Sampling time	11:10 AM	3:15 PM	1:38 PM	3:45 PM	3:04 PM	12:21 PM	11:55 AM
Cs-134	1.1	1.2	1.1	1.0	1.2	0.67	0.68
Cs-137	2.2	2.2	2.6	2.3	2.0	1.8	1.2
Ru-106	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND
All β	ND (19)	ND (18)	180	ND (18)	25	ND (20)	55
H-3	290	310	460	370	430	370	240
Sr-90	Under measurement	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Groundwater observation hole No.3-4 (Bq/L)

Sampling date	2013/9/12	2013/9/18	2013/9/25	2013/10/2	2013/10/9	H25.10.17	H25.10.23
Sampling time	1:20 PM	10:16 AM	1:03 PM	11:12 AM	10:55 AM	11:40 AM	11:35 AM
Cs-134	0.52	0.72	1.0	0.68	0.66	0.96	1.0
Cs-137	1.3	1.8	1.1	1.3	1.9	2.2	2.3
Ru-106	ND	ND	ND	ND	ND	ND	ND
Mn-54	ND	ND	ND	ND	ND	ND	ND
Co-60	ND	ND	ND	ND	ND	ND	ND
Sb-125	ND	ND	ND	ND	ND	ND	ND
All β	ND (17)	ND (18)	ND (18)	ND (19)	ND (18)	ND (15)	ND (17)
H-3	170	130	160	ND (120)	ND (130)	Under measurement	-
Sr-90	Under measurement	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

North side of Unit 5,6 discharge channel (Bq/L)

Sampling date	2013/6/21	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/26	2013/9/2	2013/9/9	2013/9/16	2013/9/23	2013/9/30	
Sampling time	7:25 AM	11:25 AM	6:55 AM	6:15 AM	6:05 AM	5:50 AM	5:55 AM	6:55 AM	6:30 AM	6:10 AM	6:00 AM	6:00 AM	6:05 AM	5:55 AM	5:58 AM	6:05 AM	
Cs-134	1.8	ND (1.9)	ND (1.2)	1.4	ND (1.2)	ND (1.3)	ND (0.92)	ND (1.4)	ND (0.93)	ND (1.4)	ND (1.2)	ND (1.1)	ND (1.1)	ND (1.3)	ND (0.88)	ND (1.8)	
Cs-137	2.1	3.3	1.2	2.5	1.5	2.5	ND (1.4)	ND (1.5)	1.4	ND (1.5)	ND (1.7)	ND (1.4)	ND (1.4)	ND (1.1)	2.3	ND (1.1)	ND (1.1)
All β	-	ND (22)	ND (17)	ND (19)	ND (22)	ND (23)	ND (19)	ND (22)	ND (19)	ND (18)	ND (19)	ND (16)	ND (16)	ND (15)	ND (17)	ND (15)	
H-3	-	8.6	4.9	3.7	5.5	ND (3.2)	ND (2.9)	3.7	4.7	5.4	8.3	ND (1.8)	ND (1.8)	2.7	ND (1.8)	ND (1.7)	
Sr-90	-	5.8	-	-	-	Under measurement	-	-	Under measurement	-	-	-	-	Under measurement	-	-	

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

<Continued from the previous page>

Sampling date	2013/10/7	2013/10/14	2013/10/21
Sampling time	5:55 AM	5:50 AM	5:55 AM
Cs-134	1.3	ND (1.0)	ND (1.0)
Cs-137	1.7	1.5	ND (1.2)

All β	ND (17)	ND (16)	ND (16)
H-3	7.3	2.4	Under measurement
Sr-90	—	Under measurement	—

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

In front of Unit 6 water intake channel, seawater (Bq/L)

Sampling date	2013/6/25	2013/7/2	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/26	2013/9/2	2013/9/9	2013/9/16	2013/9/23	2013/9/30	2013/10/7
Sampling time	7:15 AM	8:25 AM	6:30 AM	6:15 AM	5:50 AM	6:15 AM	6:10 AM	6:20 AM	6:30 AM	5:50 AM	5:50 AM	5:55 AM	5:40 AM	6:25 AM	6:00 AM	6:00 AM
Cs-134	ND (3.3)	ND (1.7)	ND (2.2)	ND (1.6)	ND (1.4)	ND (2.4)	ND (2.0)	ND (2.4)	2.4	ND (2.0)	ND (3.2)	ND (2.3)	ND (2.4)	ND (1.7)	ND (1.8)	ND (3.3)
Cs-137	ND (2.1)	2.6	ND (1.9)	3.1	ND (1.3)	ND (2.3)	ND (2.7)	ND (2.5)	4.7	ND (2.5)	2.4	ND (2.7)	ND (2.4)	ND (1.9)	ND (2.4)	ND (2.4)
All β	ND (18)	20	ND (17)	ND (22)	ND (21)	ND (19)	ND (22)	ND (19)	46	ND (21)	ND (19)	ND (17)	ND (19)	21	ND (19)	22
H-3	6.0	8.2	ND (3.1)	11	ND (3.2)	ND (2.9)	4.1	8.8	24	5.9	8.6	4.0	18	23	11	14
Sr-90	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

<Continued from the previous page

Sampling date	2013/10/14	2013/10/21
Sampling time	5:40 AM	5:45 AM
Cs-134	ND (3.3)	ND (1.7)
Cs-137	ND (2.5)	ND (2.1)
All β	19	17
H-3	5.0	Under measurement
Sr-90	—	—

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

In front of shallow draft quay, seawater (Bq/L)

Sampling date	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/26	2013/9/2	2013/9/9	2013/9/16	2013/9/23	2013/9/30	2013/10/7
Sampling time	6:06 AM	6:03 AM	5:31 AM	5:30 AM	5:25 AM	5:34 AM	6:00 AM	6:10 AM	5:53 AM	5:48 AM	5:49 AM	5:50 AM	5:51 AM	6:00 AM	6:35 AM	5:43 AM
Cs-134	ND (1.8)	1.9	ND (1.8)	ND (2.3)	ND (1.9)	ND (1.7)	5.3	3.5	3.3	ND (2.0)	ND (1.9)	2.3	ND (2.5)	1.7	2.9	ND (2.1)
Cs-137	2.3	5.6	5.1	5.7	ND (2.2)	2.2	8.6	7.9	7.4	ND (2.2)	ND (2.5)	4.5	3.7	2.7	11	5.7
All β	ND (18)	40	19	35	ND (21)	ND (19)	31	25	28	ND (19)	ND (17)	24	21	53	29	
H-3	340	ND (120)	ND (120)	ND (120)	ND (120)	ND (120)	ND (130)	ND (120)	ND (120)	ND (120)	ND (130)	ND (110)	ND (110)	ND (120)	Under measurement	ND (120)
Sr-90	7.4	—	—	—	Under measurement	—	—	—	Under measurement	—	—	—	Under measurement	—	—	—

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/10/9	2013/10/10	2013/10/11	2013/10/12	2013/10/13	2013/10/14	2013/10/15	2013/10/17	2013/10/21
Sampling time	6:19 AM	6:06 AM	1:30 PM	6:02 AM	5:44 AM	5:48 AM	6:00 AM	6:10 AM	5:47 AM
Cs-134	ND (2.3)	4.3	4.5	2.8	ND (2.3)	2.7	2.3	2.8	2.4
Cs-137	8.5	6.7	8.3	7.4	3.9	5.5	6.0	6.7	7.2
All β	25	26	ND (21)	ND (19)	ND (19)	22	ND (19)	25	ND (17)
H-3	ND (110)	ND (120)	Under measurement						
Sr-90	—	—	—	—	—	—	—	—	—

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

North side of Unit 1-4 water intake channel, seawater (Bq/L)

Sampling date	2013/1/14	2013/2/11	2013/3/11	2013/4/15	2013/5/13	2013/6/10	2013/6/21	2013/6/24	2013/6/26	2013/6/28	2013/7/1	2013/7/3	2013/7/5	2013/7/7	2013/7/9	2013/7/11
Sampling time	7:00 AM	6:32 AM	6:27 AM	6:12 AM	5:59 AM	6:01 AM	6:18 AM	5:50 PM	6:13 AM	6:27 AM	6:26 AM	6:08 AM	6:17 AM	6:11 AM	6:09 AM	6:46 AM
Cs-134	3.5	3.7	31	ND (2.5)	9.2	7.3	12	-	18	15	13	13	6.3	8.0	11	12
Cs-137	5.7	10	56	6.0	16	14	28	-	28	33	28	23	17	18	24	29
All β	170	260	230	140	490	290	310	-	260	230	420	310	130	160	230	220
H-3	110	170	120	110	290	500	1,100	1,500	760	760	2,200	2,300	490	760	930	940
Sr-90	-	-	-	-	-	-	Under measurement	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/7/14	2013/7/16	2013/7/18	2013/7/21	2013/7/23	2013/7/25	2013/7/28	2013/7/30	2013/8/1	2013/8/4	2013/8/6	2013/8/8	2013/8/11	2013/8/13	2013/8/15	2013/8/18
Sampling time	6:11 AM	6:08 AM	6:06 AM	5:51 AM	6:23 AM	6:11 AM	6:13 AM	6:04 AM	6:23 AM	6:13 AM	6:05 AM	6:02 AM	6:04 AM	6:11 AM	6:15 AM	6:05 AM
Cs-134	14	19	14	16	18	18	24	21	19	14	13	17	27	34	32	18
Cs-137	32	43	35	29	40	32	46	49	36	34	32	46	55	81	77	44
All β	330	500	380	250	240	470	660	480	590	230	410	610	1,000	930	1,100	760
H-3	2,200	2,300	1,900	1,100	990	1,300	3,100	2,200	2,400	1,300	2,000	3,800	3,700	4,700	3,200	
Sr-90	-	-	-	-	-	Under measurement	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/8/20	2013/8/22	2013/8/25	2013/8/27	2013/8/29	2013/9/1	2013/9/3	2013/9/5	2013/9/8	2013/9/10	2013/9/12	2013/9/15	2013/9/17	2013/9/19	2013/9/22	2013/9/24
Sampling time	6:33 AM	6:09 AM	5:58 AM	6:07 AM	6:13 AM	6:05 AM	6:03 AM	6:02 AM	5:58 AM	6:06 AM	6:32 AM	5:56 AM	6:16 AM	6:06 AM	6:09 AM	6:02 AM
Cs-134	22	24	33	33	35	28	28	28	39	54	33	27	23	28	46	16
Cs-137	47	51	73	78	78	62	56	61	97	110	65	66	46	62	94	41
All β	550	620	900	640	830	500	520	580	880	880	690	400	250	320	810	280
H-3	2,000	2,000	2,900	2,000	4,200	2,000	1,500	1,700	2,800	3,400	2,800	1,300	1,000	1,100	3,000	Under measurement
Sr-90	-	Under measurement	-	-	-	-	-	-	-	-	-	-	-	-	Under measurement	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/9/26	2013/9/29	2013/10/1	2013/10/3	2013/10/6	2013/10/8	2013/10/10	2013/10/13	2013/10/15	2013/10/17	2013/10/20	2013/10/22
Sampling time	6:08 AM	6:08 AM	6:13 AM	6:03 AM	6:06 AM	6:20 AM	6:10 AM	5:48 AM	6:05 AM	6:18 AM	6:02 AM	6:20 AM
Cs-134	26	26	20	21	29	32	89	59	32	33	36	27
Cs-137	54	60	55	51	63	74	190	140	72	72	65	58
All β	370	390	410	340	450	690	740	700	410	290	590	550
H-3	1,200	1,700	1,300	930	1,800	2,500	2,400	2,700	1,600	740	1,600	Under measurement
Sr-90	-	-	-	-	-	-	-	-	-	-	Under measurement	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/6/27	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/26	2013/9/2	2013/9/9	2013/9/16	2013/9/23	2013/9/30	2013/10/7
Sampling time	9:50 AM	6:50 AM	6:17 AM	6:12 AM	6:14 AM	6:15 AM	6:42 AM	6:58 AM	6:43 AM	6:28 AM	6:17 AM	6:31 AM	6:25 AM	6:38 AM	6:35 AM	6:15 AM
Cs-134	6.1	3.3	ND (1.4)	7.7	ND (1.8)	ND (2.5)	7.9	16	8.0	ND (2.1)	4.8	12	6.9	6.2	2.9	14
Cs-137	13	8.2	ND (1.7)	18	ND (1.8)	ND (1.9)	15	33	19	ND (2.2)	11	19	16	19	11	28
All β	200	99	22	250	ND (21)	21	190	320	280	29	180	250	130	110	53	230
H-3	180	140	ND (120)	460	ND (120)	ND (120)	200	370	300	ND (120)	510	240	130	230	150	390
Sr-90	-	Under measurement	-	-	-	Under measurement	-	-	-	Under measurement	-	-	-	Under measurement	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Unit 1 screen (inside the silt fence), seawater (Bq/L)

Sampling date	2013/6/21	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/26	2013/9/2	2013/9/9	2013/9/16	2013/9/23	2013/9/30
Sampling time	6:23 AM	6:18 AM	6:13 AM	5:45 AM	5:43 AM	5:38 AM	5:44 AM	6:10 AM	6:20 AM	6:09 AM	5:58 AM	5:57 AM	6:01 AM	6:00 AM	6:10 AM	6:02 AM
Cs-134	6.9	8.9	5.4	3.4	17	4.8	16	12	24	24	23	24	31	21	31	23
Cs-137	15	20	13	12	37	8.4	34	28	51	41	50	50	68	44	65	49
All β	160	170	140	89	320	79	330	260	700	540	530	540	550	230	440	330
H-3	480	530	420	180	1,300	320	1,500	1,200	2,500	1,800	1,400	1,400	1,400	510	1,400	1,200
Sr-90	-	Under measurement	-	-	-	Under measurement	-	-	Under measurement	-	-	-	-	Under measurement	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Continued from the previous page

Sampling date	2013/10/7	2013/10/9	2013/10/10	2013/10/14	2013/10/21
Sampling time	5:52 AM	6:26 AM	6:15 AM	5:59 AM	5:55 AM
Cs-134	30	51	73	47	29
Cs-137	67	110	170	97	64
All β	590	690	710	620	470
H-3	2,000	1,300	1,500	1,500	Under measurement
Sr-90	—	—	—	Under measurement	—

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Between the water intake channel of Unit 1 and Unit 2, seawater (Surface layer) (Bq/L)

Sampling date	2013/6/14	2013/6/21	2013/6/24	2013/6/26 Surface layer	2013/6/28 Surface layer	2013/7/1 Surface layer	2013/7/3 Surface layer	2013/7/5 Surface layer	2013/7/7 Surface layer	2013/7/9 Surface layer	2013/7/11 Surface layer	2013/7/14 Surface layer	2013/7/16 Surface layer	2013/7/18 Surface layer	2013/7/21 Surface layer	2013/7/23 Surface layer
Sampling time	1:20 PM	11:00 AM	6:00 PM	4:55 PM	11:34 AM	6:04 AM	6:15 AM	6:25 AM	6:22 AM	6:18 AM	6:58 AM	6:20 AM	6:16 AM	6:14 AM	5:59 AM	6:33 AM
Cs-134	-	9.4	-	6.2	8.5	4.9	5.3	5.6	6.8	ND (2.1)	5.6	7.9	11	9.5	3.3	15
Cs-137	-	19	-	11	19	11	9.3	12	15	3.4	13	20	25	23	8.5	27
All β	-	330	-	260	180	200	130	150	180	65	110	200	310	320	96	120
H-3	600	910	420	200	230	170	230	330	570	170	ND (120)	560	800	420	390	580
Sr-90	-	Under measurement	-	-	-	-	-	-	-	-	-	-	-	-	-	Under measurement

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/7/25 Surface layer	2013/7/28 Surface layer	2013/7/30 Surface layer	2013/8/1 Surface layer	2013/8/4 Surface layer	2013/8/6 Surface layer	2013/8/8 Surface layer	2013/8/11 Surface layer	2013/8/13 Surface layer	2013/8/15 Surface layer	2013/8/18 Surface layer	2013/8/20 Surface layer	2013/8/22 Surface layer	2013/8/25 Surface layer	2013/8/27 Surface layer	2013/8/29 Surface layer
Sampling time	6:26 AM	6:22 AM	6:13 AM	6:34 AM	6:25 AM	6:13 AM	6:08 AM	6:15 AM	6:19 AM	6:27 AM	6:13 AM	6:41 AM	6:31 AM	6:12 AM	6:15 AM	6:25 AM
Cs-134	14	15	17	13	11	19	18	27	15	25	21	16	20	17	26	26
Cs-137	27	38	35	28	21	36	37	56	31	54	43	37	39	45	64	57
All β	290	330	340	320	230	360	390	600	390	740	380	310	540	440	500	500
H-3	880	1,800	1,700	1,300	1,100	1,400	1,500	2,300	890	2,600	2,000	1,300	1,300	940	1,400	1,400
Sr-90	-	-	-	-	-	-	-	-	-	-	-	-	Under measurement	-	-	-

Sampling date	2013/9/1 Surface layer	2013/9/3 Surface layer	2013/9/5 Surface layer	2013/9/8 Surface layer	2013/9/10 Surface layer	2013/9/12 Surface layer	2013/9/15 Surface layer	2013/9/17 Surface layer	2013/9/19 Surface layer	2013/9/22 Surface layer	2013/9/24 Surface layer	2013/9/26 Surface layer	2013/9/29 Surface layer	2013/10/01 Surface layer	2013/10/03 Surface layer	2013/10/06 Surface layer
Sampling time	6:12 AM	6:11 AM	6:15 AM	6:05 AM	6:16 AM	6:50 AM	6:02 AM	6:35 AM	6:14	6:18	6:14	6:14 AM	6:15 AM	6:21 AM	6:10 AM	6:25 AM
Cs-134	23	16	17	30	39	24	22	21	22	28	17	17	24	22	19	18
Cs-137	40	39	47	67	80	45	47	42	45	59	38	42	53	45	43	47
All β	370	420	390	580	690	360	320	220	360	480	360	300	360	310	320	330
H-3	1,600	890	1,200	1,700	1,900	1,500	840	720	1,100	1,500	860	860	1,200	940	870	1,100
Sr-90	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

<Continued from the previous page>

Sampling date	2013/10/08 Surface layer	2013/10/10 Surface layer	2013/10/13 Surface layer	2013/10/15 Surface layer	2013/10/17 Surface layer	2013/10/20 Surface layer	2013/10/22 Surface layer
Sampling time	6:26 AM	6:18 AM	5:54 AM	6:10 AM	6:33 AM	6:08 AM	6:27 AM
Cs-134	30	87	45	33	34	20	23
Cs-137	65	200	100	74	70	50	53
All β	530	600	740	450	280	570	480
H-3	1,600	1,400	2,600	920	610	1,300	Under measurement
Sr-90	—	—	—	—	—	Under measurement	—

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Between the water intake channel of Unit 1 and Unit 2, seawater (Lower layer) (Bq/L)

Sampling date	2013/6/26 Lower layer	2013/6/28 Lower layer	2013/7/1 Lower layer	2013/7/3 Lower layer	2013/7/5 Lower layer	2013/7/7 Lower layer	2013/7/9 Lower layer	2013/7/11 Lower layer	2013/7/14 Lower layer	2013/7/16 Lower layer	2013/7/18 Lower layer	2013/7/21 Lower layer	2013/7/23 Lower layer	2013/7/25 Lower layer	2013/7/28 Lower layer	2013/7/30 Lower layer
Sampling time	4:55 PM	11:36 AM	6:04 AM	6:15 AM	6:25 AM	6:22 AM	6:18 AM	6:58 AM	6:20 AM	6:16 AM	5:59 AM	6:33 AM	6:26 AM	6:22 AM	6:13 AM	
Cs-134	6.2	7.5	5.7	3.0	6.8	4.9	2.0	2.6	9.6	7.5	7.0	ND (1.6)	9.9	4.3	2.3	2.5
Cs-137	9.3	17	14	8.9	14	6.9	3.6	8.0	18	13	14	3.2	19	6.8	8.6	8.4
All β	210	180	180	120	180	220	51	58	180	450	320	19	100	170	93	97
H-3	360	340	ND (120)	ND (120)	170	210	ND (120)	500	460	390	420	ND (120)	370	230	690	650
Sr-90	Under measurement	—	—	—	—	—	—	—	—	—	—	Under measurement	—	—	—	—

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/8/1 Lower layer	2013/8/4 Lower layer	2013/8/6 Lower layer	2013/8/8 Lower layer	2013/8/11 Lower layer	2013/8/13 Lower layer	2013/8/15 Lower layer	2013/8/18 Lower layer	2013/8/20 Lower layer	2013/8/22 Lower layer	2013/8/25 Lower layer	2013/8/27 Lower layer	2013/8/29 Lower layer	2013/9/1 Lower layer	2013/9/3 Lower layer	2013/9/5 Lower layer
Sampling time	6:34 AM	6:25 AM	6:13 AM	6:08 AM	6:15 AM	6:19 AM	6:27 AM	6:13 AM	6:41 AM	6:31 AM	6:12 AM	6:15 AM	6:25 AM	6:12 AM	6:11 AM	6:15 AM
Cs-134	4.0	5.8	4.2	6.0	5.7	6.1	8.9	5.1	8.3	5.2	9.4	3.4	13	11	3.4	7.0
Cs-137	5.2	9.8	11	13	11	14	20	16	19	7.9	20	7.9	25	24	11	13
All β	180	110	120	200	270	250	300	80	140	210	330	250	340	370	160	110
H-3	300	1,200	210	490	510	570	1,000	560	690	280	720	230	1,200	1,600	260	510
Sr-90	—	—	—	—	—	—	—	—	Under measurement	—	—	—	—	—	—	—

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/9/8 Lower layer	2013/9/10 Lower layer	2013/9/12 Lower layer	2013/9/15 Lower layer	2013/9/17 Lower layer	2013/9/19 Lower layer	2013/9/22 Lower layer	2013/9/24 Lower layer	2013/9/26 Lower layer	2013/9/29 Lower layer	2013/10/01 Lower layer	2013/10/03 Lower layer	2013/10/06 Lower layer	2013/10/08 Lower layer	2013/10/10 Lower layer	
Sampling time	6:05 AM	6:16 AM	6:50 AM	6:02 AM	6:35 AM	6:14 AM	6:18 AM	6:14 AM	6:14 AM	6:15 AM	6:21 AM	6:10 AM	6:25 AM	6:26 AM	6:18 AM	5:54 AM
Cs-134	12	11	12	11	12	7.9	11	16	16	22	19	21	16	17	93	34
Cs-137	24	24	23	23	29	26	25	35	38	52	37	43	33	39	200	79
All β	370	310	360	190	170	180	200	300	300	330	320	260	220	250	400	430
H-3	640	470	400	720	520	410	470	780	660	1,100	880	780	580	450	690	800
Sr-90	—	—	—	—	—	—	Under measurement	—	—	—	—	—	—	—	—	—

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Unit 2 screen (inside the silt fence), seawater (Bq/L)

Sampling date	2013/6/21	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/26	2013/9/2	2013/9/9	2013/9/16	2013/9/23	2013/9/30
Sampling time	6:29 AM	6:24 AM	6:27 AM	5:51 AM	5:48 AM	5:45 AM	5:50 AM	6:15 AM	6:31 AM	6:17 AM	6:04 AM	6:01 AM	6:05 AM	6:04 AM	6:15 AM	6:07 AM
Cs-134	7.1	11	16	ND (1.8)	14	ND (1.9)	6.8	11	20	26	12	15	25	26	17	22
Cs-137	14	23	34	5.1	27	ND (1.9)	18	24	42	52	35	36	49	48	46	54
All β	230	260	220	26	250	ND (21)	140	240	370	490	280	300	520	350	350	350
H-3	290	320	250	ND (120)	440	ND (120)	370	500	570	820	380	520	1,500	1,300	1,300	1,500
Sr-90	Under measurement	—	—	—	—	Under measurement	—	—	—	Under measurement	—	—	—	Under measurement	—	—

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/10/7	2013/10/9	2013/10/10	2013/10/11	2013/10/12	2013/10/13	2013/10/14	2013/10/15	2013/10/17	2013/10/21
Sampling time	5:56 AM	6:29 AM	6:31 AM	6:11 AM	6:14 AM	6:05 AM	6:05 AM	6:21 AM	6:49 AM	5:59 AM
Cs-134	27	370	300	110	78	58	50	50	32	39
Cs-137	61	830	670	250	180	130	110	120	79	98
All β	420	1,700	1,300	580	590	560	520	520	260	500
H-3	1,700	1,900	1,500	1,200	1,200	1,400	1,300	1,200	560	Under measurement
Sr-90	—	—	—	—	—	—	—	—	—	—

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Between the water intake channel of Unit 2 and Unit 3, seawater (Bq/L)

Sampling date	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/20 Surface layer	2013/8/20 Lower layer	2013/8/26	2013/9/2	2013/9/9	2013/9/16	2013/9/23
Sampling time	6:51 AM	6:30 AM	5:56 AM	5:53 AM	5:49 AM	5:54 AM	6:19 AM	6:37 AM	6:21 AM	10:55 AM	11:10 AM	6:08 AM	6:03 AM	6:11 AM	6:07 AM	6:18 AM
Cs-134	8.8	6.0	4.6	9.3	ND (1.7)	8.4	15	21	12	5.2	3.5	8.2	10	19	14	13
Cs-137	18	14	15	18	ND (1.8)	23	34	37	30	14	9.8	24	24	38	31	35

All β	220	140	40	250	ND (21)	160	210	410	310	230	85	280	300	450	76	320
H-3	350	ND (120)	ND (120)	460	ND (120)	660	320	720	240	-	-	350	420	790	140	Under measurement
Sr-90	Under measurement	-	-	-	Under measurement	-	-	-	Under measurement	-	-	-	-	-	-	Under measurement

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/9/30	2013/10/7	2013/10/11	2013/10/12	2013/10/13	2013/10/14	2013/10/15	2013/10/17	2013/10/21
Sampling time	6:13 AM	6:00 AM	6:13 AM	6:17 AM	6:08 AM	6:07 AM	6:25 AM	6:56 AM	6:02 AM
Cs-134	14.0	22	46	40	23	32	21	25	9.2
Cs-137	24	58	110	77	51	62	48	53	19
All β	200	480	350	380	310	370	340	340	97
H-3	370	1,200	480	720	460	680	460	490	Under measurement
Sr-90	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Unit 3 screen (inside the silt fence), seawater (Bq/L)

Sampling date	2013/6/21	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/16	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/26	2013/9/2	2013/9/9	2013/9/16	2013/9/23
Sampling time	6:33 AM	6:30 AM	6:36 AM	6:01 AM	5:59 AM	6:32 AM	11:13 AM	5:57 AM	6:25 AM	6:41 AM	6:28 AM	6:14 AM	6:06 AM	6:15 AM	6:10 AM	6:25 AM
Cs-134	64	59	32	8.3	350	190	31	7.6	69	39	68	14	17	21	190	25
Cs-137	110	120	68	16	770	380	63	19	140	82	140	43	32	38	440	57
All β	270	310	230	72	1,000	610	120	96	290	340	270	300	220	270	600	220
H-3	220	190	ND (120)	ND (120)	ND (120)	-	ND (120)	200	240	380	160	260	410	270	ND (110)	290
Sr-90	Under measurement	-	-	-	-	-	Under measurement	-	-	-	Under measurement	-	-	-	-	Under measurement

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/9/30	2013/10/7	2013/10/9	2013/10/10	2013/10/14	2013/10/21
Sampling time	6:18 AM	6:03 AM	6:34 AM	6:36 AM	6:15 AM	6:06 AM
Cs-134	44	30	49	47	23	74
Cs-137	95	61	110	110	51	200
All β	240	190	210	210	120	240
H-3	250	290	190	ND (120)	ND (120)	Under measurement
Sr-90	-	-	-	-	Under measurement	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Between the water intake channel of Unit 3 and Unit 4, seawater (Bq/L)

Sampling date	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/20	Surface layer	2013/8/20	Lower layer	2013/8/26	2013/9/2	2013/9/9	2013/9/16	2013/9/23
Sampling time	6:47 AM	6:38 AM	6:06 AM	6:00 AM	6:02 AM	6:02 AM	6:29 AM	6:48 AM	6:32 AM	11:16 AM	11:25 AM	6:20 AM	6:08 AM	6:20 AM	6:15 AM	6:31 AM		
Cs-134	9.9	7.3	2.6	12	ND (2.0)	11	12	22	20	14	4.8	12	9.8	14	28	15		
Cs-137	23	16	7.0	26	ND (2.0)	22	28	45	43	30	7.7	26	22	36	50	28		
All β	230	130	18	260	ND (21)	120	210	390	160	180	57	320	250	280	130	230		
H-3	250	ND (120)	ND (120)	430	ND (120)	280	280	650	270	-	-	310	430	410	200	570		
Sr-90	Under measurement	-	-	-	Under measurement	-	-	-	Under measurement	-	-	-	-	-	-	Under measurement		

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/9/30	2013/10/7	2013/10/14	2013/10/21
Sampling time	6:29 AM	6:08 AM	6:25 AM	6:10 AM
Cs-134	13	17	15	15
Cs-137	29	36	32	34
All β	170	300	120	120
H-3	380	620	220	Under measurement
Sr-90	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Unit 4 screen (inside the silt fence), seawater (Bq/L)

Sampling date	2013/6/21	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/26	2013/9/2	2013/9/9	2013/9/16	2013/9/23	2013/9/30
Sampling time	6:37 AM	6:35 AM	6:42 AM	6:04 AM	6:02 AM	11:16 AM	6:00 AM	6:28 AM	6:44 AM	6:37 AM	6:18 AM	6:12 AM	6:18 AM	6:13 AM	6:30 AM	6:23 AM
Cs-134	31	34	17	46	43	12	30	27	30	20	13	16	21	62	30	28
Cs-137	70	65	36	93	89	26	64	58	62	49	34	28	45	140	76	61
All β	250	220	160	130	300	49	200	210	310	200	270	230	210	200	190	170
H-3	ND (210)	260	ND (120)	ND (120)	180	ND (120)	260	210	400	ND (120)	280	360	220	160	310	290
Sr-90	Under measurement	-	-	-	-	Under measurement	-	-	-	Under measurement	-	-	-	-	Under measurement	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/10/7	2013/10/9	2013/10/10	2013/10/14	2013/10/21
Sampling time	6:06 AM	6:37 AM	6:39 AM	6:23 AM	6:09 AM
Cs-134	44	36	30	20	50
Cs-137	98	80	65	53	110
All β	360	140	120	85	150
H-3	400	180	ND (120)	ND (120)	Under measurement
Sr-90	-	-	-	Under measurement	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Around the south discharge channel (Bq/L)

Sampling date	2013/6/21	2013/6/26	2013/7/3	2013/7/8	2013/7/15	2013/7/22	2013/7/29	2013/8/5	2013/8/12	2013/8/19	2013/8/26	2013/9/2	2013/9/9	2013/9/16	2013/9/23	2013/9/30
Sampling time	7:15 AM	11:15 AM	5:10 AM	5:15 AM	10:45 AM	5:15 AM	5:15 AM	5:20 AM	5:40 AM	5:20 AM	5:20 AM	5:20 AM	5:20 AM	5:20 AM	5:20 AM	5:20 AM
Cs-134	ND (1.0)	ND (1.1)	ND (1.2)	ND (0.93)	ND (1.2)	ND (1.2)	ND (1.0)	ND (1.3)	ND (1.2)	ND (1.4)	ND (1.1)	ND (1.4)	ND (1.3)	ND (1.2)	ND (1.2)	ND (1.2)
Cs-137	2.0	ND (1.3)	ND (1.2)	ND (1.1)	3.0	ND (1.4)	ND (1.3)	ND (1.6)	ND (1.4)	ND (1.5)	ND (1.0)	ND (1.3)	ND (1.5)	ND (1.8)	ND (1.4)	ND (1.5)
All β	ND (19)	ND (22)	ND (18)	ND (18)	ND (21)	ND (20)	ND (21)	ND (18)	ND (19)	ND (18)	ND (19)	ND (21)	ND (15)	ND (19)	ND (17)	ND (18)
H-3	-	ND (2.9)	ND (3.0)	ND (3.1)	ND (2.9)	ND (3.2)	ND (2.9)	ND (3.1)	ND (2.9)	ND (3.0)	ND (1.7)	ND (1.8)	ND (1.5)	ND (1.8)	ND (1.7)	ND (1.7)
Sr-90	-	0.36	-	-	-	Under measurement	-	-	-	Under measurement	-	-	-	Under measurement	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date

Sampling date	2013/10/7	2013/10/14	2013/10/21
Sampling time	5:20 AM	5:10 AM	9:45 AM
Cs-134	ND (1.3)	ND (1.0)	ND (1.3)
Cs-137	ND (1.4)	ND (1.1)	ND (1.3)
All β	ND (21)	ND (17)	ND (17)
H-3	ND (1.8)	ND (1.8)	Under measurement
Sr-90	-	Under measurement	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Port entrance, seawater (Bq/L)

Sampling date	2013/6/20	2013/6/26	2013/7/4	2013/7/8	2013/7/17	2013/7/22	2013/7/31	2013/8/5	2013/8/12	2013/8/19	2013/8/26	2013/9/3	2013/9/9	2013/9/18	2013/9/24	2013/10/3	
Sampling time	1:18 PM	2:19 PM	3:19 PM	10:29 AM	12:20 PM	11:32 AM	7:38 AM	11:54 AM	9:14 AM	7:22 AM	7:21 AM	7:52 AM	8:46 AM	10:12 AM	9:37 AM	9:03 AM	
Cs-134	ND (1.3)	ND (1.9)	ND (1.7)	ND (2.0)	ND (2.2)	ND (1.9)	ND (2.1)	ND (1.9)	ND (1.4)	1.6	ND (2.0)	ND (1.2)	ND (1.2)	ND (1.7)	ND (1.2)	ND (1.1)	
Cs-137	ND (1.2)	3.7	ND (2.0)	ND (2.6)	ND (2.0)	ND (1.9)	ND (2.4)	ND (1.5)	ND (1.6)	4.7	ND (1.6)	ND (1.0)	ND (0.90)	ND (16)	2.6	1.4	2.0
All β	15	31	ND (22)	ND (19)	ND (20)	ND (18)	ND (20)	ND (20)	ND (21)	69	ND (17)	ND (16)	ND (16)	ND (15)	ND (15)	ND (15)	ND (15)
H-3	5.0	29	ND (3.6)	4.2	4.8	ND (3.0)	ND (3.1)	3.8	ND (2.8)	68	4.0	ND (1.6)	2.5	6.7	ND (1.8)	2.7	ND (1.8)
Sr-90	3.5	-	-	-	-	Under measurement	-	-	-	Under measurement	-	-	-	-	Under measurement	-	

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

East side in the port, seawater (Bq/L)

Sampling date	2013/6/26	2013/7/4	2013/7/9	2013/7/12	2013/10/13	2013/10/14	2013/10/15	2013/10/17	2013/10/21
Sampling time	2:22 PM	10:32 AM	10:34 AM	2:40 PM	11:41 AM	7:43 AM	11:58 AM	9:20 AM	7:30 AM
Cs-134	ND (2.4)	ND (2.3)	ND (1.7)	ND (2.3)	ND (1.8)	ND (1.4)	ND (1.8)	2.9	ND (1.1)
Cs-137	ND (2.4)	3.3	ND (2.4)	ND (2.5)	ND (2.1)	ND (2.4)	ND (2.0)	6.6	1.9
All β	ND (16)	ND (15)	ND (15)	ND (17)	ND (16)	ND (16)	ND (15)	74	ND (1.0)
H-3	6.8	ND (2.0)	4.3	7.9	7.5	ND (2.0)	4.7	67	6.6
Sr-90	-	-	-	-	-	ND (3.1)	ND (3.1)	ND (2.8)	ND (1.6)
	Under measurement	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

<Continued from the previous page

Sampling date	2013/10/17	2013/10/21
Sampling time	11:30 AM	10:28 AM
Cs-134	3.3	2.1
Cs-137	9.0	3.5

All β	21	ND (15)
H-3	11	Under measurement
Sr-90	—	—

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

West side in the port, seawater (Bq/L)

Sampling date	2013/6/26	2013/7/4	2013/7/9	2013/7/17	2013/7/22	2013/7/31	2013/8/5	2013/8/12	2013/8/19	2013/8/28	2013/9/3	2013/9/9	2013/9/18	2013/9/24	2013/10/3	2013/10/7
Sampling time	2:25 PM	10:37 AM	10:38 AM	2:47 PM	11:50 AM	7:48 AM	12:02 PM	9:02 AM	7:33 AM	7:38 AM	8:49 AM	8:59 AM	10:03 AM	9:26 AM	8:51 AM	10:00 AM
Cs-134	ND (2.5)	ND (2.2)	ND (2.0)	ND (2.2)	ND (2.2)	ND (1.5)	ND (1.8)	ND (2.0)	2.6	ND (1.1)	ND (1.3)	1.2	ND (1.4)	1.7	2.3	ND (2.1)
Cs-137	3.3	ND (2.6)	ND (1.9)	2.4	ND (2.2)	ND (2.4)	ND (1.9)	ND (2.3)	6.5	1.6	ND (1.2)	2.8	1.8	2.5	4.4	ND (1.4)
All β	43	60	ND (19)	ND (20)	ND (18)	ND (20)	ND (20)	ND (18)	57	ND (17)	ND (16)	ND (16)	ND (15)	ND (15)	ND (16)	ND (16)
H-3	26	37	4.7	20	ND (9.6)	6.3	4.2	4.8	59	5.3	ND (1.6)	14	5.4	4.0	7.3	6.3
Sr-90	Under measurement	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sampling date	2013/10/17	2013/10/21
Sampling time	11:35 AM	10:34 AM
Cs-134	2.0	ND (1.3)
Cs-137	5.2	2.7
All β	17	ND (15)
H-3	7.5	Under measurement
Sr-90	—	—

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

North side in the port, seawater (Bq/L)

Sampling date	2013/8/12	2013/8/19	2013/8/28	2013/9/3	2013/9/9	2013/9/18	2013/9/24	2013/10/3	2013/10/7	2013/10/17	2013/10/21
Sampling time	9:31 AM	7:36 AM	7:35 AM	8:53 AM	9:01 AM	9:59 AM	9:23 AM	8:47 AM	12:00 AM	11:38 AM	10:37 AM
Cs-134	ND (1.8)	ND (2.0)	ND (2.1)	ND (1.1)	ND (1.3)	1.5	ND (1.4)	2.3	ND (2.1)	2.5	ND (1.1)
Cs-137	ND (2.1)	4.7	1.8	ND (1.1)	1.1	2.8	1.7	3.9	1.9	5.8	2.2
All β	ND (21)	69	ND (17)	ND (16)	ND (16)	ND (15)	ND (15)	ND (15)	ND (16)	ND (15)	ND (15)
H-3	6.5	52	7.3	2.2	4.1	10	4.7	7.8	6.5	6.2	Under measurement
Sr-90	—	—	—	—	—	—	—	—	—	—	—

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

South side in the port, seawater (Bq/L)

Sampling date	2013/8/12	2013/8/19	2013/8/28	2013/9/3	2013/9/9	2013/9/18	2013/9/24	2013/10/3	2013/10/7	2013/10/17	2013/10/21
Sampling time	9:24 AM	7:27 AM	7:24 AM	7:57 AM	8:50 AM	10:09 AM	9:33 AM	8:58 AM	9:49 AM	11:26 AM	10:22 AM
Cs-134	ND (2.0)	2.1	1.1	ND (1.5)	ND (0.81)	1.5	ND (1.7)	1.6	ND (1.4)	3.5	3.1
Cs-137	ND (2.3)	4.6	3.4	ND (1.3)	1.1	3.7	ND (1.2)	4.5	1.7	7.8	5.0
All β	ND (18)	79	ND (17)	ND (16)	ND (16)	ND (15)	ND (15)	ND (15)	ND (16)	28	ND (15)
H-3	3.4	60	3.2	ND (1.6)	ND (1.6)	5.8	ND (1.8)	2.9	8.6	12	Under measurement
Sr-90	—	—	—	—	—	—	—	—	—	—	—

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

North side of the north breakwater (Bq/L)

Sampling date	2013/8/14	2013/8/21	2013/8/27	2013/9/3	2013/9/11	2013/9/18	2013/9/28	2013/10/4	2013/10/8	2013/10/10	2013/10/18
Sampling time	8:17 AM	8:09 AM	8:14 AM	8:39 AM	9:16 AM	9:00 AM	9:42 AM	12:08 PM	8:43 AM	11:54 AM	9:10 AM
Cs-134	ND (1.5)	ND (1.1)	ND (0.66)	ND (0.88)	ND (0.70)	ND (0.67)	ND (0.61)	ND (0.68)	ND (0.64)	ND (0.67)	ND (0.81)
Cs-137	ND (1.4)	ND (1.4)	ND (0.49)	ND (0.58)	ND (0.62)	ND (0.52)	ND (0.57)	ND (0.52)	ND (0.73)	ND (0.80)	ND (0.64)
All β	ND (18)	ND (20)	ND (17)	ND (16)	ND (17)	ND (16)	ND (16)	ND (15)	ND (15)	—	ND (16)
H-3	4.7	ND (2.9)	ND (2.0)	ND (1.8)	ND (1.9)	ND (1.7)	ND (1.7)	ND (1.6)	ND (1.7)	—	ND (1.8)
Sr-90	-	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

East side of the port entrance (Bq/L)

Sampling date	2013/8/14	2013/8/21	2013/8/27	2013/9/3	2013/9/11	2013/9/18	2013/9/28	2013/10/4	2013/10/8	2013/10/10	2013/10/18
Sampling time	8:21 AM	8:16 AM	8:20 AM	8:39 AM	8:59 AM	8:44 AM	9:51 AM	9:13 PM	8:25 AM	11:48 AM	8:50 AM
Cs-134	ND (1.1)	ND (1.0)	ND (0.84)	ND (0.63)	ND (0.80)	ND (0.45)	ND (0.66)	ND (0.80)	ND (0.76)	ND (0.68)	ND (1.2)
Cs-137	ND (1.1)	ND (1.3)	ND (0.69)	ND (0.69)	ND (0.71)	ND (0.68)	ND (0.64)	ND (0.69)	1.4	ND (0.50)	1.6
All β	ND (18)	ND (20)	ND (17)	ND (16)	ND (17)	ND (16)	ND (16)	ND (15)	ND (15)	—	ND (16)
H-3	ND (2.9)	ND (2.9)	ND (2.0)	ND (1.8)	ND (1.9)	3.6	ND (1.7)	ND (1.6)	6.4	—	2.9
Sr-90	-	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

South side of the south breakwater (Bq/L)

Sampling date	2013/8/14	2013/8/21	2013/8/27	2013/9/3	2013/9/11	2013/9/18	2013/9/28	2013/10/4	2013/10/8	2013/10/10	2013/10/18
Sampling time	8:09 AM	8:01 AM	8:07 AM	8:31 AM	9:06 AM	8:52 AM	9:56 AM	12:19 PM	8:33 AM	11:42 AM	8:59 AM
Cs-134	ND (1.5)	ND (1.0)	ND (0.69)	ND (0.43)	ND (0.74)	ND (0.68)	ND (0.64)	ND (0.61)	ND (0.88)	ND (0.63)	ND (0.70)
Cs-137	ND (1.1)	ND (1.4)	ND (0.68)	ND (0.66)	ND (0.64)	ND (0.82)	ND (0.82)	ND (0.57)	ND (0.85)	ND (0.71)	ND (0.76)
All β	ND (18)	ND (20)	ND (17)	ND (16)	ND (17)	ND (16)	ND (16)	ND (15)	ND (15)	—	ND (16)
H-3	ND (2.9)	ND (2.9)	ND (2.0)	ND (1.8)	ND (1.9)	ND (1.7)	ND (1.7)	ND (1.6)	ND (1.7)	—	ND (1.8)
Sr-90	-	-	-	-	-	-	-	-	-	-	-

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.