

Progress of Landside Impermeable Wall freezing: Phase 2 of the first stage

TEPCO


- The purpose of the Landside Impermeable Wall construction lies not in freezing soil to form an underground wall but in keeping groundwater from flowing into the reactor/turbine buildings and preventing new contaminated water from being generated.
- By closing less than 95 percent of the mountain side of the Landside Impermeable Wall in Phase 2 of the first stage, it is expected that the amount of groundwater flowing into the areas around the reactor/turbine buildings will be reduced. This will help keep groundwater from being contaminated during the first stage.
- Throughout the first stage, how freezing of the Landside Impermeable Wall has progressed will be checked by monitoring the difference in groundwater levels inside and outside of the wall and the amount of groundwater pumped up by the subdrain and groundwater drain systems and the well point system.

Changes in soil temperatures over time

TEPCO

Note

- Average Soil Temperature (AST) of medium-grained sandstone layer (blue line): average value of thermometer temperatures measured at 1m intervals except for the areas between ground surface and Ground Level 2m and the areas around the first muddy layer boarder.
- Average Soil Temperature (AST) of alternating strata layer (red line): Average value of thermometer temperatures measured at 1m intervals except for the areas around the upper and lower parts of the alternating layer boarder.

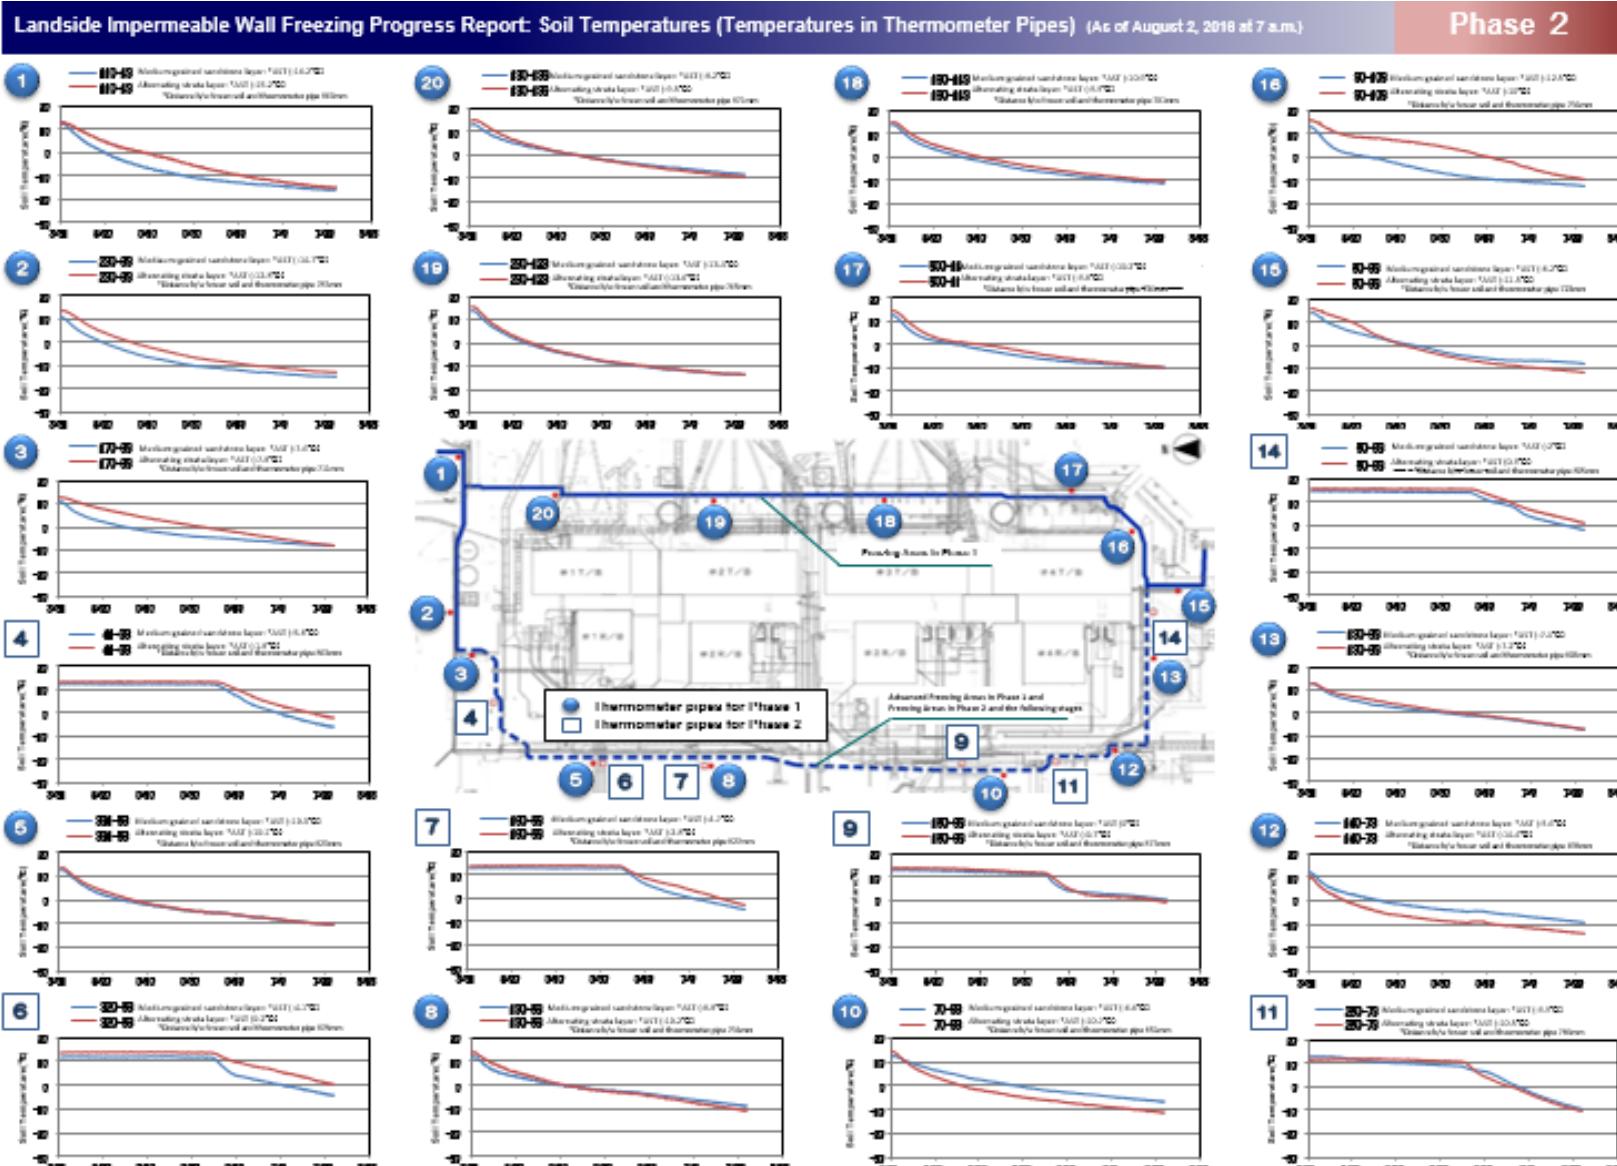


Groundwater levels and hydraulic heads (in the medium-grained sandstone layer 1 on the seaside)



TEPCO

Monitoring items at initial stage of the Landside Impermeable Wall operations (Phase 2 of the first stage: the medium-grained sandstone layer 1 on the seaside)

1. Landside Impermeable Wall (groundwater levels around the seaside and the operations of Subdrain pumping system)

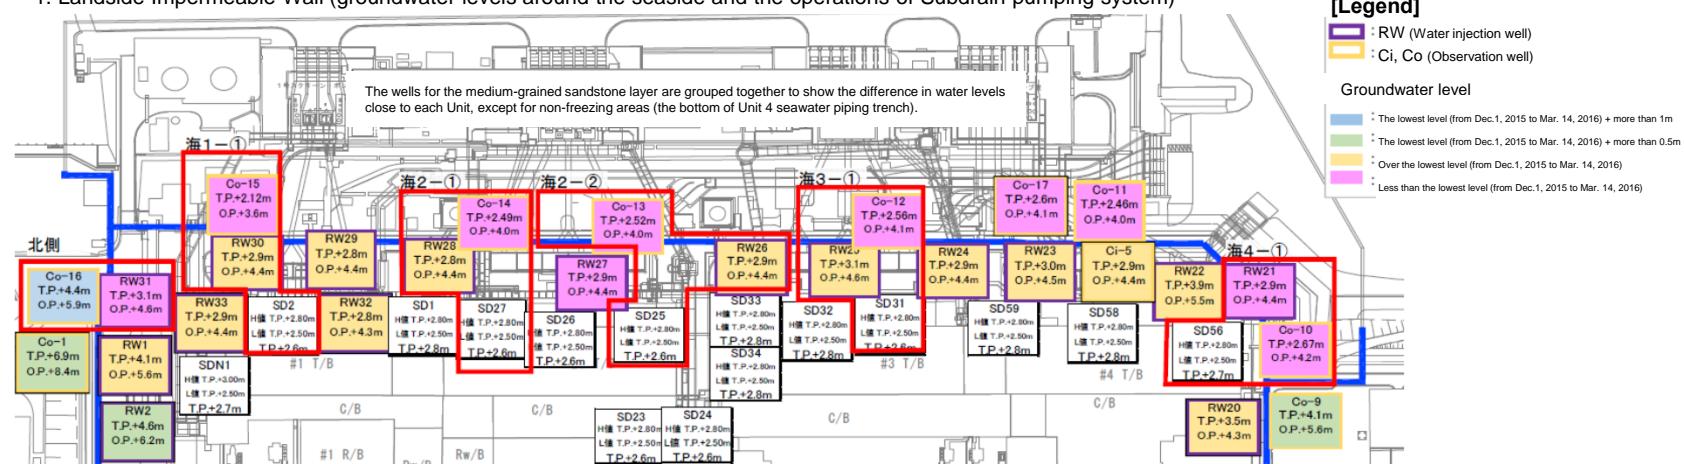

2. Groundwater levels inside and outside of the Landside Impermeable Wall

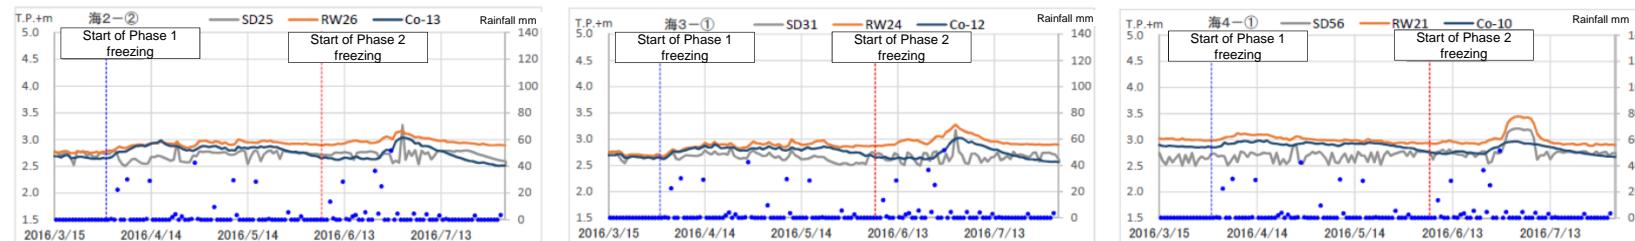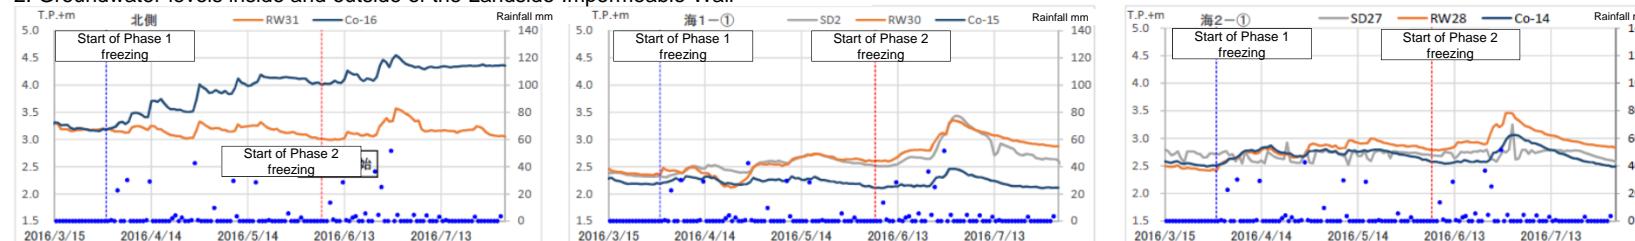


The data of groundwater levels as of 12 p.m. on August 2.

Groundwater levels and hydraulic heads (in the medium-grained sandstone layer 2 on the landside)


TEPCO

Monitoring items at initial stage of the Landside Impermeable Wall operations (Phase 2 of the first stage: the medium-grained sandstone layer 2 on the landside)

3. Landside Impermeable Wall (groundwater levels around the seaside and the operations of Subdrain pumping system)

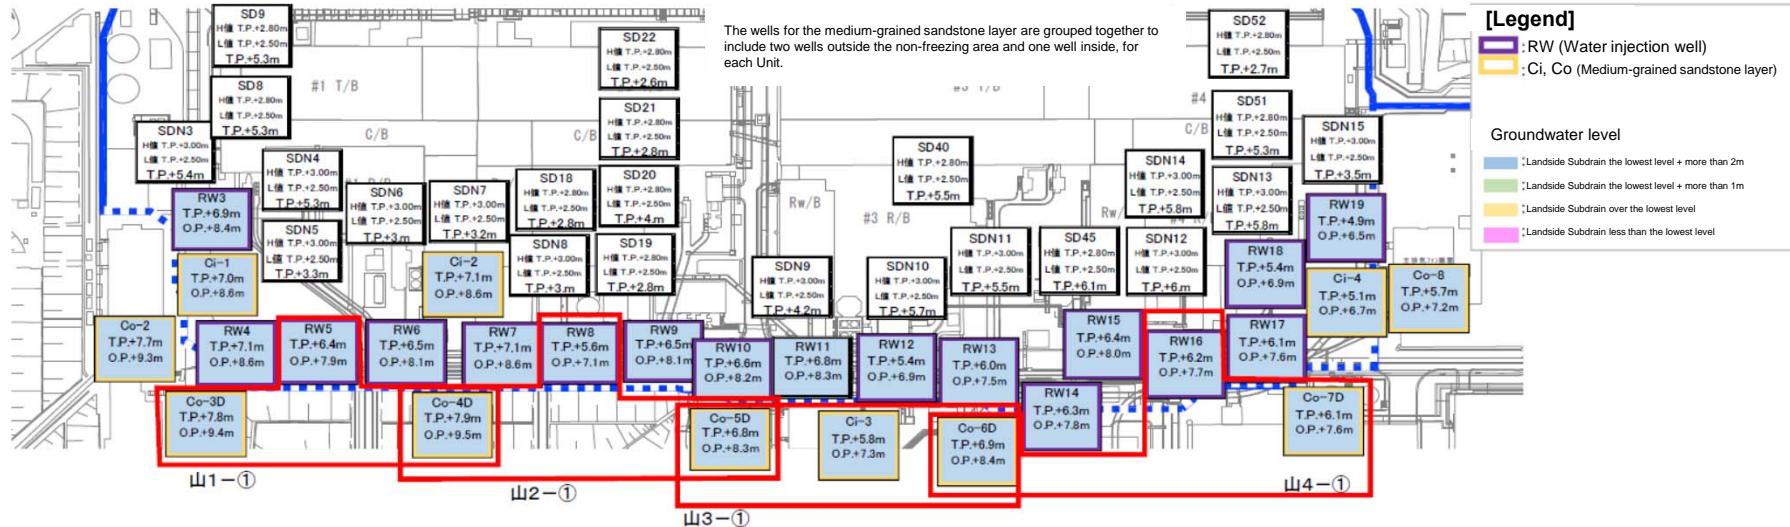

4. Groundwater levels inside and outside of the Landside Impermeable Wall

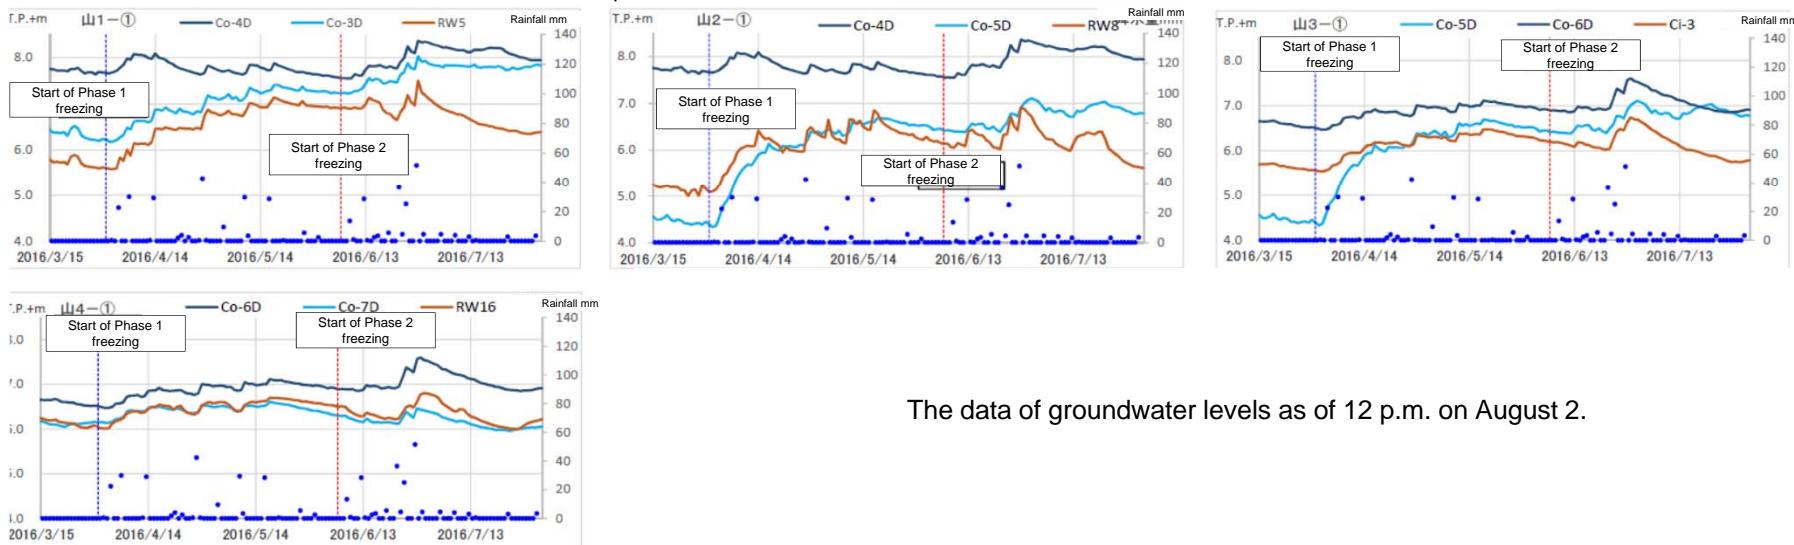

The data of groundwater levels as of 12 p.m. on August 2.

Groundwater levels and hydraulic heads


(in the alternating strata layer and the fine- and rough-grained sandstone layer 1 on the seaside)

TEPCO


Monitoring items at initial stage of the Landside Impermeable Wall operations

(Phase 2 of the first stage: the alternating strata layer and the fine- and rough-grained sandstone layer 1 on the seaside)

5. Landside Impermeable Wall (groundwater levels around the seaside and the operations of Subdrain pumping system)

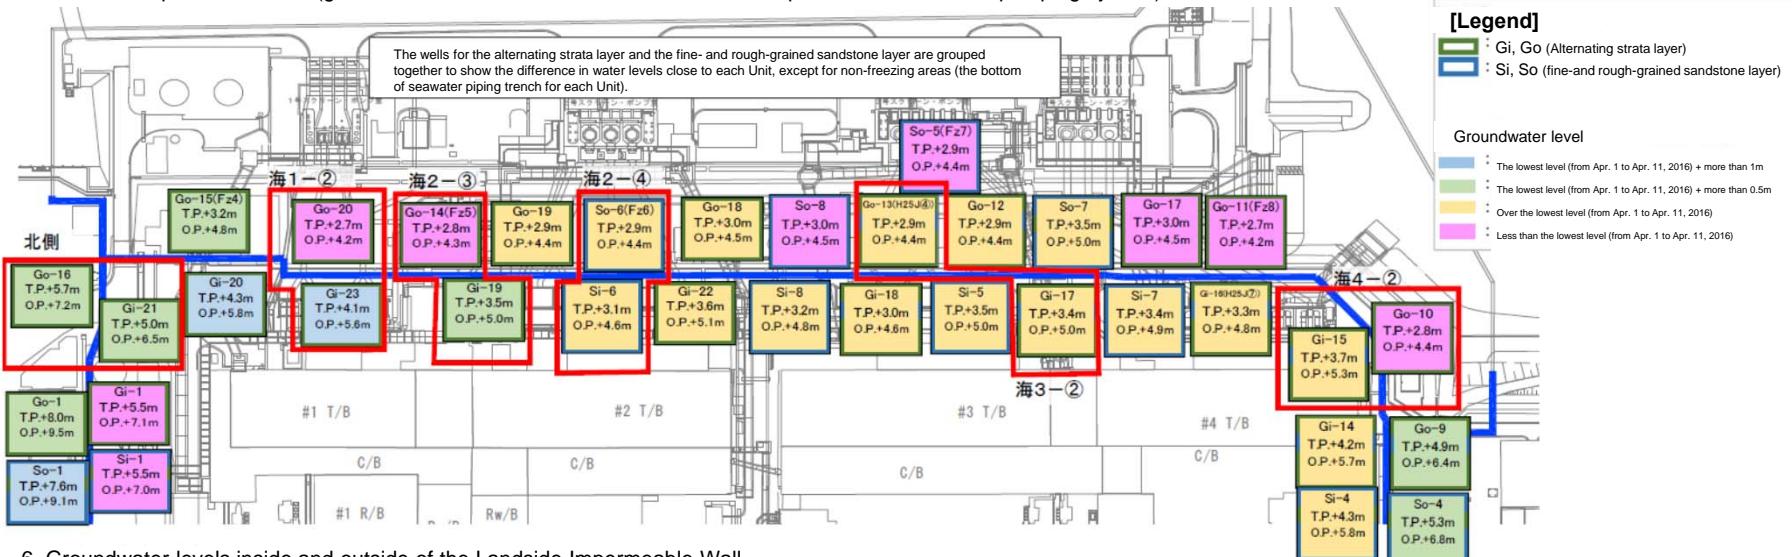

6. Groundwater levels inside and outside of the Landside Impermeable Wall

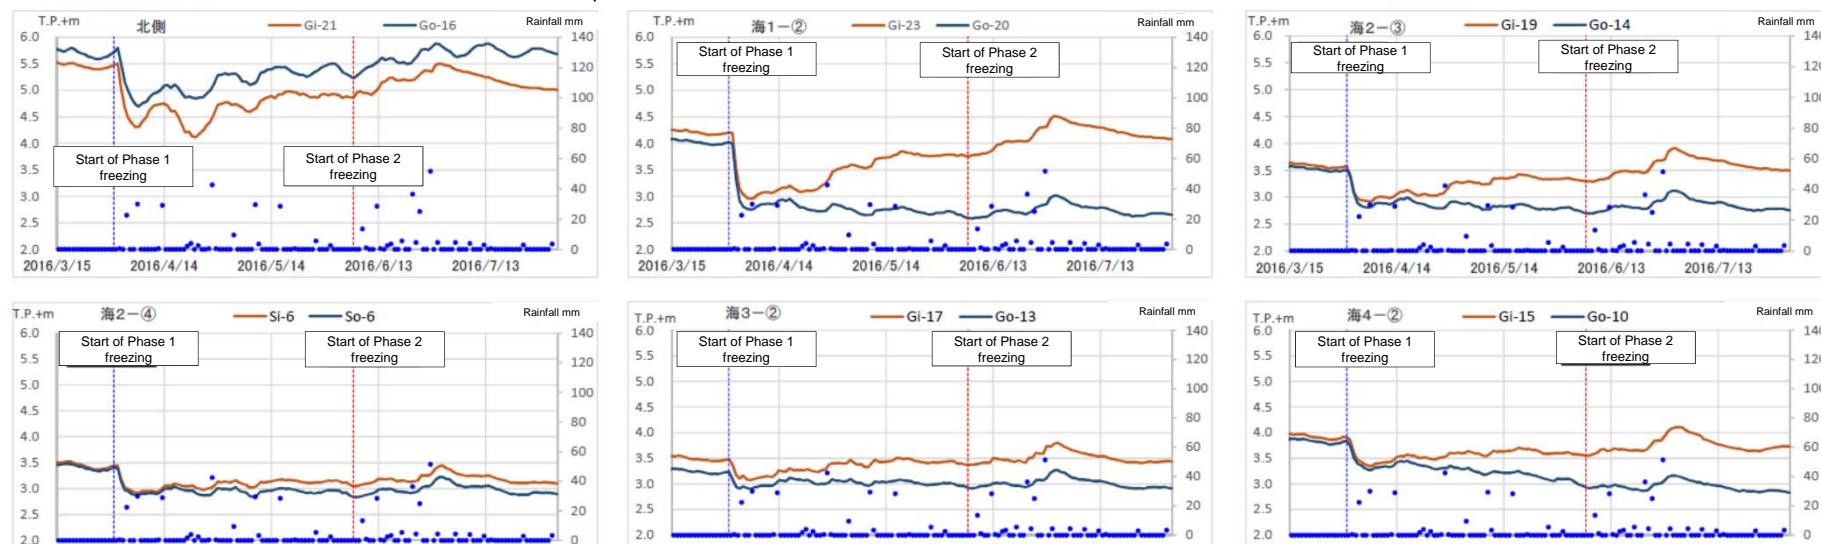

The data of groundwater levels as of 12 p.m. on August 2.


Groundwater levels and hydraulic heads

(in the alternating strata layer and the fine- and rough-grained sandstone layer 2 on the landside) **TEPCO**


Monitoring items at initial stage of the Landside Impermeable Wall operations

(Phase 2 of the first stage: the alternating strata layer and the fine- and rough-grained sandstone layer 2 on the landside)

7. Landside Impermeable Wall (groundwater levels around the seaside and the operations of Subdrain pumping system)

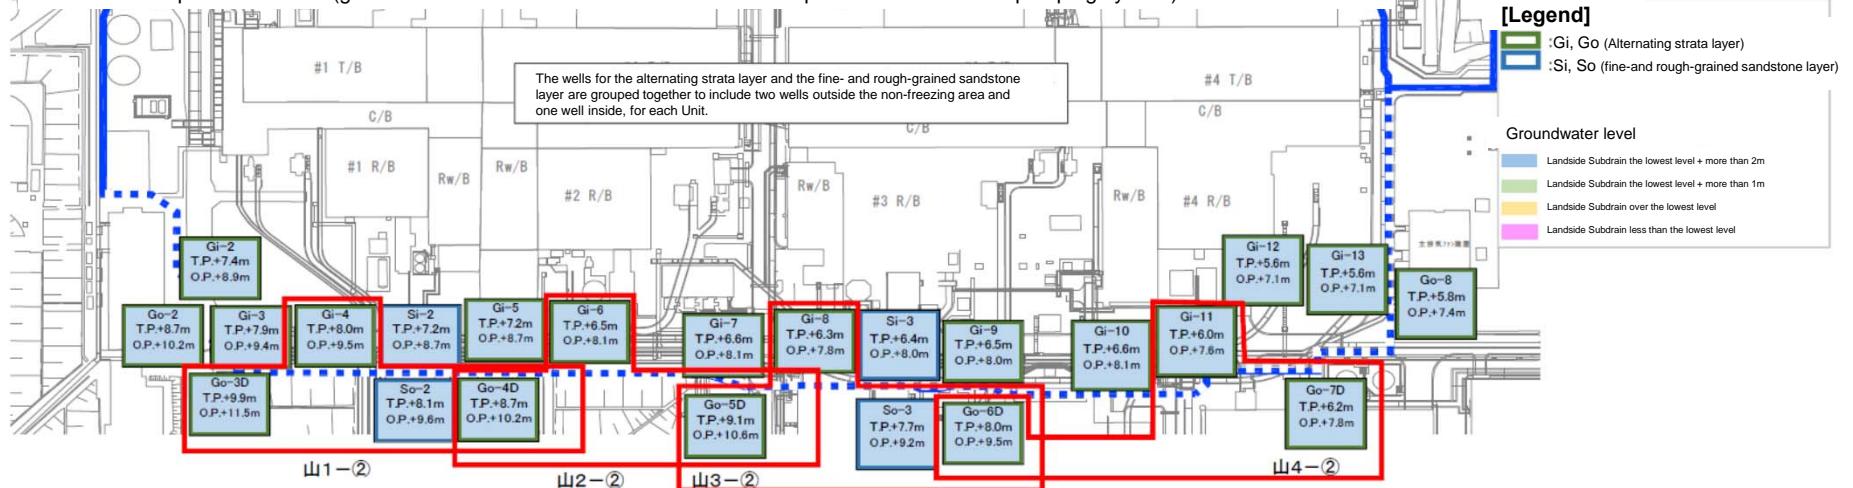


8. Groundwater levels inside and outside of the Landside Impermeable Wall

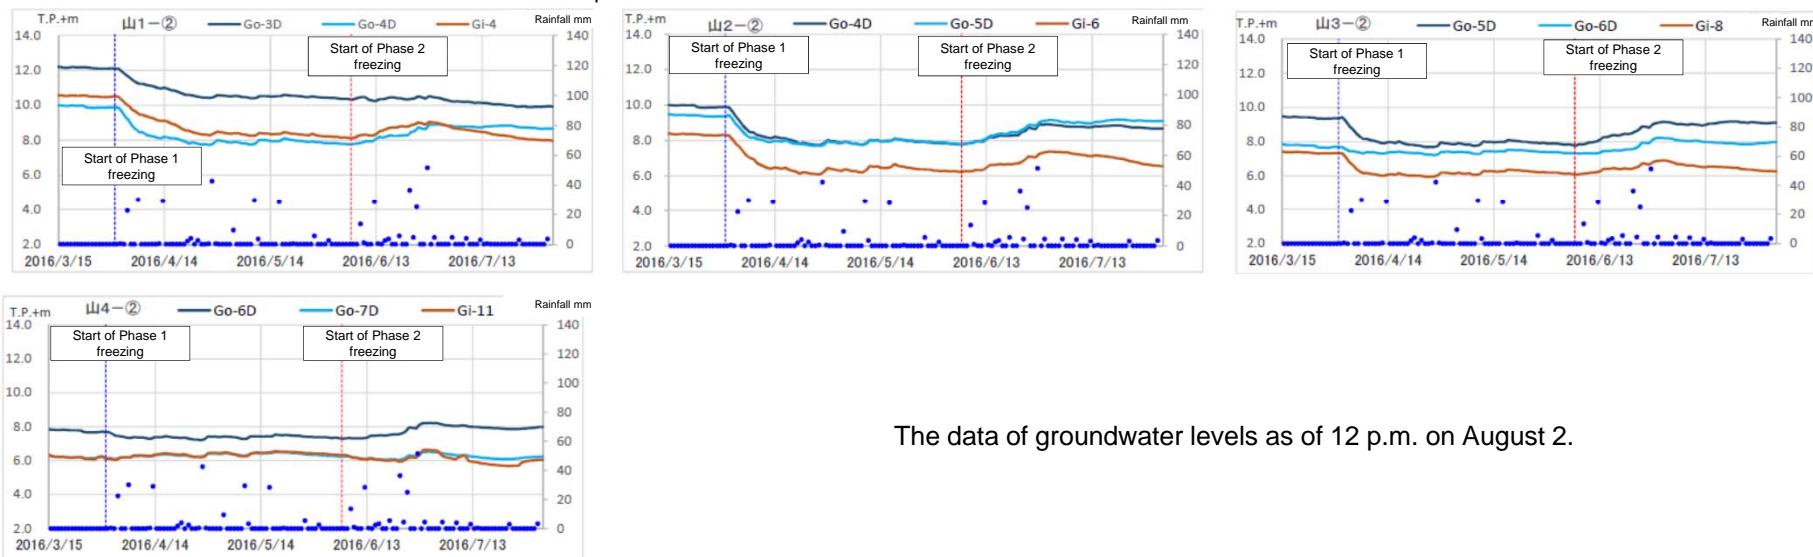

[Reference] Location map of groundwater level observation wells (as of June 201

TEPCO

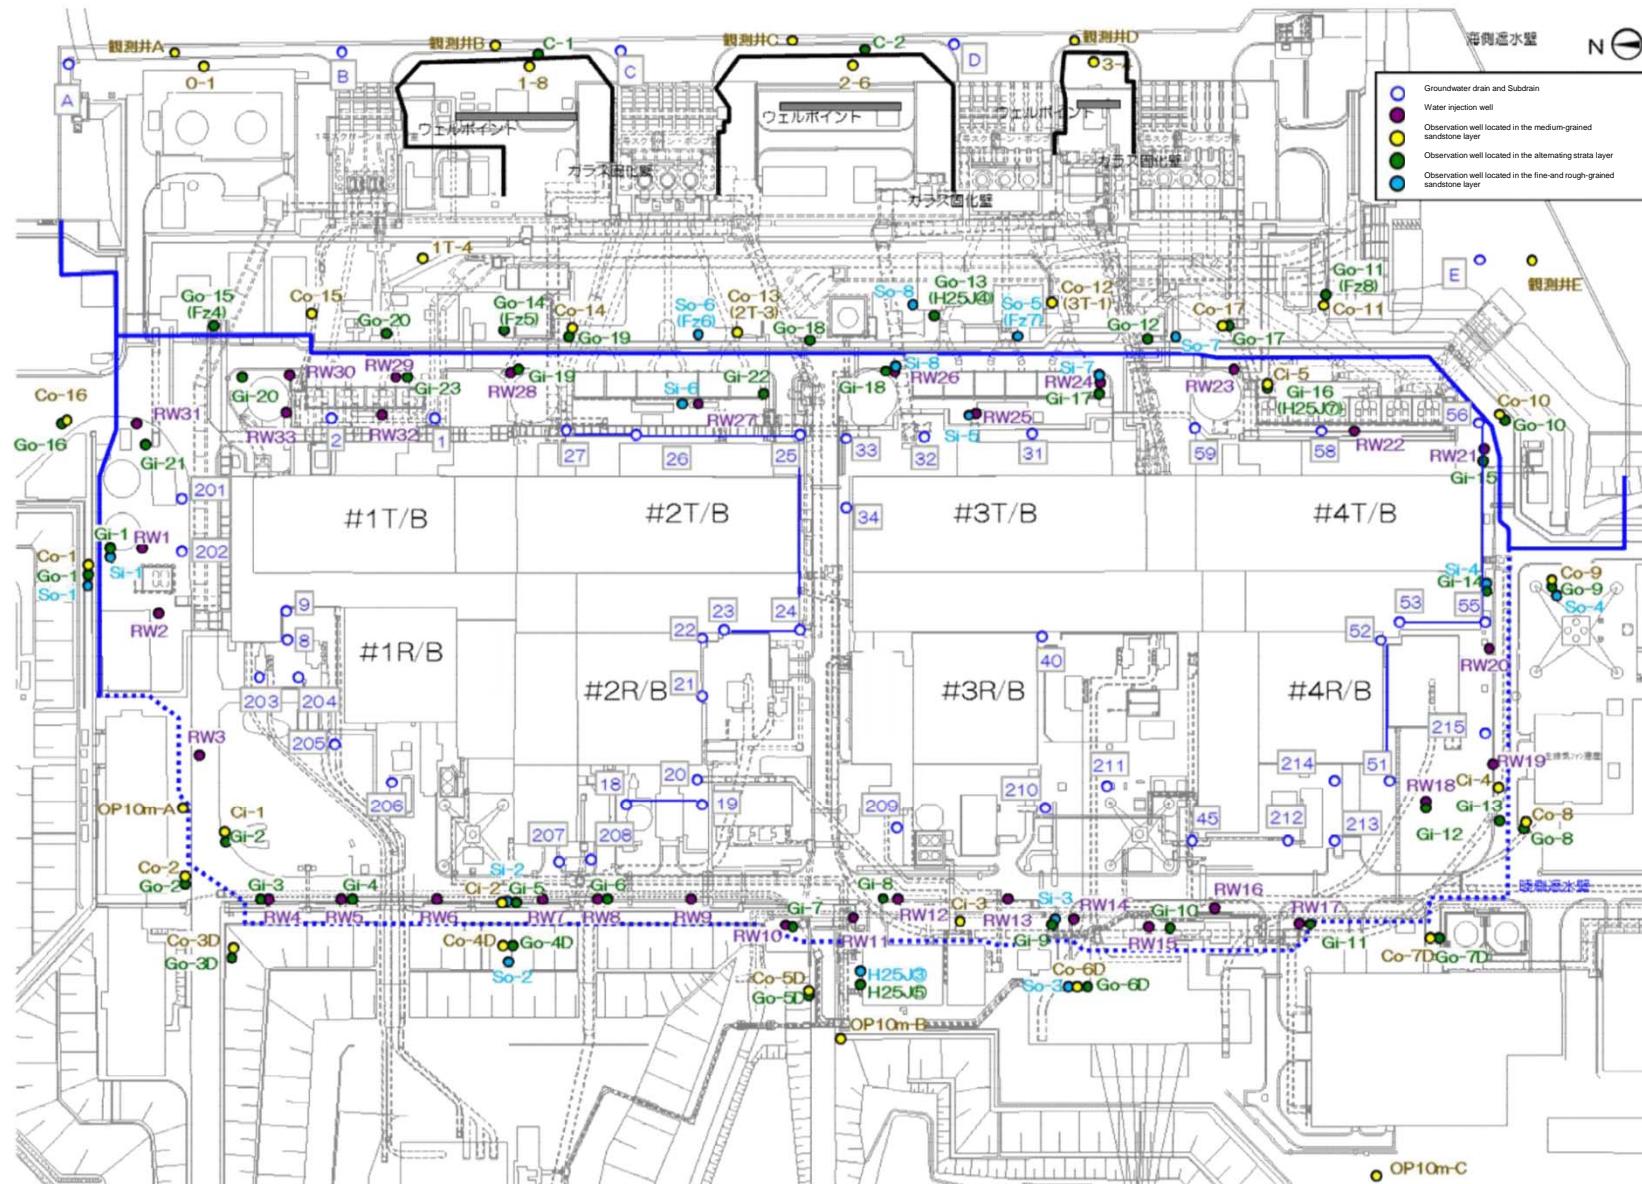

[Reference] Distribution map of soil temperatures (north side of Unit1) **TEPCO**

Distribution map of soil temperatures



(1) North side of Unit 1 (a view from the north side)

(The temperature data as of 7 a.m. on August 2.)

[Legend]

- Thermometer pipe for the outside of frozen soil line
- Thermometer pipe for the inside of frozen soil line
- Diagonally installed thermometer pipe for the soil freezing pipes installed on single line (advanced freezing)
- Thermometer pipe for no freezing areas
- ▼ Corner of frozen soil line

KEY PLAN

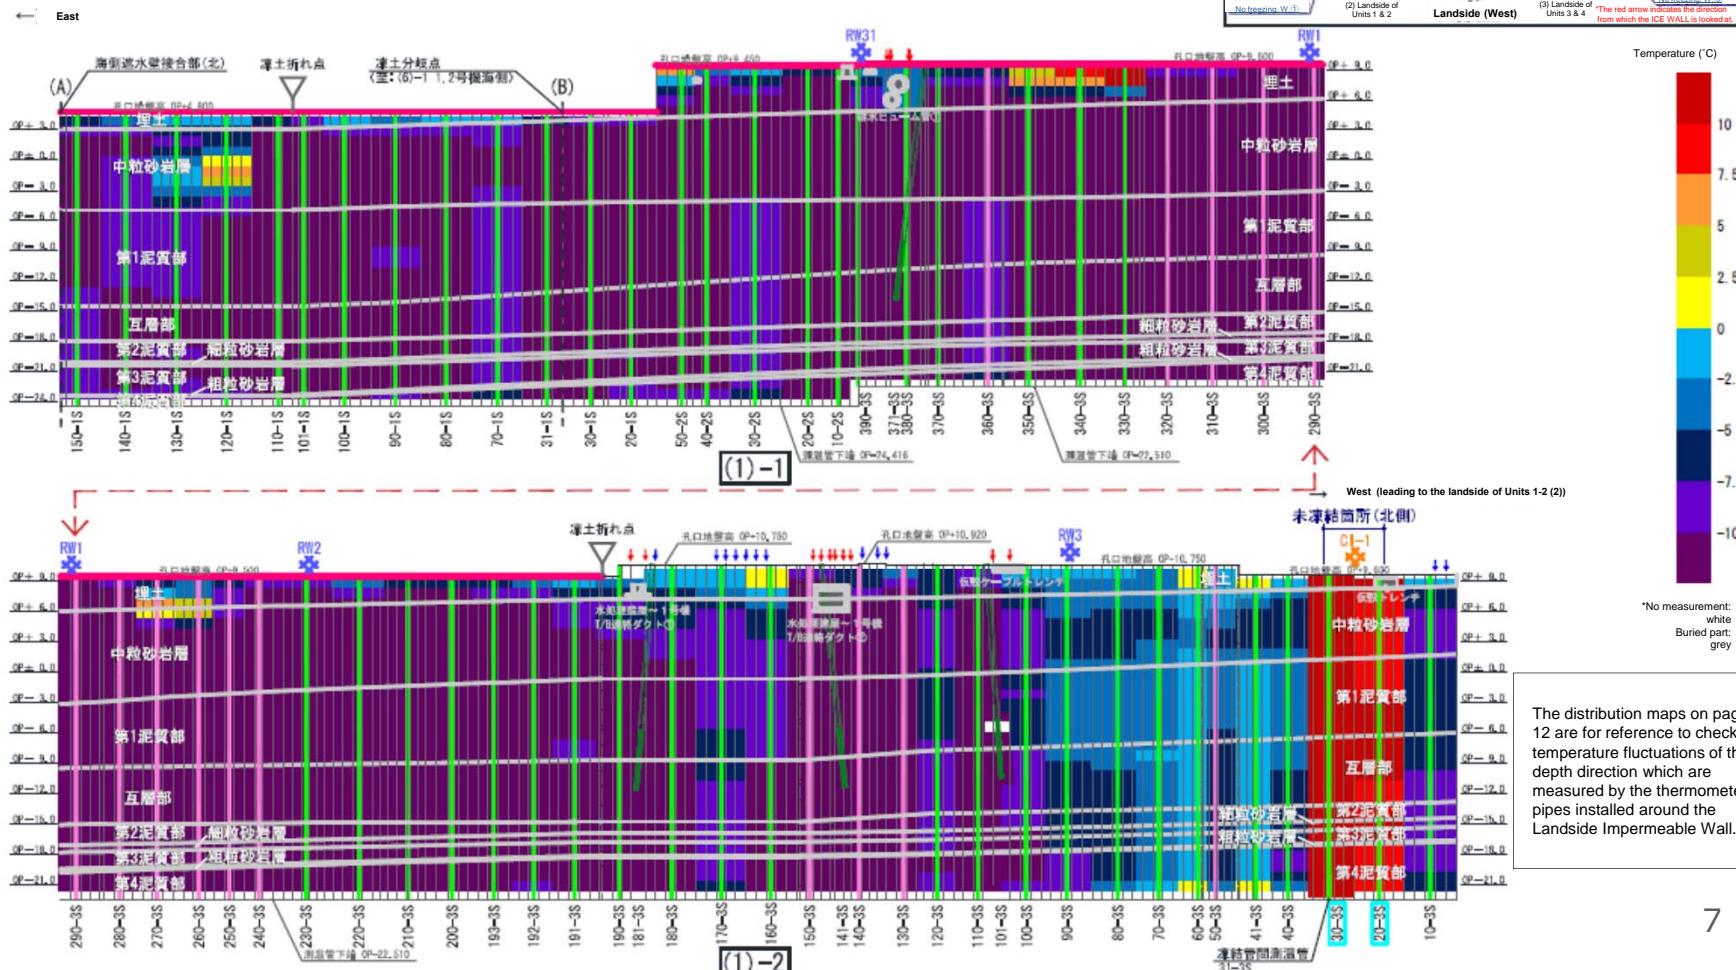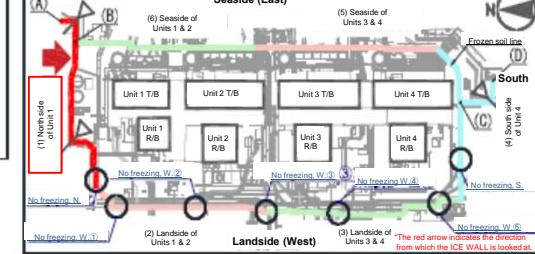

[Reference] Distribution map of soil temperatures (west side of Units 1-2)

TEPCO

Distribution map of soil temperatures


(2) Landside of Units 1-2 (a view from the west side)

(The temperature data as of 7 a.m. on August 2.)


[Legend]

- RE (recharge well)
- Thermometer pipe for the outside of frozen soil line
- Thermometer pipe for the inside of frozen soil line
- Diagonally installed thermometer pipe for the soil freezing pipes installed on single line
- Thermometer pipe for no freezing areas
- Soil freezing pipes installed on multiple lines (advanced freezing)
- Soil freezing pipes installed on multiple lines (normal freezing)
- ▼ Corner of frozen soil line
- Freezing areas for the seaside and a part of the north side


KEY PLAN

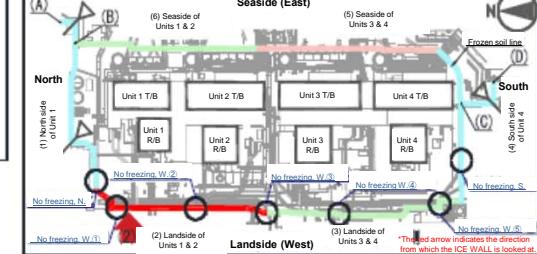

← North (leading to the north side of Unit 1 (1))

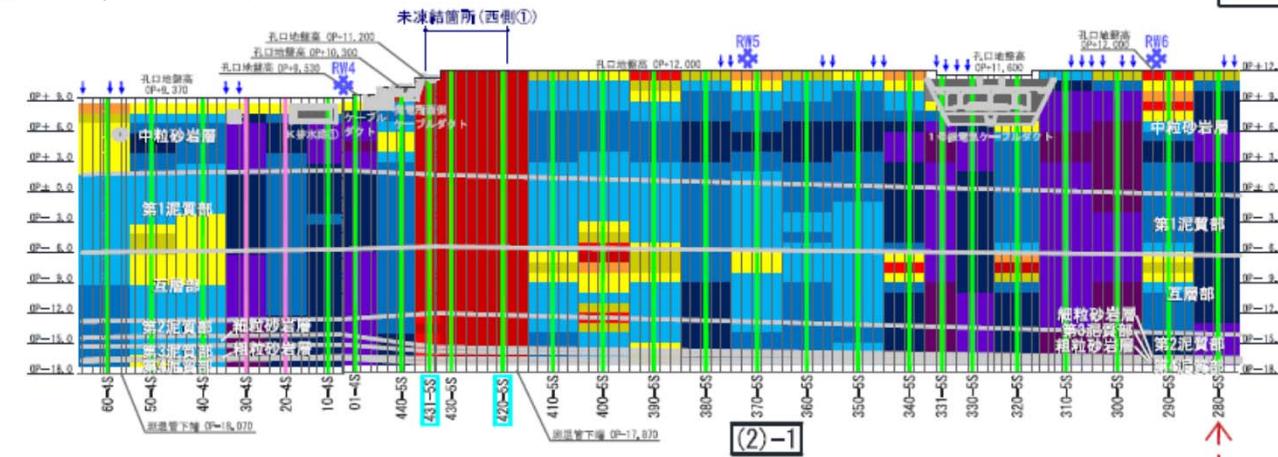

(2)-1

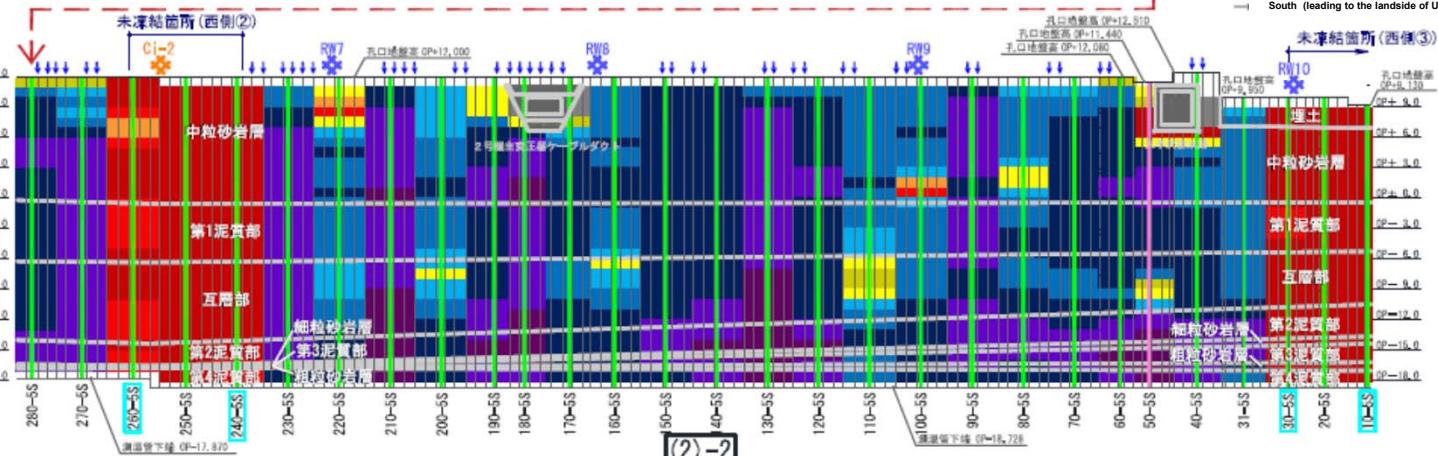

*No measurement:
white
Buried part:
grey


[Reference] Distribution map of soil temperatures (west side of Units 3-4)

TEPCO

Distribution map of soil temperatures

(3) Landside of Units 3-4 (a view from the west side)

(The temperature data as of 7 a.m. on August 2.)

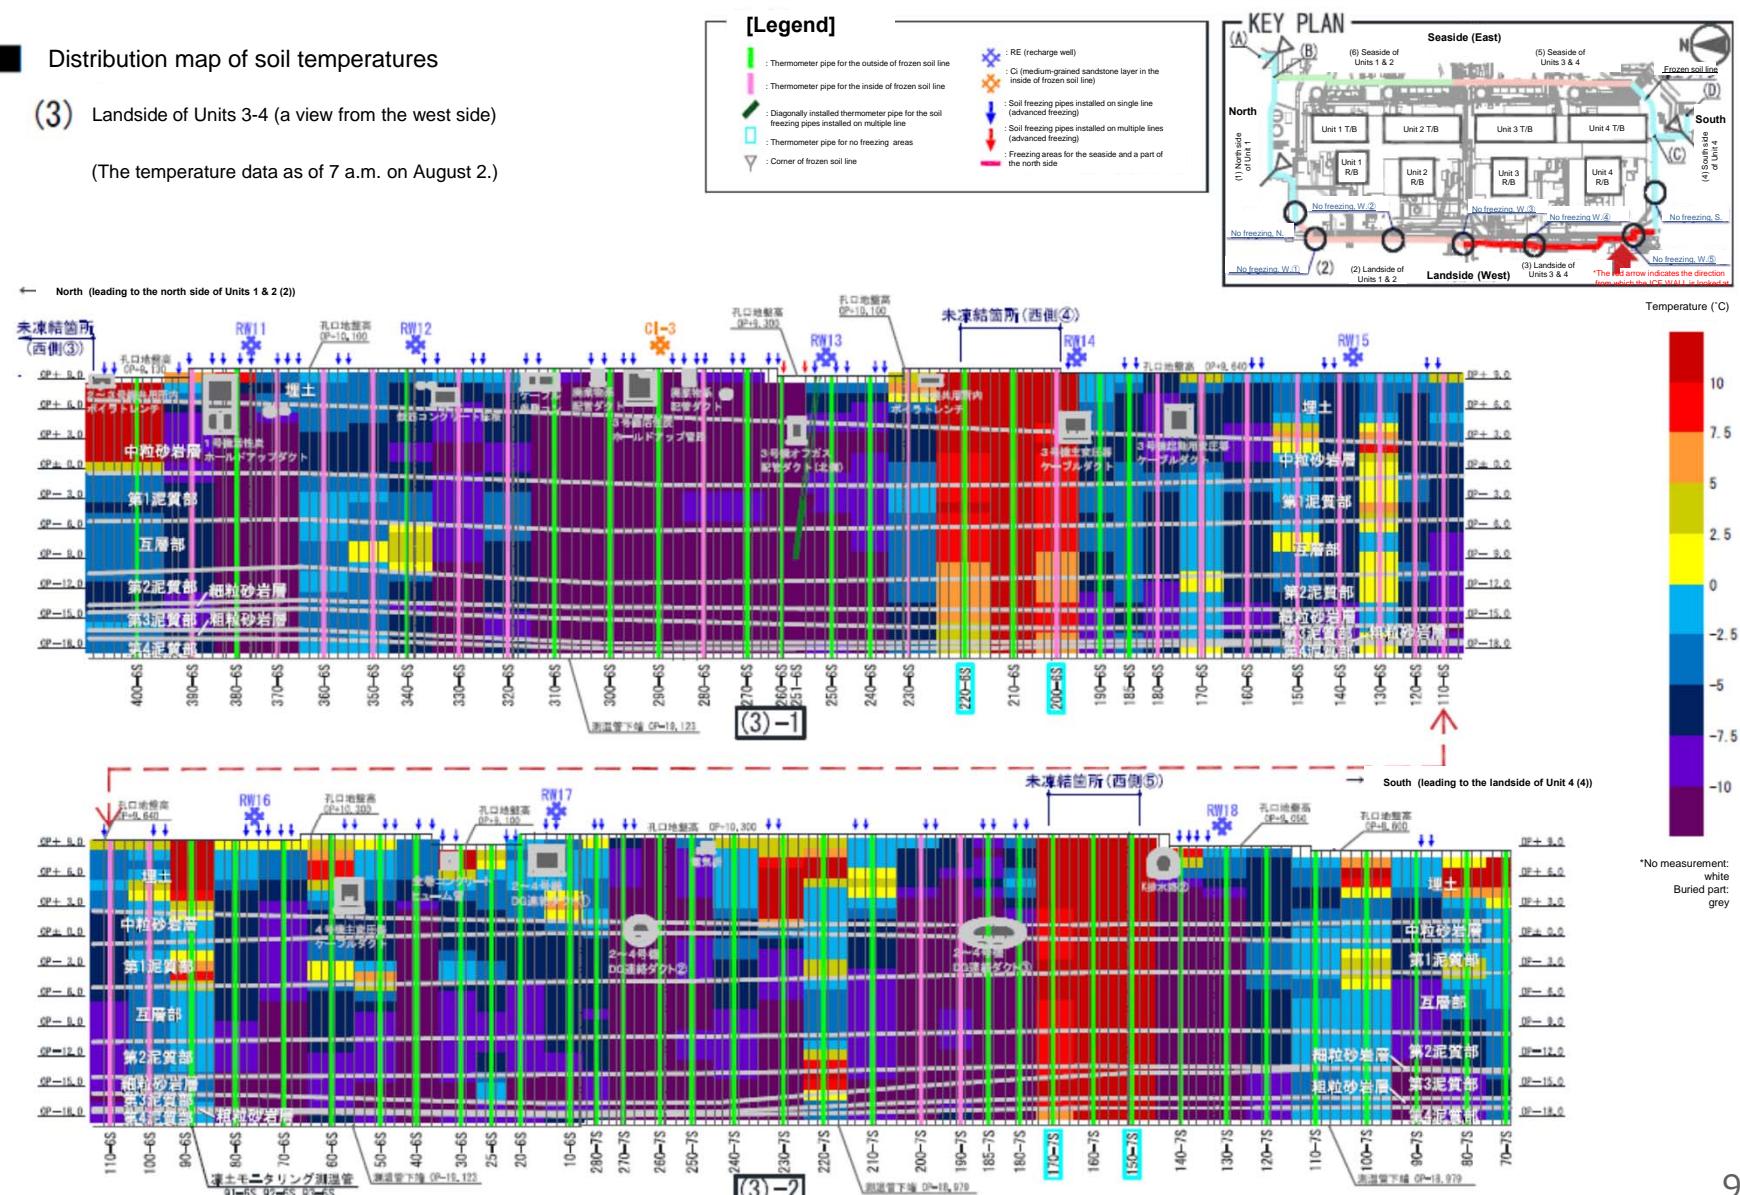

[Reference] Distribution map of soil temperatures (south side of Unit 4)

TEPCO



Distribution map of soil temperatures

(4) South side of Unit 4 (a view from the south side)

(The temperature data as of 7 a.m. on August 2.)

[Legend]

- Thermometer pipe for the outside of frozen soil line
- Thermometer pipe for the inside of frozen soil line
- Diagonally installed thermometer pipe for the soil freezing pipes installed on multiple line
- Thermometer pipe for no freezing areas
- ▼ Corner of frozen soil line
- RE (recharge well)
- Ci (medium-grained sandstone layer in the inside of frozen soil line)
- Soil freezing pipes installed on single line (advanced freezing)
- Soil freezing pipes installed on multiple lines (advanced freezing)
- Freezing areas for the seaside and a part of the north side

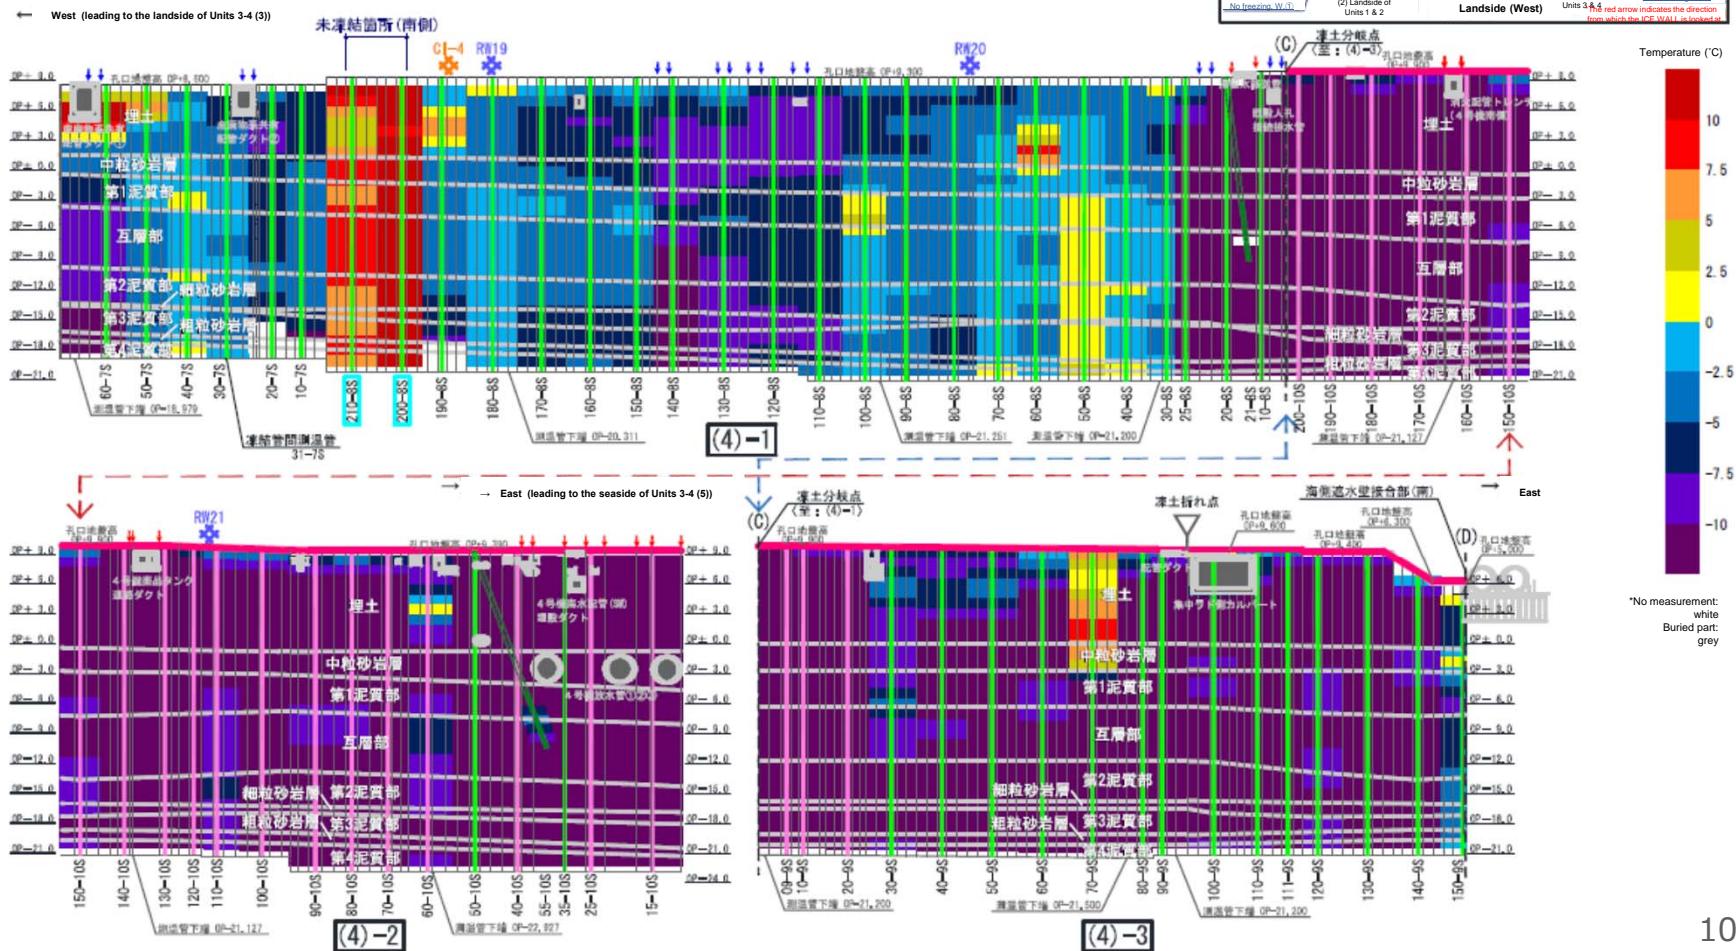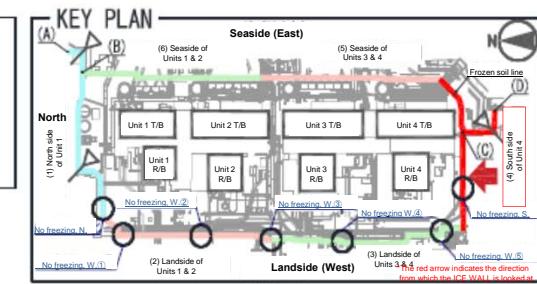

[Reference] Distribution map of soil temperatures (east side of Units 3-4)

TEPCO

Distribution map of soil temperatures



(5) Seaside of Units 3-4
(west side: a view from the inside of frozen soil)

(The temperature data as of 7 a.m. on August 2.)

[Legend]

- Thermometer pipe for the outside of frozen soil line
- Thermometer pipe for the inside of frozen soil line
- Diagonally installed thermometer pipe for the soil freezing pipes installed on multiple line
- Thermometer pipe for no freezing areas
- ▼ Corner of frozen soil line
- ✖ RE (recharge well)
- ✖ CI (medium-grained sandstone layer in the inside of frozen soil line)
- ↓ Soil freezing pipes installed on single line (advanced freezing)
- ↓ Soil freezing pipes installed on multiple lines (advanced freezing)
- Freezing areas for the seaside and a part of the north side

KEY PLAN

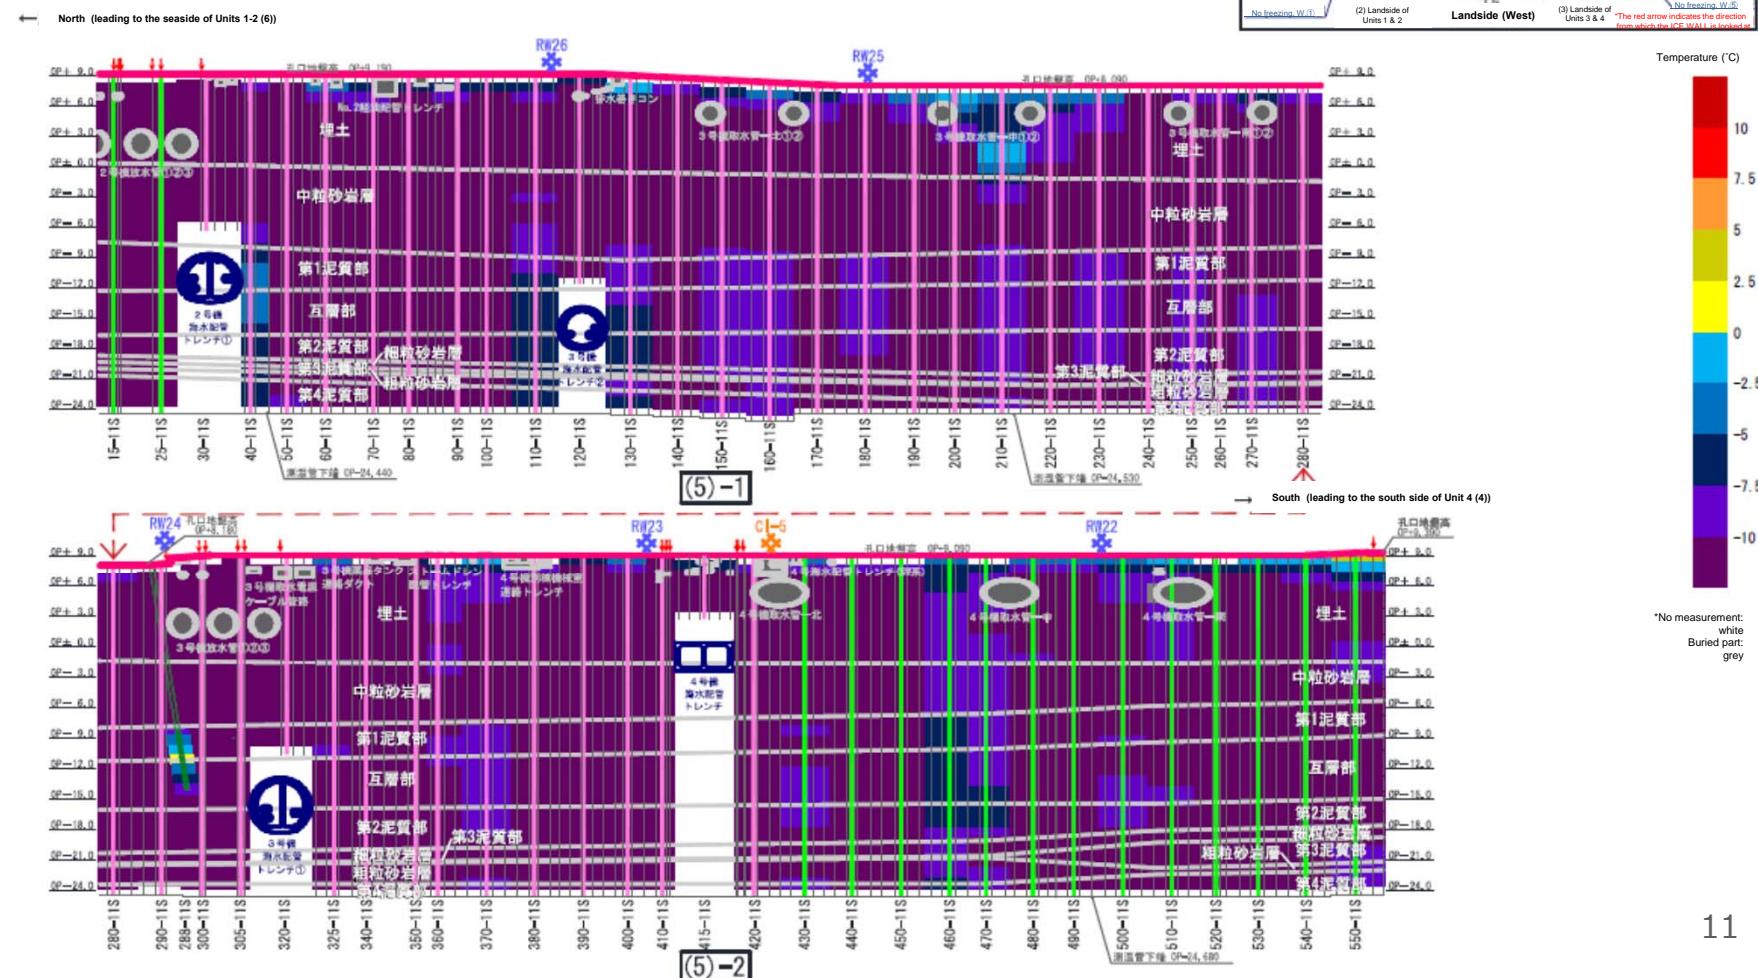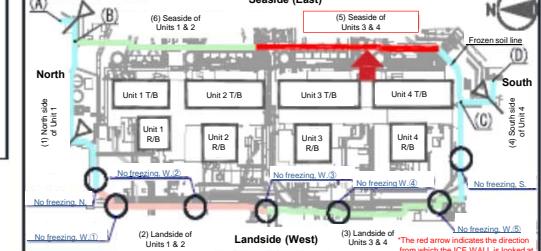

[Reference] Distribution map of soil temperature (east side of Units 1-2)

TEPCO

Distribution map of soil temperatures

(6) Seaside of Units 1-2
(west side: a view from the inside of frozen soil)

(The temperature data as of 7 a.m. on August 2.)

