


### Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings

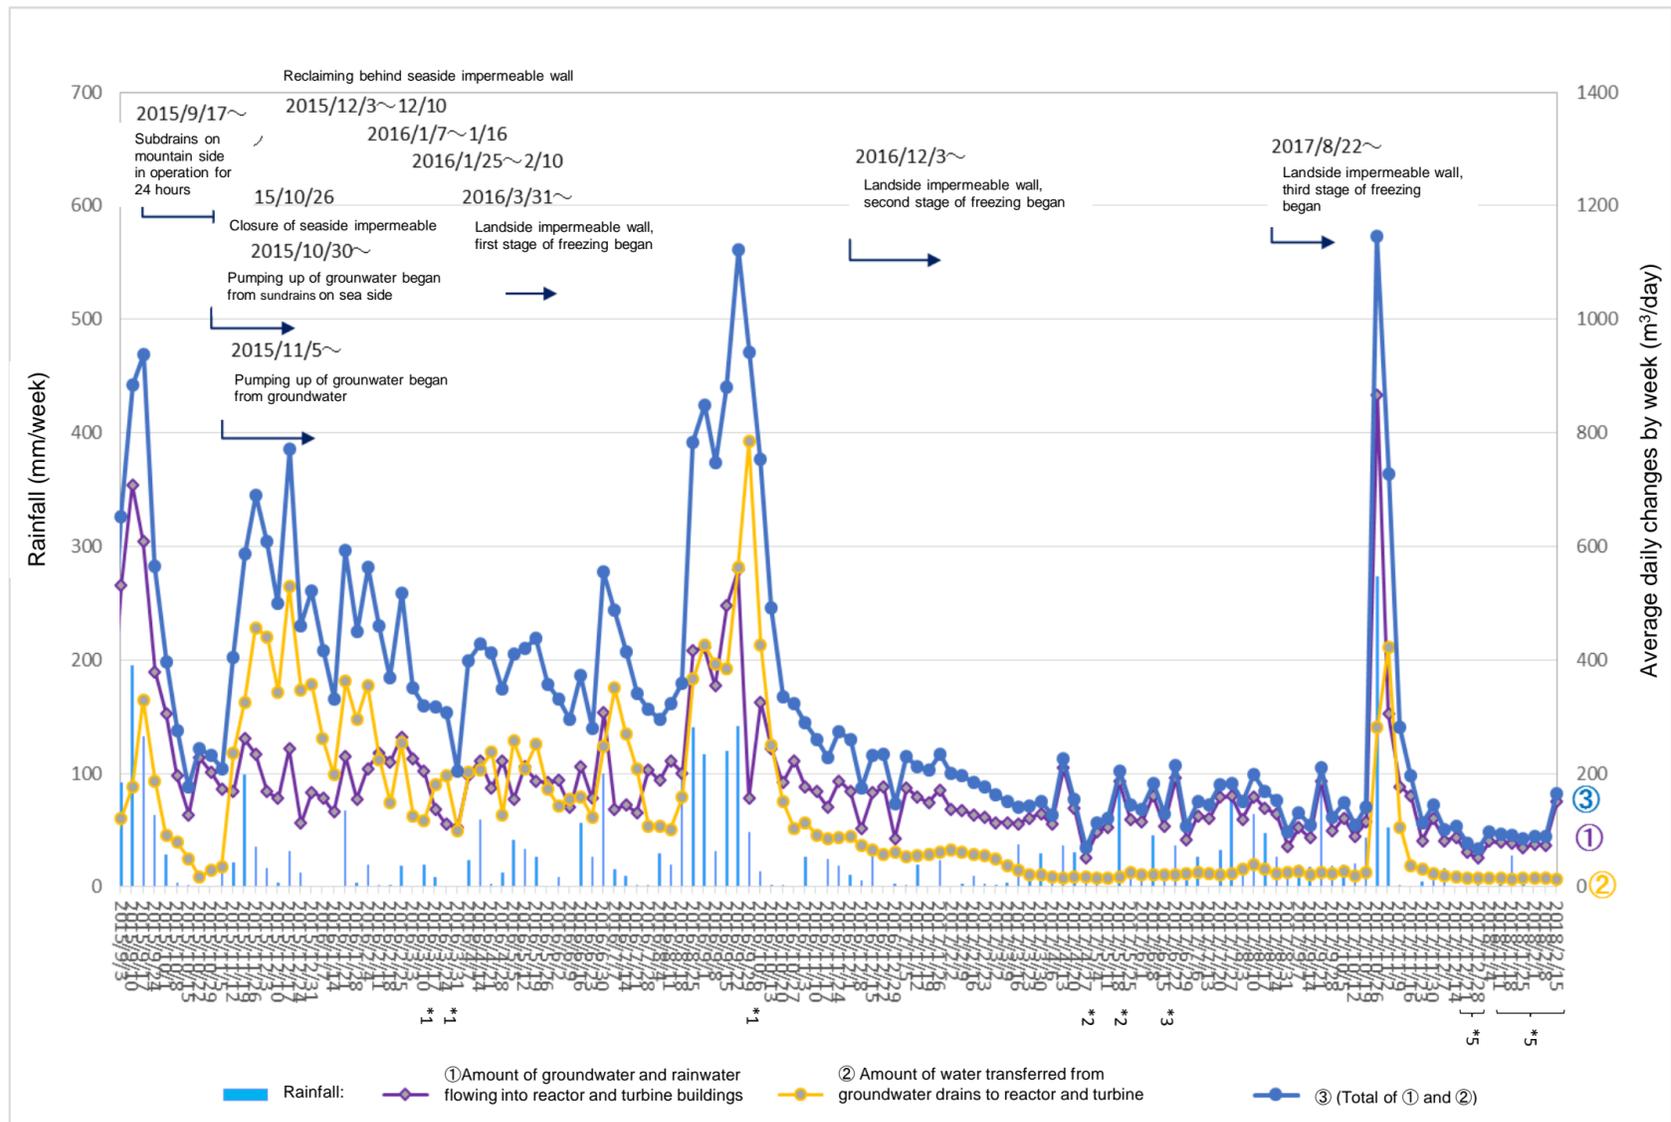

### Amount of water transferred from groundwater drains to reactor and turbine buildings (From February 8, 2018 to February 14, 2018/ 24 hours per day)

Date	Temporary storage tanks				(Reference) improved wells and well points				(Reference) Amount of water transferred to turbine buildings [(α)+(β)]
	A	B	C	Total*4 (α)	Between Units 1-2	Between Units 2-3	Between Units 3-4	Total*4 (β)	
Feb.8	0	0	0	0	16	0	0	16	16
Feb.9	0	0	0	0	17	0	0	17	17
Feb.10	0	0	0	0	8	0	0	8	8
Feb.11	0	0	0	0	16	0	0	16	16
Feb.12	0	0	0	0	17	0	0	17	17
Feb.13	0	0	0	0	8	0	0	8	8
Feb.14	0	0	0	0	16	0	0	16	16

\*①Amount of groundwater and rainwater flowing into reactor and turbine buildings: 151m<sup>3</sup>/day, ②Amount of water transferred from groundwater drains to reactor and turbine buildings: 14m<sup>3</sup>/day, ③(Total of ① and ②): 165m<sup>3</sup>/day, Rainfall: 0mm/week

\*1 Water gauges in reactor and turbine buildings were calibrated.

\*2 The amount of water levels conjectures uncertain cross-section for corresponding to the water level, that is needed to calculate for storage capacity of centralized reactive waste treatment facility.

\*3 The amount of water levels was revision the cross-section for corresponding to the water level, that is needed to calculate for storage capacity of centralized reactive waste treatment facility from June 1, 2017 on.

\*4 There are cases where there is a difference between the sum of each number on the table above and the "total" because the "total" is the sum of numbers with one digit after the decimal point.

\*5 In the amount of groundwater and rainwater flowing into the Unit1 was conducted, excluding the trenches.