



Measurement Results of the Accumulated Water Levels and Temperatures in the Mid-basement Floor of Unit 1 Reactor Building at Fukushima Daiichi Nuclear Power Station

< Reference >
September 20, 2012
Tokyo Electric Power Company

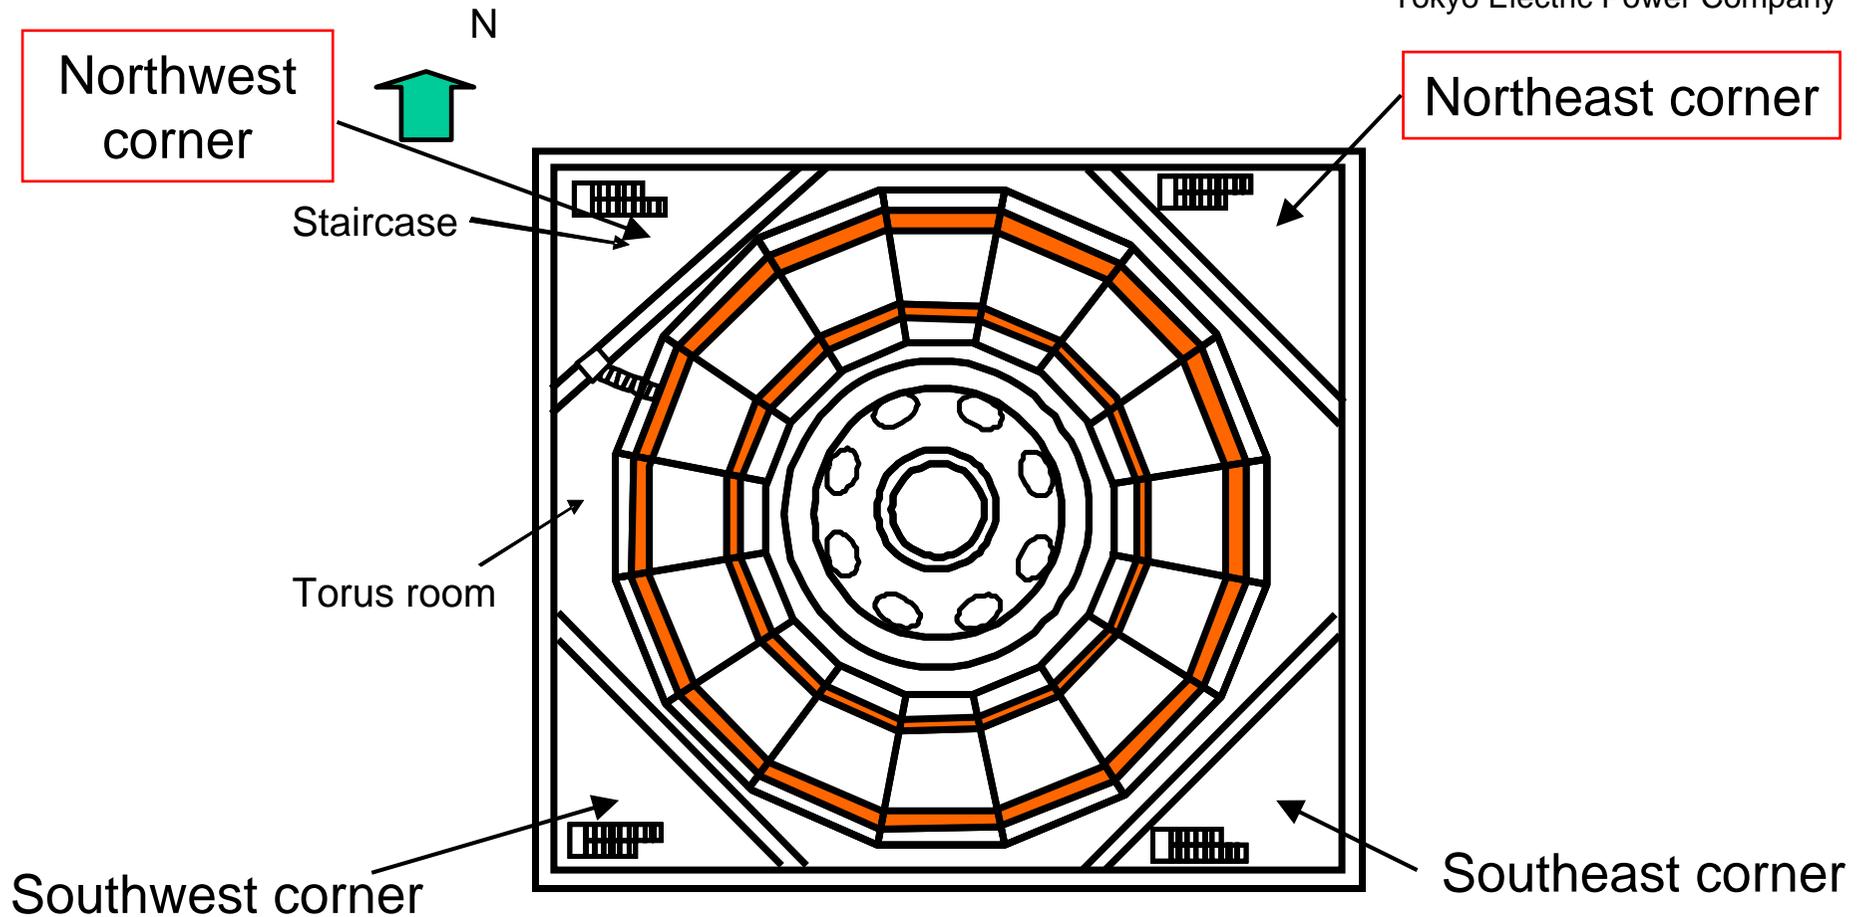

Mid-basement floor of the Reactor Building

Measurement at Unit 1 Triangle Corner (September 20, 2012)

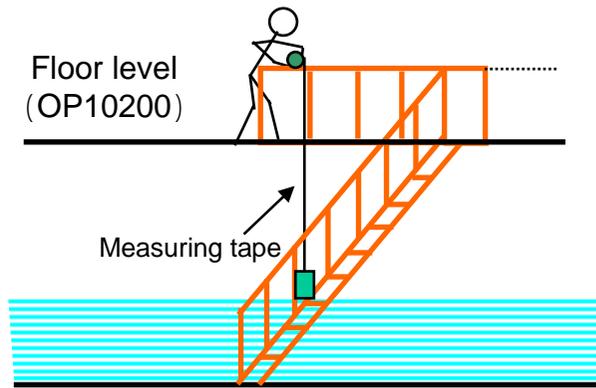

Water level measurement

	Location	Water level
Water level measurement results	Northeast corner	OP 3910 mm
	Northwest corner	OP 4420 mm

	Location	Temperature
Temperature measurement results	Northeast corner	32.4
	Northwest corner	32.6

- Exposure dose (Result)
- Planned dose: 9mSv
 - Actual dose: 1.72mSv (Max.)